OIL ANALYSIS REPORT

Sample Rating Trend

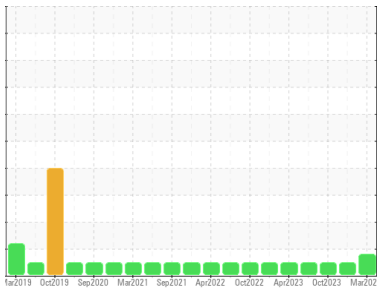

SEDIMENT

Machine Id
INGERSOLL RAND R110I-A125 4 IR (S/N V3443U18080)
Component
Air Compressor
Fluid
USPI MAX FG AIR 46 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of visible silt present in the sample.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**USPM36644**	USPM30602	USPM31090
Sample Date		Client Info		**27 Mar 2024**	09 Jan 2024	17 Oct 2023
Machine Age	hrs	Client Info		**31284**	29722	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	**0**	0	0
Chromium	ppm	ASTM D5185m	>15	**0**	<1	0
Nickel	ppm	ASTM D5185m	>6	**0**	0	<1
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	0	0
Lead	ppm	ASTM D5185m	>20	**0**	0	0
Copper	ppm	ASTM D5185m	>80	**0**	<1	0
Tin	ppm	ASTM D5185m	>15	**0**	0	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	0	**0**	0	0
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	<1
Magnesium	ppm	ASTM D5185m	0	**0**	<1	0
Calcium	ppm	ASTM D5185m	0	**0**	0	1
Phosphorus	ppm	ASTM D5185m	0	**0**	3	5
Zinc	ppm	ASTM D5185m	0	**0**	0	0
Sulfur	ppm	ASTM D5185m	0	**0**	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>12	**0**	<1	<1
Sodium	ppm	ASTM D5185m		**<1**	1	2
Potassium	ppm	ASTM D5185m	>20	**0**	<1	<1
Water	%	ASTM D6304	>0.1	**0.013**	0.014	0.020
ppm Water	ppm	ASTM D6304	>1000	**132**	149	207.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**---**	366	269
Particles >6µm		ASTM D7647	>2500	**---**	117	84
Particles >14µm		ASTM D7647	>320	**---**	18	10
Particles >21µm		ASTM D7647	>80	**---**	5	2
Particles >38µm		ASTM D7647	>20	**---**	0	0
Particles >71µm		ASTM D7647	>4	**---**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**---**	16/14/11	15/14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	**0.76**	0.80	0.94

OIL ANALYSIS REPORT

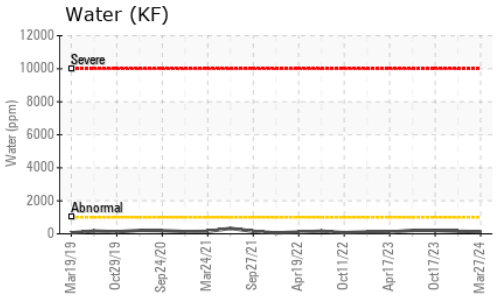

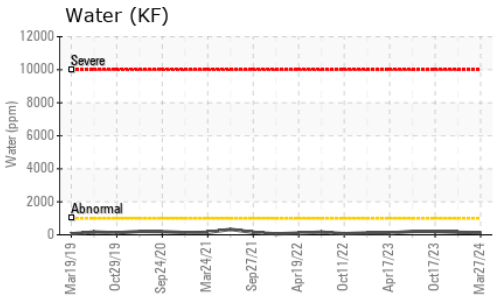

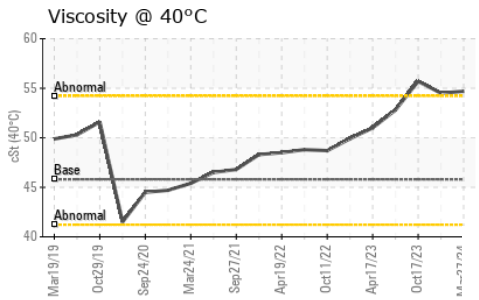

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	▲ **MODER**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	**54.7**	54.5	55.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

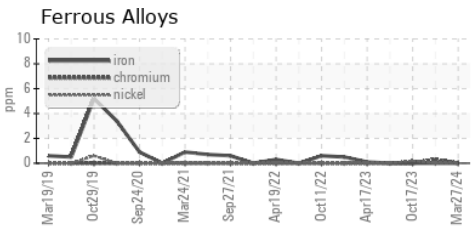

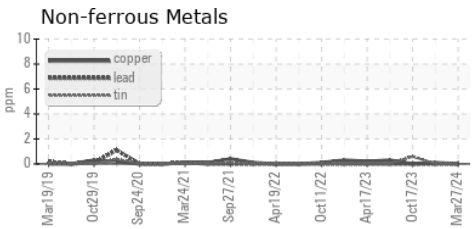

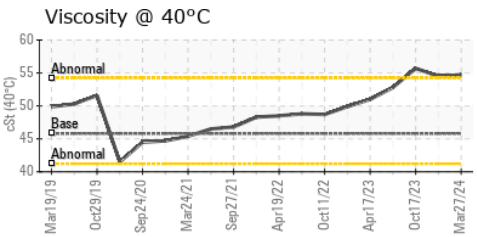

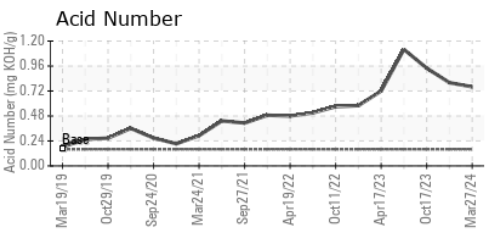

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36644
Lab Number : 06141341
Unique Number : 10966149
Test Package : IND 2

Received : 08 Apr 2024
Tested : 09 Apr 2024
Diagnosed : 09 Apr 2024 - Doug Bogart

TYSON ENT-FAYETTEVILLE-USP

FAYETTEVILLE, AR
US
Contact: RICHARD STOCKTON

T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)