

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

SULLAIR 201707270005 - GKN

Compressor

SULLAIR SULLUBE (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0886212		
Sample Date		Client Info		01 Apr 2024		
Machine Age	hrs	Client Info		35629		
Oil Age	hrs	Client Info		10511		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	745	711		
Molybdenum	ppm	ASTM D5185m	0.0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	0.0	0		
Calcium	ppm	ASTM D5185m	1	0		
Phosphorus	ppm	ASTM D5185m	3	0		
Zinc	ppm	ASTM D5185m	0.1	0		
Sulfur	ppm	ASTM D5185m	240	338		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		39		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.06	0.36		




OIL ANALYSIS REPORT

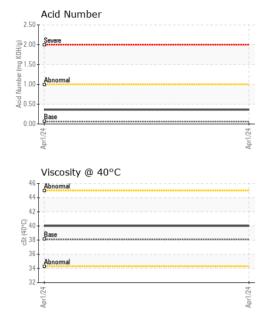



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	38.1	40.0		


Color	no image	no image
Bottom	no image	no image

SAMPLE IMAGES













Certificate 12367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. Lab Number : 06141382

: WC0886212 Unique Number : 10966190

Received : 08 Apr 2024 **Tested** : 09 Apr 2024 Diagnosed

: 10 Apr 2024 - Angela Borella

FS-COMPRESSION CO, LLC 203 AERO COURT GREENSBORO, NC US 27409

Contact: Dallas Burcham

dallas.burcham@fs-compression.com T: (336)605-9622

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

F: (336)605-9844