


OIL ANALYSIS REPORT

Sample Rating Trend

M-460 [9219]

KAESER 58202254 - DEPARTMENT OF DEFENSE (S/N 3359)

Component Compressor

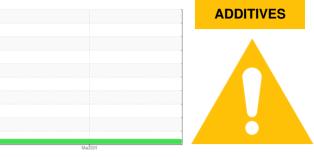

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


An additive depletion is indicated. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06141420		
Sample Date		Client Info		29 Mar 2024		
Machine Age	hrs	Client Info		105		
Oil Age	hrs	Client Info		20		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	<u>^</u> 82		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	86		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	22758		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		



OIL ANALYSIS REPORT

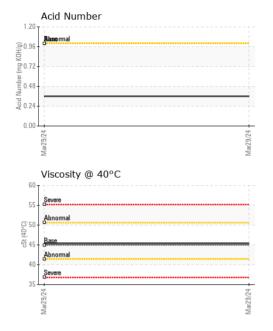


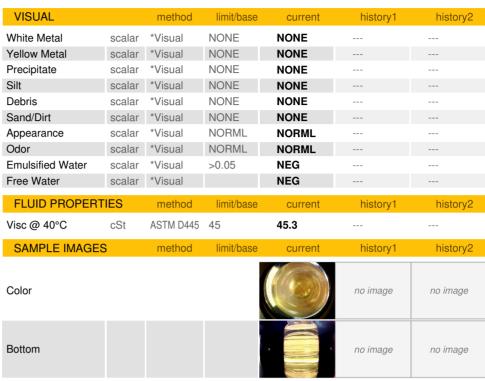


GRAPHS













Certificate 12367

Laboratory Sample No. Lab Number : 06141420

: UDI06141420 Unique Number : 10966228 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 08 Apr 2024 **Tested** : 09 Apr 2024 Diagnosed

: 10 Apr 2024 - Angela Borella

DELTA INDUSTRIES - CEDAR RAPIDS 6540 4TH ST SW UNIT A

CEDAR RAPIDS, IA US 52404

Contact: MICHAEL FERRIS wearcheck@deltaind.net

T: (319)862-2500 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)