


# **OIL ANALYSIS REPORT**

M460 [9164] KAESER 100591.2 - BAYER (S/N 1034)

Component Compressor

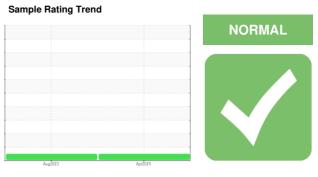

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06141423	UCH05942357	
Sample Date		Client Info		02 Apr 2024	21 Aug 2023	
Machine Age	hrs	Client Info		17001	15496	
Oil Age	hrs	Client Info		3963	2458	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<1	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	34	24	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	65	55	
Calcium	ppm	ASTM D5185m	0	0	3	
Phosphorus	ppm	ASTM D5185m	0	0	3	
Zinc	ppm	ASTM D5185m	0	0	4	
Sulfur	ppm	ASTM D5185m	23500	22315	24025	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		27	18	
Potassium	ppm	ASTM D5185m	>20	4	3	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.38	





# **OIL ANALYSIS REPORT**

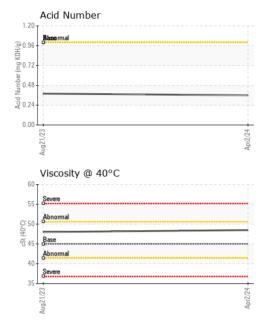



















Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: UDI06141423 Lab Number : 06141423

Unique Number : 10966231

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested** 

: 08 Apr 2024 : 09 Apr 2024 Diagnosed

: 10 Apr 2024 - Angela Borella

**DELTA INDUSTRIES - CEDAR RAPIDS** 

6540 4TH ST SW UNIT A CEDAR RAPIDS, IA US 52404

Contact: MICHAEL FERRIS wearcheck@deltaind.net

T: (319)862-2500 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Contact/Location: MICHAEL FERRIS - UCDELCED