

OIL ANALYSIS REPORT

Area NOT GIVEN INGERSALL RAND CBV738194

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






NORMAL

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06141430		
Sample Date		Client Info		02 Mar 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	506		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	10	0		
Phosphorus	ppm	ASTM D5185m	250	0		
Zinc	ppm	ASTM D5185m	100	0		
Sulfur	ppm	ASTM D5185m	400	332		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		42		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.41		



OIL ANALYSIS REPORT

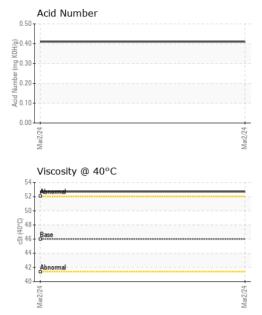

	VISUAL		method				history2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
Mar2/24	Appearance	scalar	*Visual	NORML	NORML		
M	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.8	NEG		
	Free Water	scalar	*Visual		NEG		
	FLUID PROPERT	IES	method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	46	52.7		
	SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Mar2/24 +	Color					no image	no image
	Bottom					no image	no image
	2 0 ⁴⁷ ⁴⁷ ⁴⁷ ⁴⁷ ⁶⁷ ⁶⁷ ⁶⁷ ⁶⁷ ⁶⁷ ⁶⁷ ⁶⁷ ⁶	c		Mar2/24			
	Non-rerrous Metal	3		Mar2/24			
	Viscosity @ 40°C				Acid Number		
	Abnorma 			0.50 0.40 JU 0.40 JU 0.30 0.30 0.20 0.10 V V V V V V V V V V V V V V V V V V V			
	を 参 45 - Abnormal			90.20 N p	+		
	40 40				24		
	Mar2/24			Mar2/24	Mar2/24		
Laboratory Sample No. Lab Number Unique Number		1 Madiso Recei Teste Diagn	JOHN HENRY FOSTER COMPAN 4700 LEBOURGET STREE SAINT LOUIS, M a Borella US 6313 Contact: RACHEL VON HATTE rvonhatten@jhf.co				

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCJOHSAI [WUSCAR] 06141430 (Generated: 04/10/2024 17:16:44) Rev: 1

Contact/Location: RACHEL VON HATTEN - UCJOHSAI

F: (314)874-0965