


# **OIL ANALYSIS REPORT**

# NOT GIVEN **INGERSOLL RAND VNN1192 - PLAZE**

Component Compressor

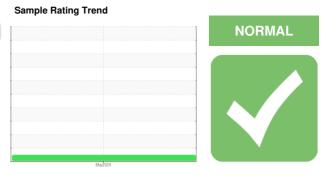

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| SAMPLE INFORM              | MATION | method      | limit/base | current     | history1 | history2 |
|----------------------------|--------|-------------|------------|-------------|----------|----------|
| Sample Number              |        | Client Info |            | UCH06141469 |          |          |
| Sample Date                |        | Client Info |            | 15 Mar 2024 |          |          |
| Machine Age                | hrs    | Client Info |            | 88795       |          |          |
| Oil Age                    | hrs    | Client Info |            | 0           |          |          |
| Oil Changed                |        | Client Info |            | Not Changd  |          |          |
| Sample Status              |        |             |            | NORMAL      |          |          |
| CONTAMINATIO               | N      | method      | limit/base | current     | history1 | history2 |
| Water                      |        | WC Method   | >0.1       | NEG         |          |          |
| WEAR METALS                |        | method      | limit/base | current     | history1 | history2 |
| Iron                       | ppm    | ASTM D5185m | >50        | 0           |          |          |
| Chromium                   | ppm    | ASTM D5185m | >10        | 0           |          |          |
| Nickel                     | ppm    | ASTM D5185m |            | 0           |          |          |
| Titanium                   | ppm    | ASTM D5185m |            | 0           |          |          |
| Silver                     | ppm    | ASTM D5185m |            | 0           |          |          |
| Aluminum                   | ppm    | ASTM D5185m | >25        | 0           |          |          |
| Lead                       | ppm    | ASTM D5185m | >25        | 0           |          |          |
| Copper                     | ppm    | ASTM D5185m | >50        | 0           |          |          |
| Tin                        | ppm    | ASTM D5185m | >15        | 0           |          |          |
| Vanadium                   | ppm    | ASTM D5185m |            | 0           |          |          |
| Cadmium                    | ppm    | ASTM D5185m |            | 0           |          |          |
| ADDITIVES                  |        | method      | limit/base | current     | history1 | history2 |
| Boron                      | ppm    | ASTM D5185m |            | 0           |          |          |
| Barium                     | ppm    | ASTM D5185m |            | 6           |          |          |
| Molybdenum                 | ppm    | ASTM D5185m |            | 0           |          |          |
| Manganese                  | ppm    | ASTM D5185m |            | 0           |          |          |
| Magnesium                  | ppm    | ASTM D5185m |            | 0           |          |          |
| Calcium                    | ppm    | ASTM D5185m |            | 0           |          |          |
| Phosphorus                 | ppm    | ASTM D5185m |            | 194         |          |          |
| Zinc                       | ppm    | ASTM D5185m |            | 0           |          |          |
| Sulfur                     | ppm    | ASTM D5185m |            | 288         |          |          |
| CONTAMINANTS               | 3      | method      | limit/base | current     | history1 | history2 |
| Silicon                    | ppm    | ASTM D5185m | >25        | <1          |          |          |
| Sodium                     | ppm    | ASTM D5185m |            | 4           |          |          |
|                            | ppm    | ASTM D5185m | >20        | 0           |          |          |
| Potassium                  | 1-1-   |             |            |             |          |          |
| Potassium<br>FLUID DEGRADA |        | method      | limit/base | current     | history1 | history2 |





## **OIL ANALYSIS REPORT**

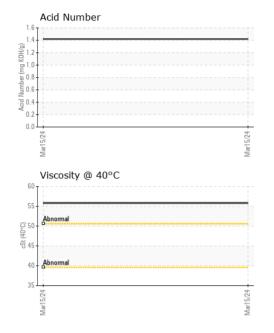



| VISUAL                  |        | method    | limit/base | current | history1 | history2 |
|-------------------------|--------|-----------|------------|---------|----------|----------|
| White Metal             | scalar | *Visual   | NONE       | NONE    |          |          |
| Yellow Metal            | scalar | *Visual   | NONE       | NONE    |          |          |
| Precipitate             | scalar | *Visual   | NONE       | NONE    |          |          |
| Silt                    | scalar | *Visual   | NONE       | MODER   |          |          |
| Debris                  | scalar | *Visual   | NONE       | NONE    |          |          |
| Sand/Dirt               | scalar | *Visual   | NONE       | NONE    |          |          |
| Appearance              | scalar | *Visual   | NORML      | NORML   |          |          |
| Odor                    | scalar | *Visual   | NORML      | NORML   |          |          |
| <b>Emulsified Water</b> | scalar | *Visual   | >0.1       | NEG     |          |          |
| Free Water              | scalar | *Visual   |            | NEG     |          |          |
| FLUID PROPERT           | TIES   | method    | limit/base | current | history1 | history2 |
| Visc @ 40°C             | cSt    | ASTM D445 |            | 55.8    |          |          |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color         |        |            |         | no image | no image |
| Bottom        |        |            |         | no image | no image |













Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06141469

: UCH06141469 Unique Number : 10966277

Received : 08 Apr 2024 **Tested** : 09 Apr 2024

Diagnosed : 10 Apr 2024 - Angela Borella JOHN HENRY FOSTER COMPANY

4700 LEBOURGET STREET SAINT LOUIS, MO US 63134

Contact: RACHEL VON HATTEN rvonhatten@jhf.com

T: (314)593-1267 F: (314)874-0965

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)