


OIL ANALYSIS REPORT

ULTRA COOLANT SSR

INGERSOLL RAND CBV798818 - WASHINGTON UNIVERSITY

Component





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06141470	UCH05889137	
Sample Date		Client Info		21 Mar 2024	26 Jun 2023	
Machine Age	hrs	Client Info		6135	2663	
Oil Age	hrs	Client Info		6135	2663	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	J	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	0	<1	
Tin	ppm	ASTM D5185m	>15	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	500	387	515	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	0	0	<1	
Calcium	ppm	ASTM D5185m	0	0	2	
Phosphorus	ppm	ASTM D5185m	20	0	0	
Zinc	ppm	ASTM D5185m	0	0	3	
Sulfur	ppm	ASTM D5185m	200	334	326	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	
Sodium	ppm	ASTM D5185m		44	23	
Potassium	ppm	ASTM D5185m	>20	4	4	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


0.322

0.23

Acid Number (AN) mg KOH/g ASTM D8045




OIL ANALYSIS REPORT

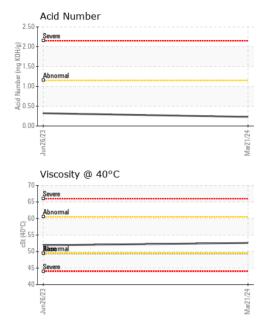



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	52.6	51.9	
	_					


Color no image **Bottom** no image **GRAPHS**

Ferrous Alloys













Certificate 12367

Laboratory Sample No.

Lab Number : 06141470

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06141470 Unique Number : 10966278

Received **Tested** Diagnosed

: 08 Apr 2024 : 09 Apr 2024 : 10 Apr 2024 - Angela Borella

JOHN HENRY FOSTER COMPANY

4700 LEBOURGET STREET SAINT LOUIS, MO US 63134

Contact: RACHEL VON HATTEN rvonhatten@jhf.com

T: (314)593-1267 F: (314)874-0965

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCJOHSAI [WUSCAR] 06141470 (Generated: 04/10/2024 17:35:13) Rev: 1

Contact/Location: RACHEL VON HATTEN - UCJOHSAI