

OIL ANALYSIS REPORT

Area ACS [416794] ATLAS COPCO ITJ079722 - RAY MEES AUTO Component Compressor

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06141503		
Sample Date		Client Info		20 Mar 2024		
Machine Age	hrs	Client Info		13090		
Oil Age	hrs	Client Info		3800		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		33		
Zinc	ppm	ASTM D5185m		76		
Sulfur	ppm	ASTM D5185m		52		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.15		



OIL ANALYSIS REPORT

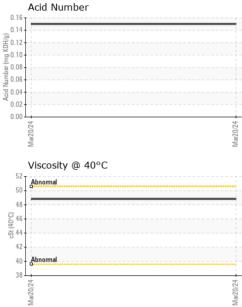

Laboratory ANAB Sample No.		Recei	∑ ≥ Madison Ave., Cary, NC 27513 Received : 08 Apr 2024 Tested : 09 Apr 2024			AIRMATIC COMPRESSOR SYSTEMS 700 WASHINGTON AVE CARLSTADT, N		
		50 + 50			Mar20/24 Mar20/24 Acid Number (ma K0H/g) 0.000 Acid Number (ma	Mar2024		Acrossed Acrossed
		Viscosity @ 40	С		H(g) 10.024	Acid Number		
		E 6 4 Copper lead						
		0↓ • 2002 ₩ Non-ferrous Me	tals		Mar20/24			
		E 6 4 2						
		GRAPHS Ferrous Alloys						
	M	Bottom					no image	no image
	Mar20/24 +	Color		method			no image	no image
		Visc @ 40°C SAMPLE IMAG	cSt	ASTM D445 method	limit/base	48.8 current	 history1	 history2
		FLUID PROPE	RTIES	method	limit/base	current	history1	history2
		Free Water	scalar	*Visual		NEG		
	M	Odor Emulsified Water	scalar scalar	*Visual *Visual	NORML >0.1	NORML NEG		
	Mar20/24	Appearance	scalar	*Visual	NORML	NORML		
		Sand/Dirt	scalar	*Visual	NONE	NONE		
		Silt Debris	scalar scalar	*Visual *Visual	NONE NONE	NONE NONE		
		Precipitate	scalar	*Visual	NONE	NONE		
		Yellow Metal	scalar	*Visual	NONE	NONE		

Contact/Location: ELVIN DIAZ - UCAIRCAR