




OIL ANALYSIS REPORT



Machine Id
DECM01BE (S/N ZBA01290)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (100 GAL)

Sample Rating Trend

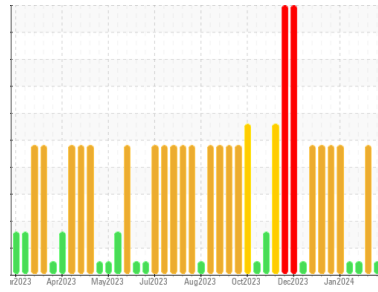

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0732895	WC0732891	WC0732899
Sample Date	Client Info		03 Apr 2024	12 Mar 2024	23 Feb 2024
Machine Age	hrs	Client Info	58345	58147	57725
Oil Age	hrs	Client Info	56062	56062	56062
Oil Changed	Client Info		Changed	Oil Added	Oil Added
Sample Status			NORMAL	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	3	2	3
Chromium	ppm	ASTM D5185m	>4	0	<1	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>6	1	4	2
Lead	ppm	ASTM D5185m	>9	<1	1	0
Copper	ppm	ASTM D5185m	>6	1	2	2
Tin	ppm	ASTM D5185m	>4	<1	3	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		7	6	5
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		11	8	9
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		29	38	39
Calcium	ppm	ASTM D5185m		1899	2193	1931
Phosphorus	ppm	ASTM D5185m		290	376	301
Zinc	ppm	ASTM D5185m		361	490	377
Sulfur	ppm	ASTM D5185m		2589	3594	2339

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	152	▲ 349	174
Sodium	ppm	ASTM D5185m	>21	<1	2	1
Potassium	ppm	ASTM D5185m	>20	<1	4	2

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624		5.6	7.0	6.3
Sulfation	Abs/.1mm	*ASTM D7415		17.1	21.7	19.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414		10.0	16.7	13.3
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.62	1.69	1.21
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	4.60	3.93	4.26




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

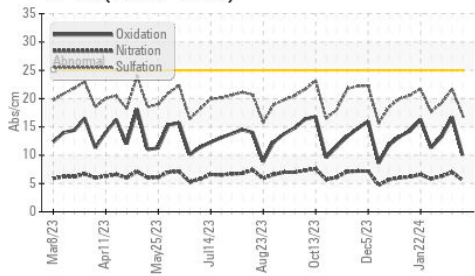


Acid Number

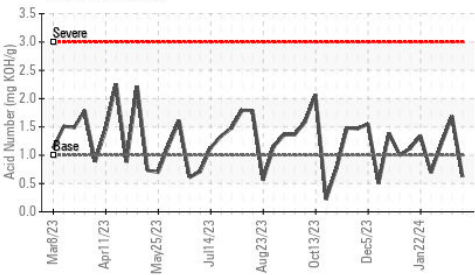

Base Number

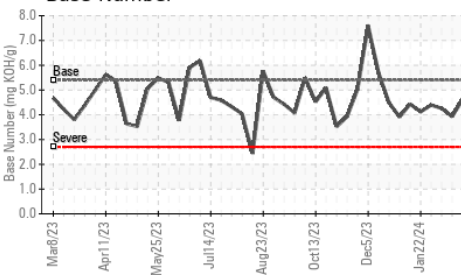

Viscosity @ 100°C

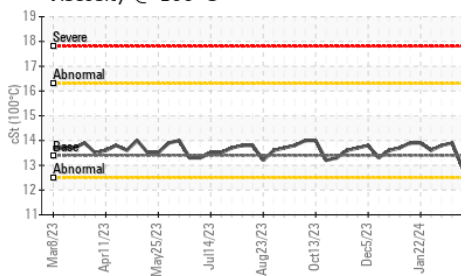


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	12.9	13.9

GRAPHS


Iron (ppm)

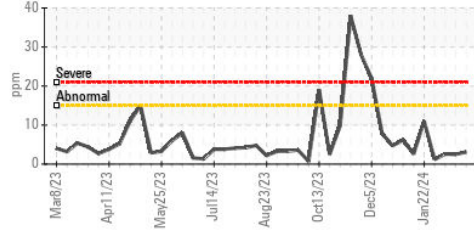


Lead (ppm)

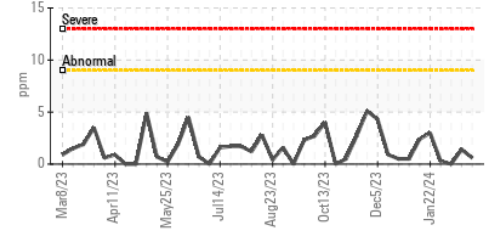


Aluminum (ppm)

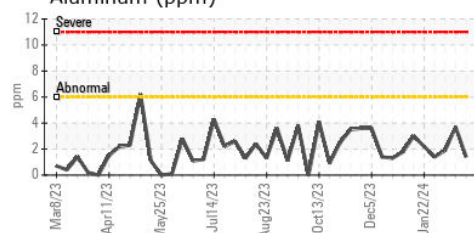


Chromium (ppm)

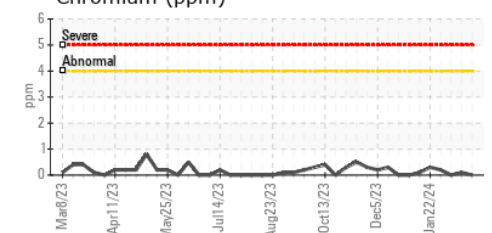


Copper (ppm)

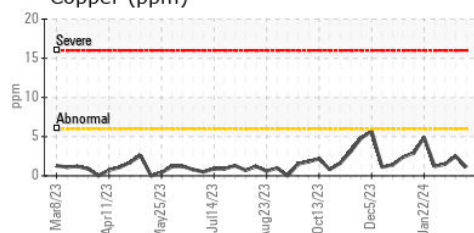


Silicon (ppm)

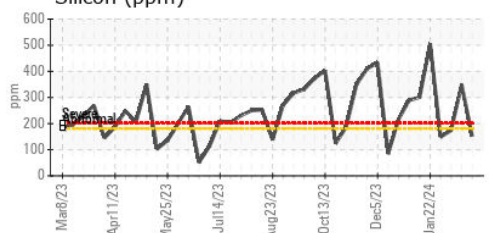

Viscosity @ 100°C

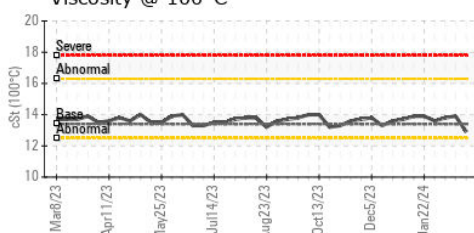

Base Number

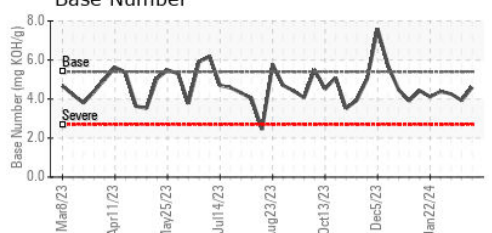

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0732895 **Received** : 08 Apr 2024
Lab Number : 06141528 **Tested** : 09 Apr 2024
Unique Number : 10966336 **Diagnosed** : 10 Apr 2024 - Sean Felton
Test Package : MOB 2

EDL NA Recips-Decatur
 620 LANDFILL DRIVE
 TRINITY, AL 35673
 Contact: JEFF SUMMERS
 jeff.summers@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)