

OIL ANALYSIS REPORT

Sample Rating Trend



WEAR



Area
AAA
Machine Id
MAZAK 314301
Component
Spindel
Fluid
FUCHS RENOLIN ZAF B 10 HT ZINC FREE (9 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The copper level is abnormal. All other component wear rates are normal.

● Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the fluid.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		FCH0000020	---	---
Sample Date	Client Info		27 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	10	---	---
Chromium	ppm	ASTM D5185m >2	0	---	---
Nickel	ppm	ASTM D5185m >2	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >2	0	---	---
Lead	ppm	ASTM D5185m >25	0	---	---
Copper	ppm	ASTM D5185m >7	▲ 73	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	0	---	---
Calcium	ppm	ASTM D5185m	7	---	---
Phosphorus	ppm	ASTM D5185m	53	---	---
Zinc	ppm	ASTM D5185m	55	---	---
Sulfur	ppm	ASTM D5185m	1022	---	---


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >20	2	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304 >0.1	NEG	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	● 10538	---	---
Particles >6µm	ASTM D7647	>2500	988	---	---
Particles >14µm	ASTM D7647	>160	66	---	---
Particles >21µm	ASTM D7647	>40	17	---	---
Particles >38µm	ASTM D7647	>10	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/14	● 21/17/13	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.045	---	---

OIL ANALYSIS REPORT


Particle Trend

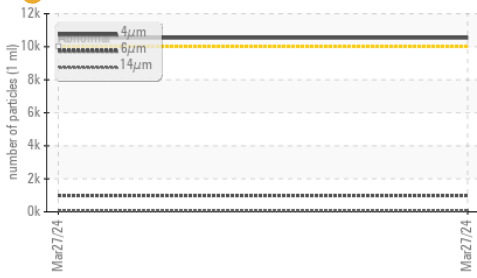


Particle Count

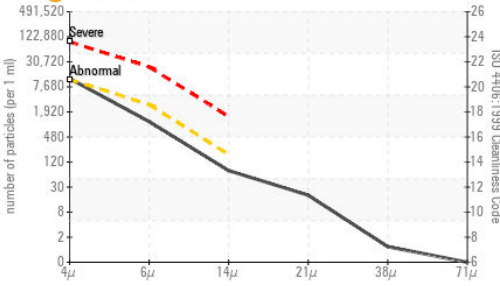


Particle Trend

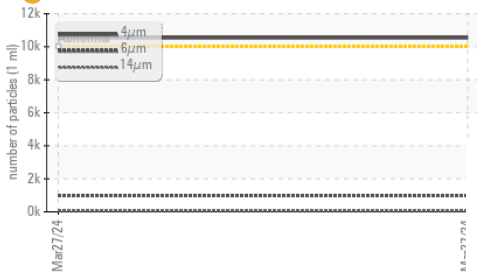

Acid Number

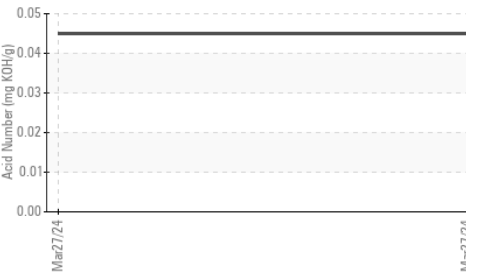

Viscosity @ 40°C

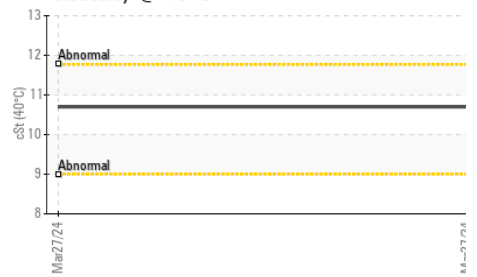





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	10.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

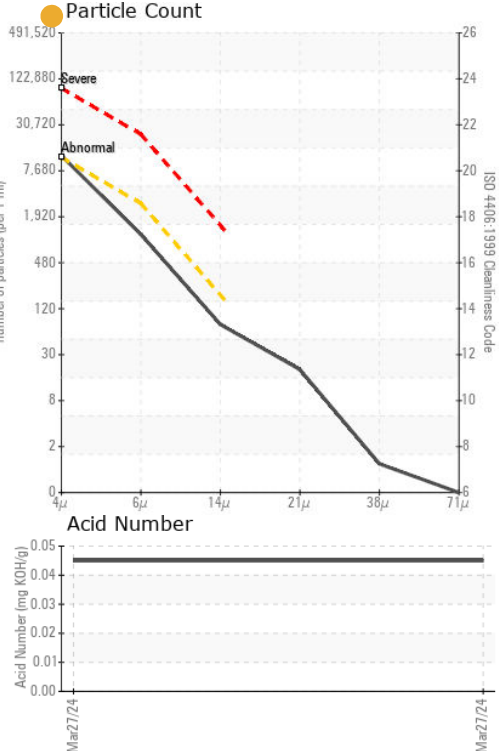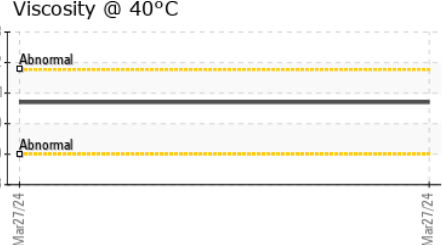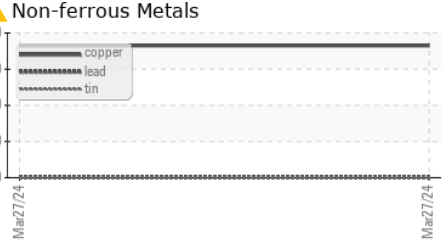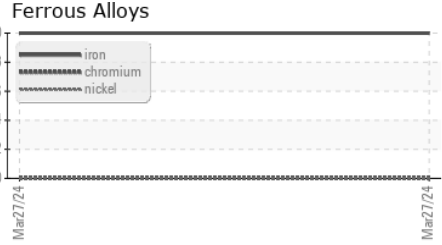

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : FCH0000020 **Received** : 08 Apr 2024
Lab Number : 06141884 **Tested** : 10 Apr 2024
Unique Number : 10966692 **Diagnosed** : 10 Apr 2024 - Doug Bogart
Test Package : PLANT

DANA - FAIRFIELD CUSTOM GEARS AND DRIVES
 2400 SAGAMORE PKWY S #2400
 LAFAYETTE, IN
 US 47905
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)