




OIL ANALYSIS REPORT

Sample Rating Trend

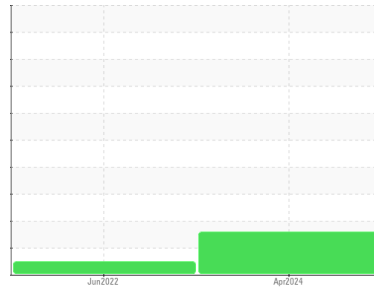

FUEL



Machine Id
Rutledge Landing LS 50kw
 Component
Diesel Engine
 Fluid
SHELL 15W40 (2 GAL)

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

Light fuel dilution occurring.

Fluid Condition

Sulfur ppm levels are abnormally high. Visc @ 100°C is abnormally low. The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0858820	WC0700354	---
Sample Date	Client Info	04 Apr 2024	10 Jun 2022	---
Machine Age	hrs	482	436	---
Oil Age	hrs	46	0	---
Oil Changed	Client Info	Changed	Changed	---
Sample Status		ABNORMAL	NORMAL	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	---
Glycol	WC Method	NEG	NEG	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	4	11	---
Chromium	ppm ASTM D5185m >20	0	<1	---
Nickel	ppm ASTM D5185m >4	0	<1	---
Titanium	ppm ASTM D5185m	<1	1	---
Silver	ppm ASTM D5185m >3	0	1	---
Aluminum	ppm ASTM D5185m >20	1	2	---
Lead	ppm ASTM D5185m >40	1	6	---
Copper	ppm ASTM D5185m >330	9	35	---
Tin	ppm ASTM D5185m >15	<1	5	---
Vanadium	ppm ASTM D5185m	<1	0	---
Cadmium	ppm ASTM D5185m	0	<1	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	141	31	---
Barium	ppm ASTM D5185m	1	0	---
Molybdenum	ppm ASTM D5185m	52	10	---
Manganese	ppm ASTM D5185m	<1	1	---
Magnesium	ppm ASTM D5185m	295	159	---
Calcium	ppm ASTM D5185m	1608	2018	---
Phosphorus	ppm ASTM D5185m	865	906	---
Zinc	ppm ASTM D5185m	1036	1113	---
Sulfur	ppm ASTM D5185m	▲ 3606	3597	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	10	15	---
Sodium	ppm ASTM D5185m >150	<1	3	---
Potassium	ppm ASTM D5185m >20	<1	0	---
Fuel	% ASTM D3524 >5	▲ 2.6	<1.0	---

INFRA-RED





method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	0.1	0.1	---
Nitration	Abs/cm *ASTM D7624 >20	6.5	8.5	---
Sulfation	Abs/.1mm *ASTM D7415 >30	17.3	19.5	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	12.9	16.6	---
Base Number (BN)	mg KOH/g ASTM D2896	6.9	8.1	---











OIL ANALYSIS REPORT

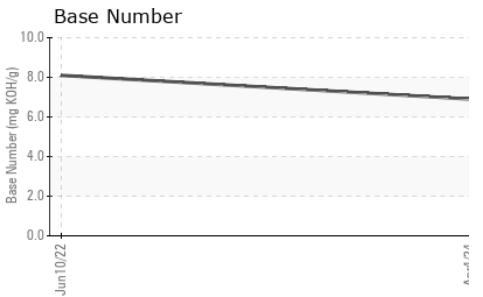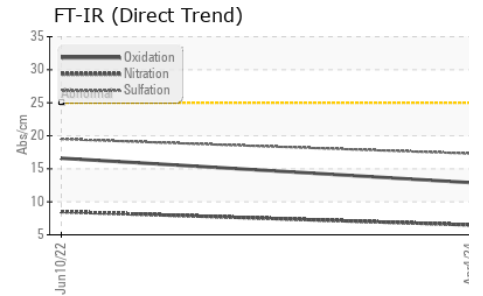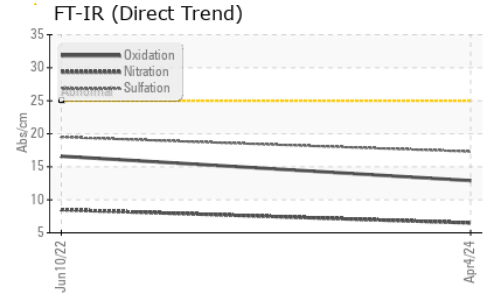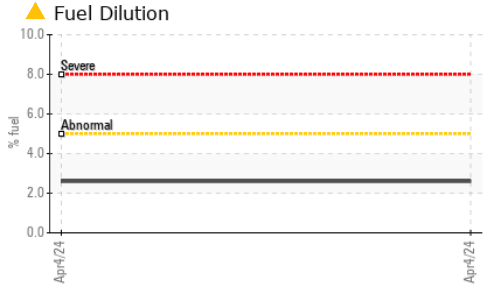

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	▲ 11.7	12.8	---

GRAPHS

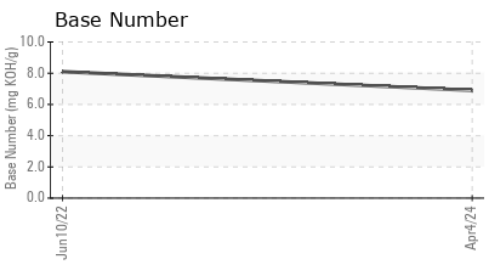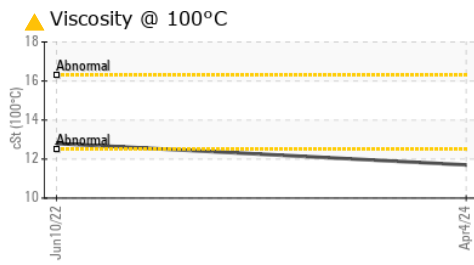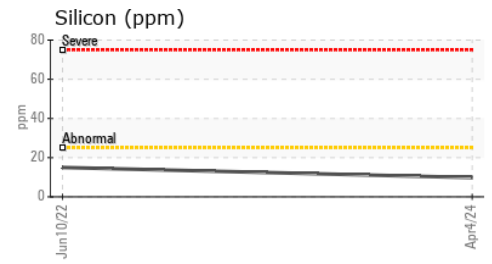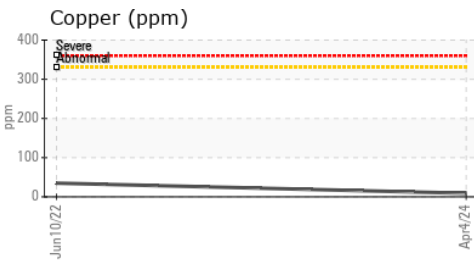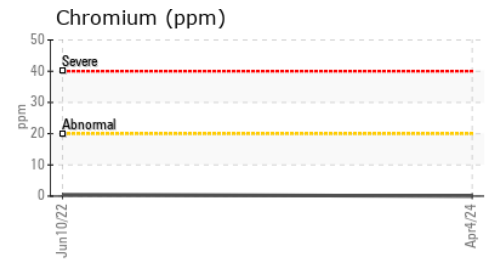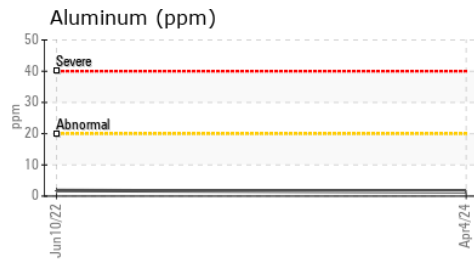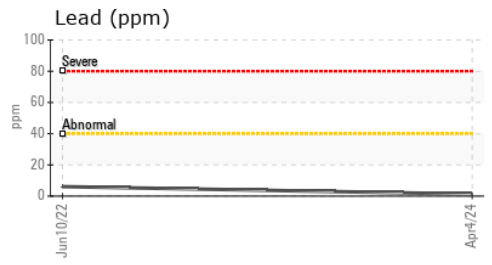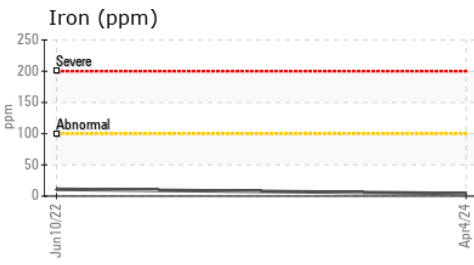

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0858820 **Received** : 08 Apr 2024
Lab Number : 06142003 **Tested** : 11 Apr 2024
Unique Number : 10966811 **Diagnosed** : 11 Apr 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, TBN)

ALTERNATIVE POWER
 1000 NORTHGATE CT
 MORRISVILLE, NC
 US 27560
 Contact: RYAN BAILEY
 ryan.bailey@bittingelectric.com
 T: (919)467-9417
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)