


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 7326119

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May202	2 Jan 2023	Aug ² 023 Ma	w2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015914	KCPA003581	KCP54324
Sample Number		Client Info		27 Mar 2024	30 Aug 2023	19 Jan 2023
Machine Age	hrs	Client Info		26854	21837	16490
Oil Age	hrs	Client Info		5018	0	5209
Oil Changed	1113	Client Info		Changed	N/A	Changed
Sample Status		Ollerit IIIIO		NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	9	15
Tin	ppm	ASTM D5185m	>10	- <1	0	0
Vanadium	ppm	ASTM D5185m	7.0	<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	17	0	24
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	4	0	14
Calcium	ppm		0	4	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	0	6
Zinc	ppm	ASTM D5185m	0	<1	0	0
Sulfur	ppm	ASTM D5185m	23500	20287	19470	16204
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	0	2
Water	%	ASTM D6304	>0.05	0.003	0.005	0.008
ppm Water	ppm	ASTM D6304	>500	39	56.4	81.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1020	2836	3722
Particles >6µm		ASTM D7647	>1300	336	1054	844
Particles >14µm		ASTM D7647	>80	30	81	27
Particles >21μm		ASTM D7647	>20	7	13	4
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12	19/17/14	19/17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -! -! NI I (ANI)		AOTA DOO45	1.0	0.42	0.40	0.44

Acid Number (AN)

mg KOH/g ASTM D8045 1.0


0.40

0.43

0.41



OIL ANALYSIS REPORT

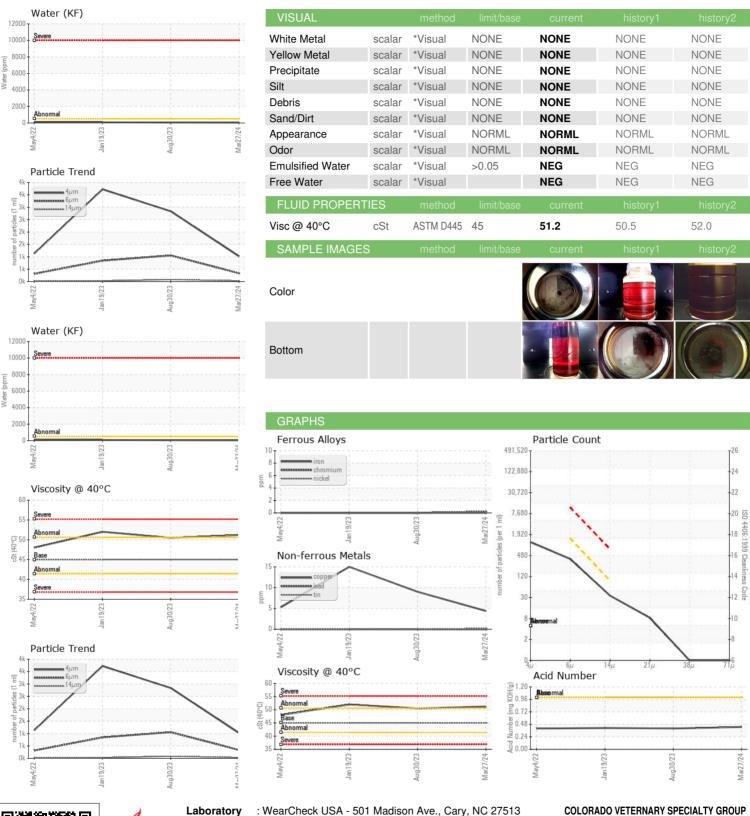



Sample No. Lab Number

: KCPA015914 : 06142228 Unique Number : 10967036

Received **Tested**

: 08 Apr 2024 : 11 Apr 2024 Diagnosed

: 11 Apr 2024 - Don Baldridge

401 E COUNTY LINE RD LITTLETON, CO US 80122

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: COLLIT [WUSCAR] 06142228 (Generated: 04/12/2024 07:08:19) Rev: 1

Contact/Location: Service Manager - COLLIT

T:

F: