




OIL ANALYSIS REPORT

Sample Rating Trend

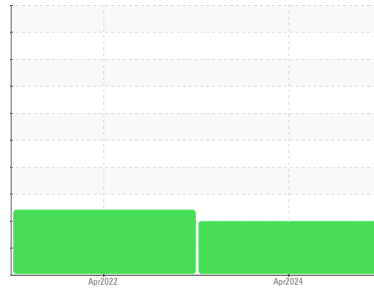

ISO



Machine Id

KAESER 3063556

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA016163	KCP44416	---
Sample Date	Client Info		03 Apr 2024	21 Apr 2022	---
Machine Age	hrs	Client Info	53911	42021	---
Oil Age	hrs	Client Info	0	4000	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	0	<1	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	<1	<1	---
Aluminum	ppm	ASTM D5185m >10	2	0	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	10	10	---
Tin	ppm	ASTM D5185m >10	<1	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	<1	▲ 0	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m 100	2	▲ 0	---
Calcium	ppm	ASTM D5185m 0	3	0	---
Phosphorus	ppm	ASTM D5185m 0	1	3	---
Zinc	ppm	ASTM D5185m 0	0	0	---
Sulfur	ppm	ASTM D5185m 23500	19418	14144	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	4	---
Sodium	ppm	ASTM D5185m	0	1	---
Potassium	ppm	ASTM D5185m >20	1	0	---
Water	%	ASTM D6304 >0.05	0.007	0.004	---
ppm Water	ppm	ASTM D6304 >500	76	45.4	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		26005	13974	---
Particles >6µm	ASTM D7647	>1300	▲ 9039	▲ 3824	---
Particles >14µm	ASTM D7647	>80	▲ 569	▲ 588	---
Particles >21µm	ASTM D7647	>20	▲ 108	▲ 211	---
Particles >38µm	ASTM D7647	>4	1	● 10	---
Particles >71µm	ASTM D7647	>3	0	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	▲ 19/16	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.53	0.51	---


OIL ANALYSIS REPORT

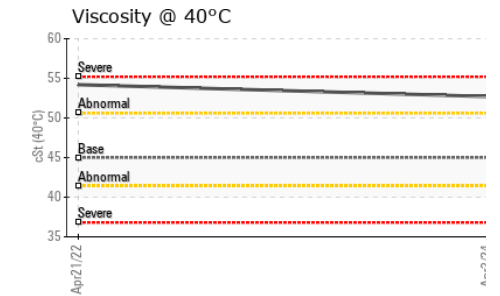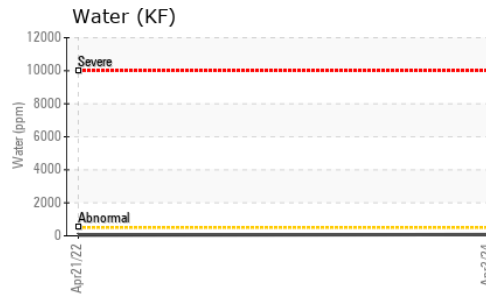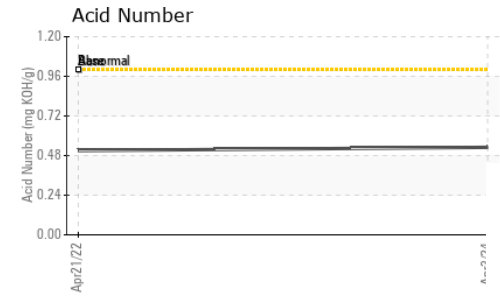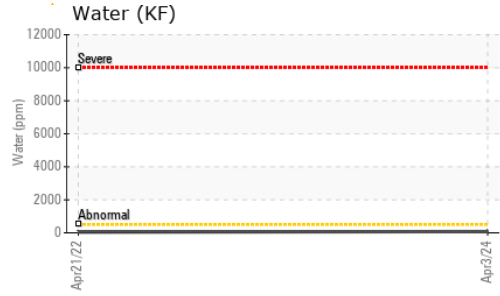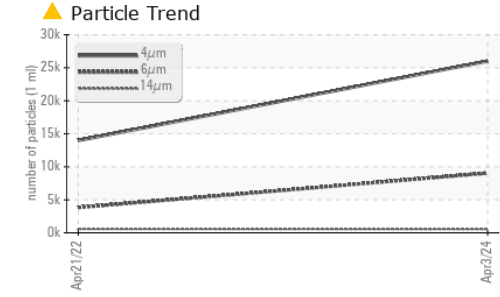





PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

PARAMETER	FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	52.7	54.2	---

PARAMETER	SAMPLE IMAGES	method	limit/base	current	history1	history2
-----------	---------------	--------	------------	---------	----------	----------

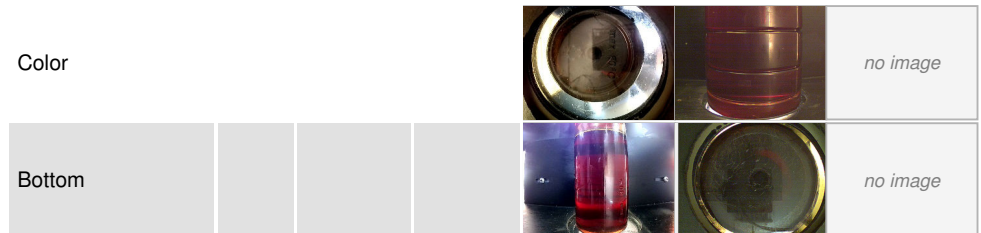

GRAPHS

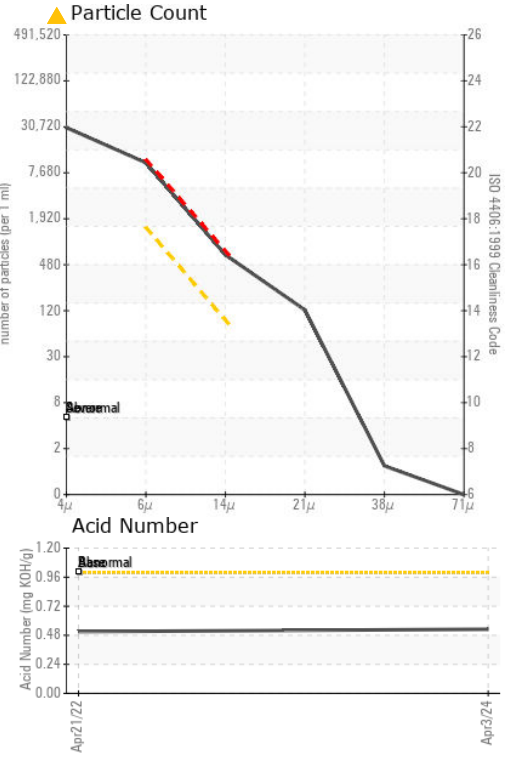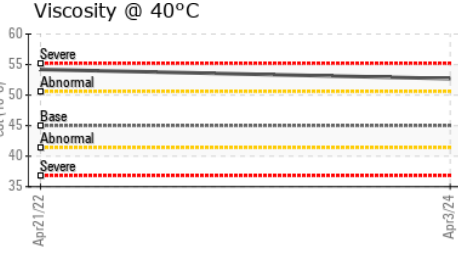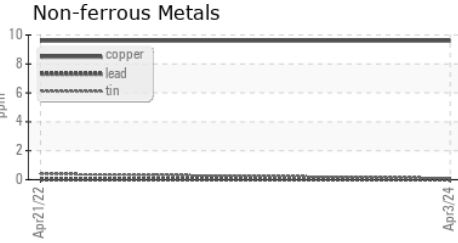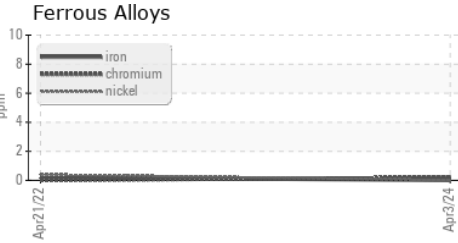

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016163 **Received** : 08 Apr 2024
Lab Number : **06142247** **Tested** : 11 Apr 2024
Unique Number : 10967055 **Diagnosed** : 11 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CALIFORNIA WASTE SOLUTIONS
 1005 TIMOTHY DR
 SAN JOSE, CA
 US 95133
 Contact: ANTONIO MORFIN
 antoniomorfin@calwaste.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)