



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**6797236 (S/N 1115)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA014803</b>	KC50706	---
Sample Date	Client Info		<b>29 Feb 2024</b>	05 Jun 2020	---
Machine Age	hrs	Client Info	<b>23244</b>	136	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	SEVERE	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	▲ 122	---
Chromium	ppm	ASTM D5185m >10	<1	<1	---
Nickel	ppm	ASTM D5185m >3	0	<1	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	<1	0	---
Aluminum	ppm	ASTM D5185m >10	2	<1	---
Lead	ppm	ASTM D5185m >10	0	2	---
Copper	ppm	ASTM D5185m >50	2	<1	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	23	---
Barium	ppm	ASTM D5185m 90	17	9	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 100	63	4	---
Calcium	ppm	ASTM D5185m 0	5	7	---
Phosphorus	ppm	ASTM D5185m 0	2	10	---
Zinc	ppm	ASTM D5185m 0	18	7	---
Sulfur	ppm	ASTM D5185m 23500	19805	42	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	▲ 39	---
Sodium	ppm	ASTM D5185m	16	25	---
Potassium	ppm	ASTM D5185m >20	4	0	---
Water	%	ASTM D6304 >0.05	0.015	▲ 84.3	---
ppm Water	ppm	ASTM D6304 >500	157	▲ 843000	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1854	---	---
Particles >6µm	ASTM D7647 >1300		694	---	---
Particles >14µm	ASTM D7647 >80		45	---	---
Particles >21µm	ASTM D7647 >20		10	---	---
Particles >38µm	ASTM D7647 >4		1	---	---
Particles >71µm	ASTM D7647 >3		0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		18/17/13	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.32	0.063	---


# OIL ANALYSIS REPORT

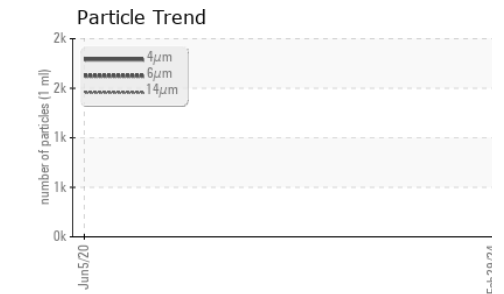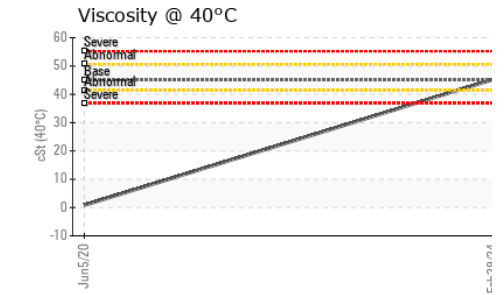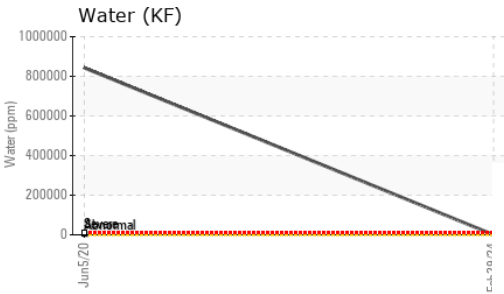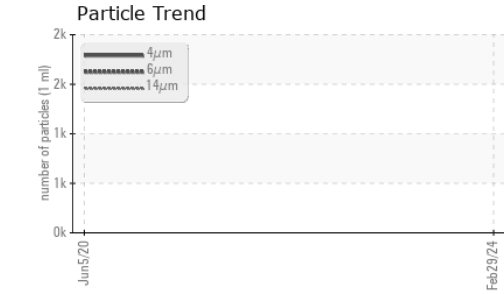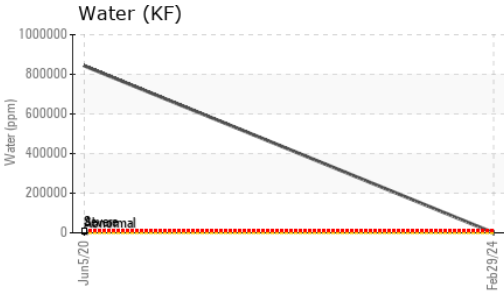






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	MILKY
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.3	0.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

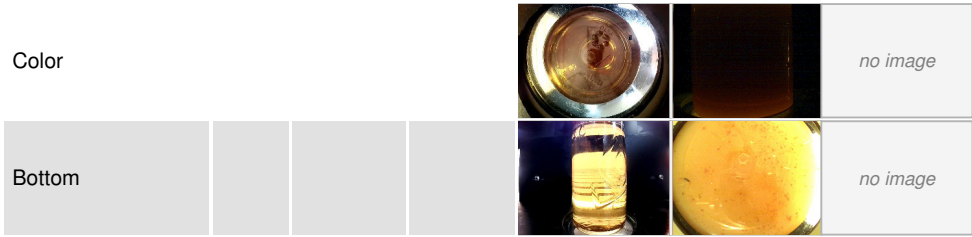

## GRAPHS

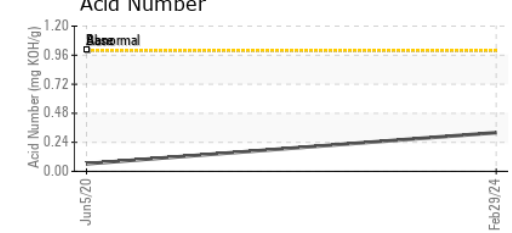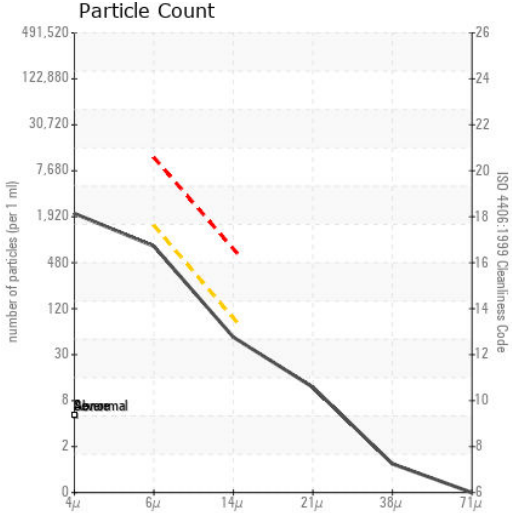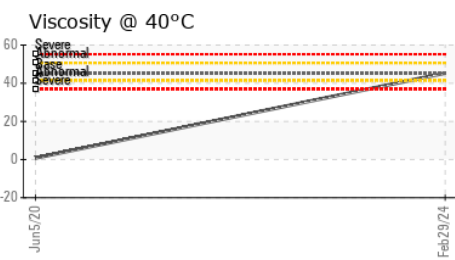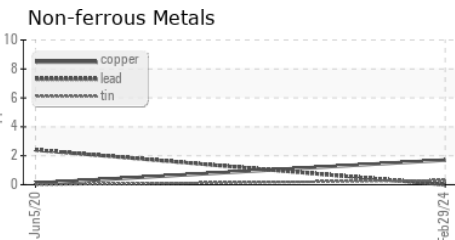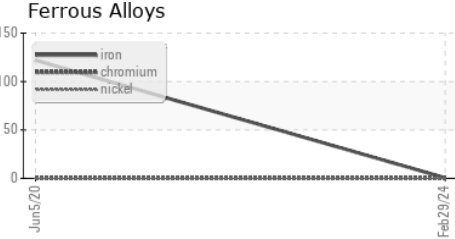

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014803 **Received** : 08 Apr 2024  
**Lab Number** : 06142250 **Tested** : 11 Apr 2024  
**Unique Number** : 10967058 **Diagnosed** : 11 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NAPA AUTO PARTS**  
 9908 JOHN PRINCE RD  
 CHARLOTTE, NC  
 US 28273  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)