


## **OIL ANALYSIS REPORT**

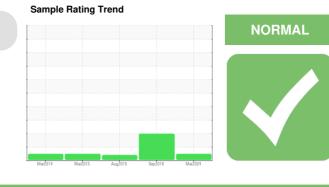

### Machine Id KAESER CSD 100ST 4691429 (S/N 1031)

Component Compressor

Fluid KAESER SIGMA (OEM) FG-460 (--- GAL)

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121775	KC78273	KC42307
Sample Date		Client Info		24 Mar 2024	27 Sep 2018	27 Aug 2015
Machine Age	hrs	Client Info		53333	27312	12349
Oil Age	hrs	Client Info		0	515	0
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	8	2
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<b>1</b> 0	5
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	2	7
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		3	2	0
Calcium	ppm	ASTM D5185m		3	0	0
Phosphorus	ppm	ASTM D5185m	500	80	238	240
Zinc	ppm	ASTM D5185m		8	151	222
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.004	0.003	0.004
ppm Water	ppm	ASTM D6304	>500	42	30	40
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		557	57690	679
Particles >6µm		ASTM D7647	>1300	196	10678	370
Particles >14µm		ASTM D7647	>80	21	<b>2</b> 97	63
Particles >21µm		ASTM D7647	>20	5	▲ 55	21
Particles >38µm		ASTM D7647	>4	0	3	3
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/15/12	<b>1</b> /15	16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.30	0.633	0.589

Contact/Location: ? ? - SCHBRA Page 1 of 2



# **OIL ANALYSIS REPORT**

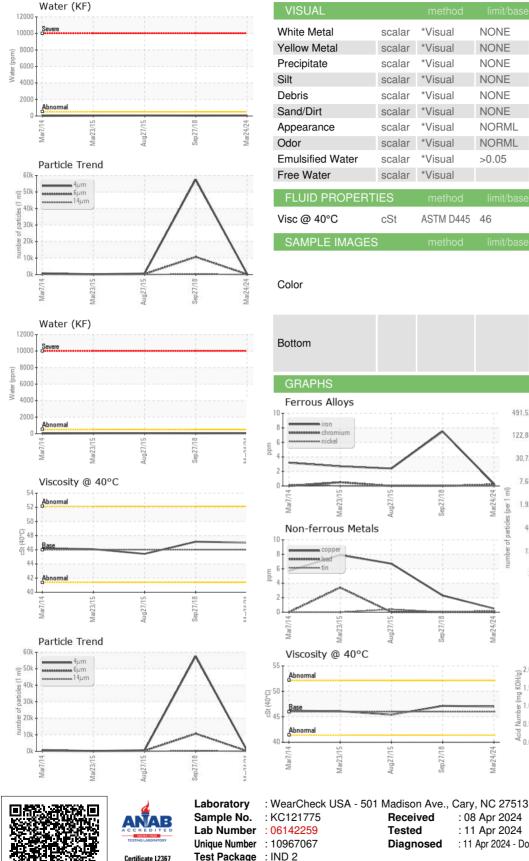

NONE NONE \*Visual NONE NONE scalar \*Visual NONE NONE NONE NONE scalar NONE NONE NONE scalar \*Visual NONE scalar \*Visual NONE NONE NONE NONE \*Visual NONE NONE scalar NONE VLITE NONE NONE NONE NONE scalar \*Visual NORML NORML NORML NORML scalar \*Visual \*Visual NORML NORML NORML NORML scalar \*Visual scalar >0.05 NEG NEG NEG scalar \*Visual NEG NEG NEG 47.0 47.14 cSt ASTM D445 46 45.42 no image no image Particle Count 491,52 122,880 30 720 7,680 Mar24/24 4406 per 1 1,920 :1999 Cle 480 120 14 30 en27/ 21/ Acid Number (B/HOX Bm) 1.5 1.50 .00 Acid 0.00 Mar24/24 -Sep27/18 Mar24/24 Sep27/18 Aug27/15 Aua27/15 Aar23/15 **Nar**7



SCHUTZ CONTAINERS

400 ASPEN HILL RD BRANCHBURG, NJ US 08876 Contact:

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Tested

: 08 Apr 2024

: 11 Apr 2024

: 11 Apr 2024 - Don Baldridge

Report Id: SCHBRA [WUSCAR] 06142259 (Generated: 04/12/2024 07:26:39) Rev: 1

Contact/Location: ? ? - SCHBRA Page 2 of 2