


# **OIL ANALYSIS REPORT**

Sample Rating Trend

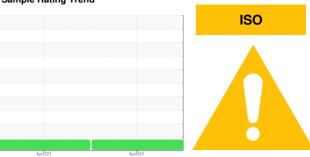

Machine Id

# KAESER 7826814 (S/N 1192)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Apr2024		
SAMPLE INFORM	MATION	method	limit/base	ourront	historya	hiotonyO
	MATION		IIIIII/base	current	history1	history2
Sample Number		Client Info		KCPA016834	KCP52635	
Sample Date		Client Info		01 Apr 2024	17 Apr 2023	
Machine Age	hrs	Client Info		4935	2632	
Oil Age	hrs	Client Info		2303	2632	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	14	10	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	2	4	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	24	28	
Calcium	ppm	ASTM D5185m	0	3	0	
Phosphorus	ppm	ASTM D5185m	0	1	3	
Zinc	ppm	ASTM D5185m	0	151	111	
Sulfur	ppm	ASTM D5185m	23500	18773	22624	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		3	6	
Potassium	ppm		>20	9	18	
Water	%	ASTM D6304	>0.05	0.012	0.011	
ppm Water	ppm	ASTM D6304	>500	129	111.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10036	8103	
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 3624	1809	
Particles >14μm		ASTM D7647	>80	59	48	
Particles >21μm		ASTM D7647	>20	5	8	
Particles >38μm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/13	20/18/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.47	0.38	



## **OIL ANALYSIS REPORT**

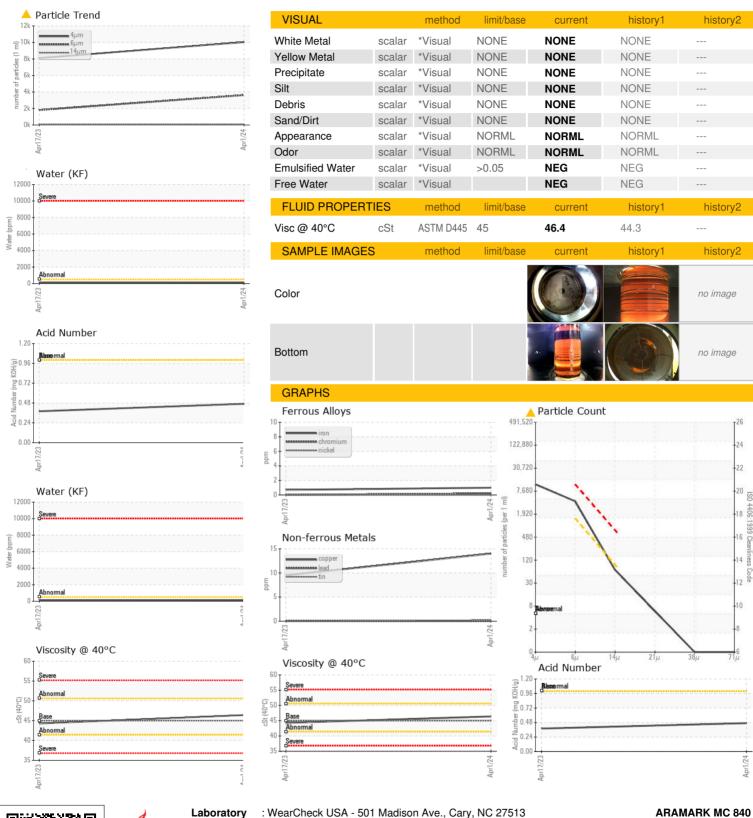



Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA016834 Lab Number : 06142263

Unique Number : 10967071

Received **Tested** Diagnosed

: 08 Apr 2024 : 11 Apr 2024 : 11 Apr 2024 - Don Baldridge 6121 COCKRILL BEND CIRCLE NASHVILLE, TN

US 37209 Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: