




OIL ANALYSIS REPORT

Sample Rating Trend

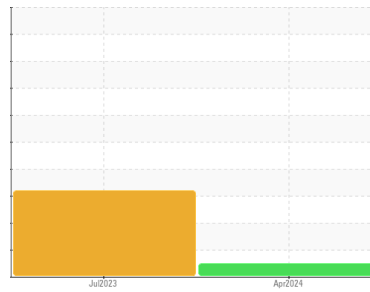

NORMAL



Machine Id
KAESER SFC 30T 8710836 (S/N 1043)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 The water content is negligible. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA017070	KCPA004845	---
Sample Date	Client Info			03 Apr 2024	13 Jul 2023	---
Machine Age	hrs Client Info			5680	1593	---
Oil Age	hrs Client Info			0	0	---
Oil Changed	Client Info			Changed	N/A	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	0	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<1	0	---
Aluminum	ppm	ASTM D5185m	>10	2	<1	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	4	<1	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	1	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	100	60	45	---
Calcium	ppm	ASTM D5185m	0	7	<1	---
Phosphorus	ppm	ASTM D5185m	0	<1	4	---
Zinc	ppm	ASTM D5185m	0	17	6	---
Sulfur	ppm	ASTM D5185m	23500	21072	22345	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	8	---
Sodium	ppm	ASTM D5185m		17	4	---
Potassium	ppm	ASTM D5185m	>20	28	8	---
Water	%	ASTM D6304	>0.05	0.019	▲ 0.392	---
ppm Water	ppm	ASTM D6304	>500	197	▲ 3920	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1387	1191	---
Particles >6µm		ASTM D7647	>1300	471	175	---
Particles >14µm		ASTM D7647	>80	26	18	---
Particles >21µm		ASTM D7647	>20	3	5	---
Particles >38µm		ASTM D7647	>4	0	1	---
Particles >71µm		ASTM D7647	>3	0	1	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	18/16/12	17/15/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34	0.35	---


OIL ANALYSIS REPORT

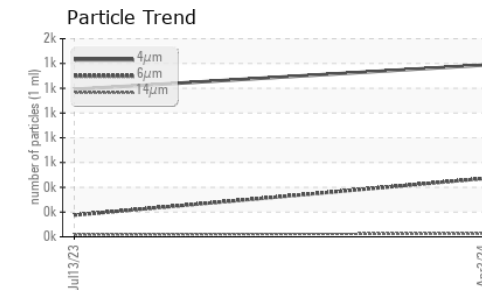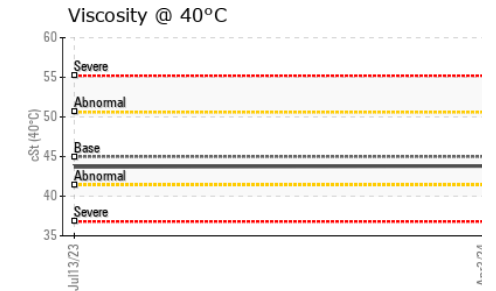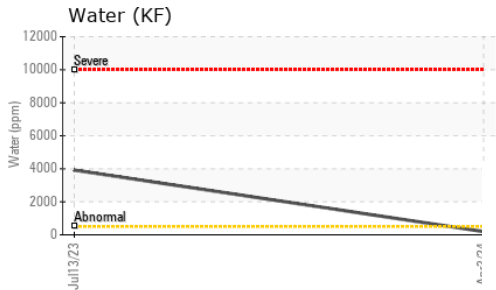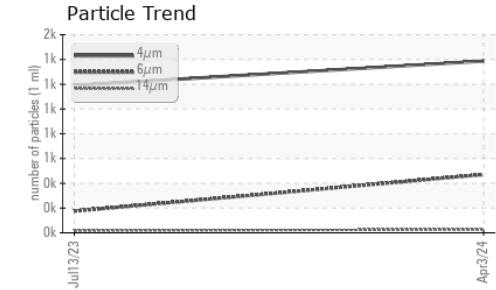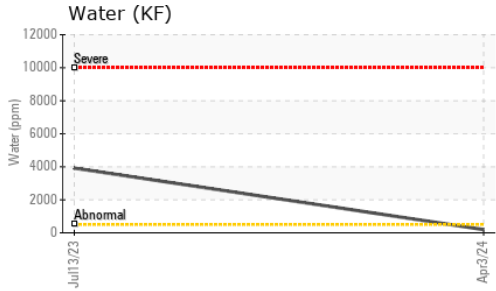






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.8	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

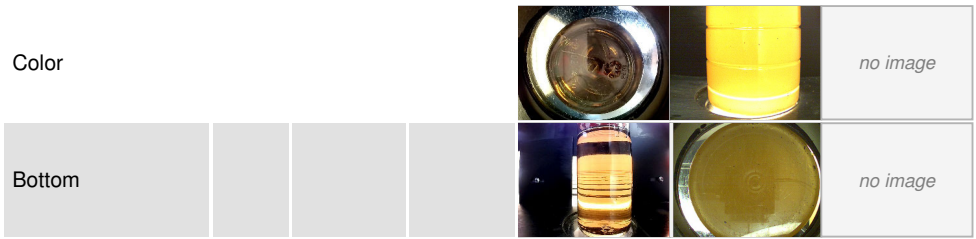

GRAPHS

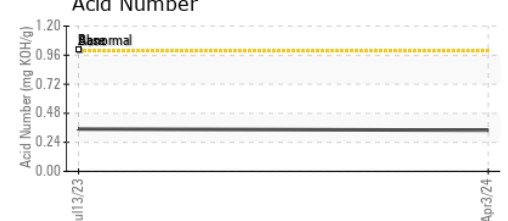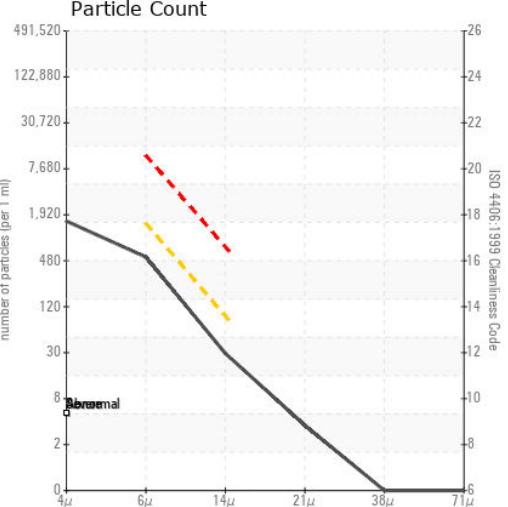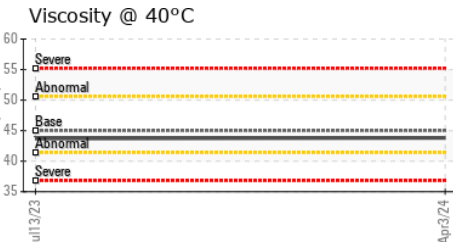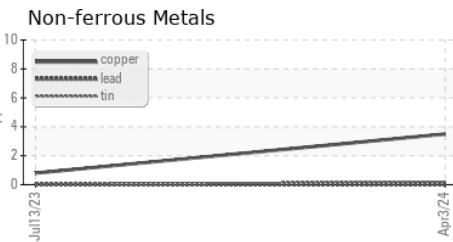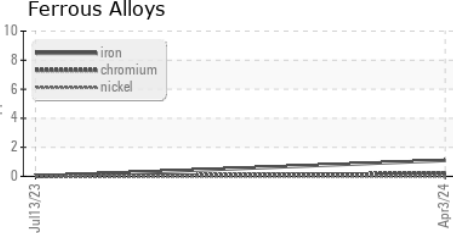

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017070 **Received** : 08 Apr 2024
Lab Number : 06142286 **Tested** : 11 Apr 2024
Unique Number : 10967094 **Diagnosed** : 11 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

QUANTA SERVICES NASHVILLE
 1621 HEIL QUAKER BLVD
 LAVERGNE, TN
 US 37086
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: