


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# **7096485 (S/N 1006)**Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2023	Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015076	KCPA001179	
Sample Date		Client Info		02 Apr 2024	30 Mar 2023	
Machine Age	hrs	Client Info		17848	13305	
Oil Age	hrs	Client Info		4000	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	3	3	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	<1	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	<1	5	
Calcium	ppm	ASTM D5185m	0	3	<1	
Phosphorus	ppm	ASTM D5185m	0	4	6	
Zinc	ppm	ASTM D5185m	0	0	0	
Sulfur	ppm	ASTM D5185m	23500	25915	21613	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m	725	0	0	
Potassium	ppm	ASTM D5185m	>20	1	4	
Water	%	ASTM D6304	>0.05	0.009	0.003	
ppm Water	ppm	ASTM D6304	>500	96	37.1	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2256	4756	
Particles >6µm		ASTM D7647	>1300	468	1158	
Particles >14um		ASTM D7647	>80	36	76	
Particles >21µm		ASTM D7647		10	17	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	19/17/13	
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.54	0.51	
, wid Indiline! (VIII)	my NOH/y	70 LINI D0040	1.0	0.57	0.01	



## **OIL ANALYSIS REPORT**

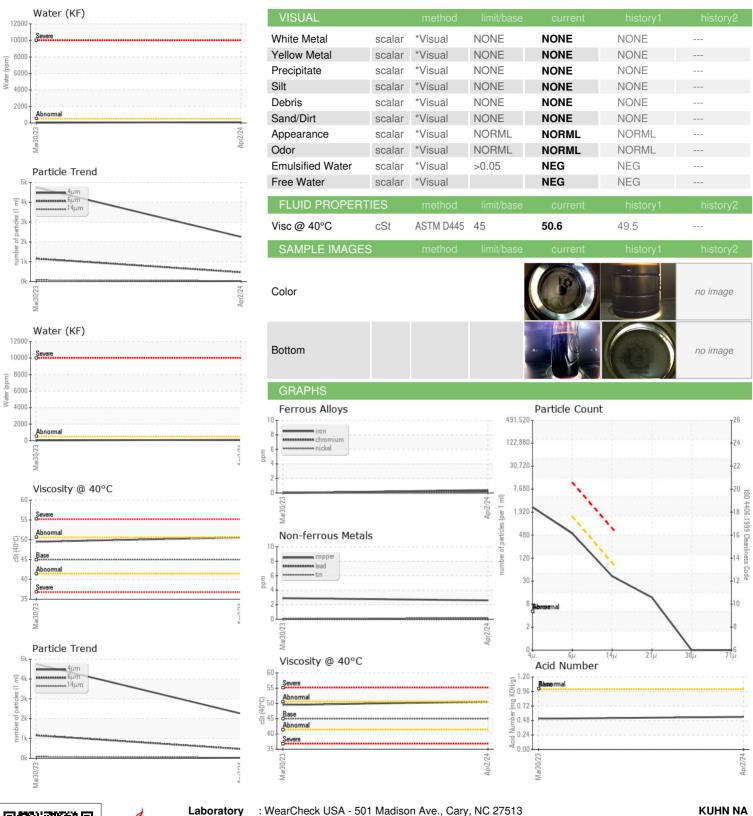



Certificate 12367

Sample No.

Lab Number : 06142299

: KCPA015076 Unique Number : 10967107

Received : 08 Apr 2024 **Tested** : 09 Apr 2024

Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 11 Apr 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

Report Id: KUHBROWI [WUSCAR] 06142299 (Generated: 04/12/2024 08:13:23) Rev: 1

W536 TEN EYCK RD

Contact: Service Manager

BRODHEAD, WI

US 53520

T: