




# OIL ANALYSIS REPORT

Sample Rating Trend

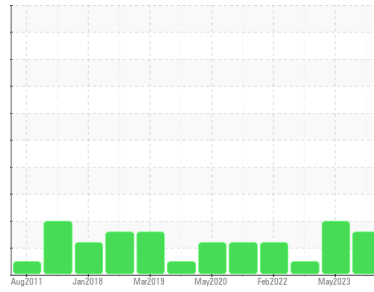

ISO



Machine Id  
**KAESER CDS 75 4022828 (S/N 1679)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA016886</b>	KCPA001678	KCP46903
Sample Date	Client Info		<b>02 Apr 2024</b>	08 May 2023	11 Oct 2022
Machine Age	hrs	Client Info	<b>53852</b>	50234	48281
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	N/A	Not Changd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	2	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	14	14	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	1	0	5
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	31	26	64
Calcium	ppm	ASTM D5185m 2	3	2	0
Phosphorus	ppm	ASTM D5185m	1	29	0
Zinc	ppm	ASTM D5185m	8	20	4
Sulfur	ppm	ASTM D5185m	<b>21025</b>	16435	21634

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	2	4	17
Potassium	ppm	ASTM D5185m >20	2	2	1
Water	%	ASTM D6304 >0.05	<b>0.015</b>	0.018	0.024
ppm Water	ppm	ASTM D6304 >500	<b>158</b>	184.8	247.3

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>19442</b>	37185	4247
Particles >6µm	ASTM D7647	>1300	▲ <b>4416</b>	▲ 10961	647
Particles >14µm	ASTM D7647	>80	▲ <b>280</b>	▲ 649	25
Particles >21µm	ASTM D7647	>20	▲ <b>64</b>	▲ 166	9
Particles >38µm	ASTM D7647	>4	<b>3</b>	▲ 6	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	▲ 22/21/17	19/17/12

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.39</b>	0.40	0.38

# OIL ANALYSIS REPORT


## ▲ Particle Trend

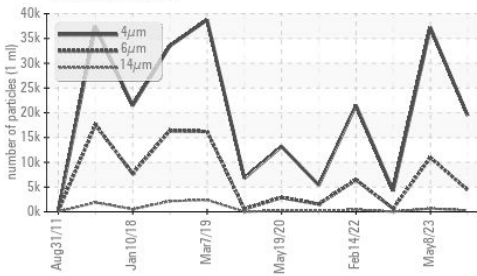


## Water (KF)

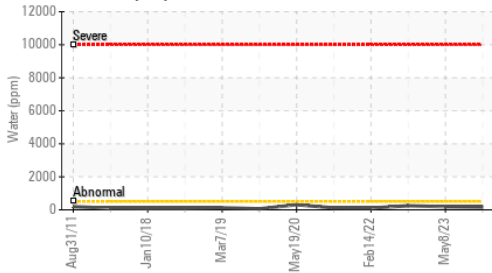


## Acid Number

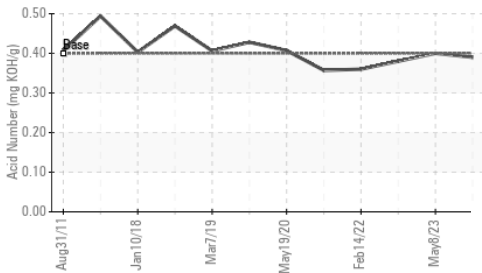

## Water (KF)

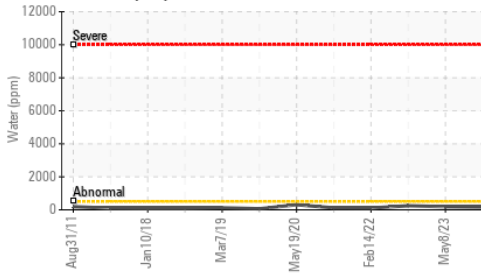

## Viscosity @ 40°C

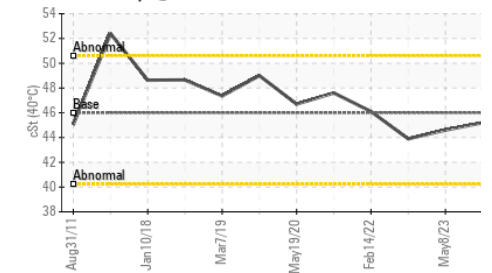


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.2	44.6	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

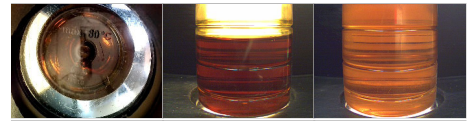


Bottom




## GRAPHS


### Ferrous Alloys

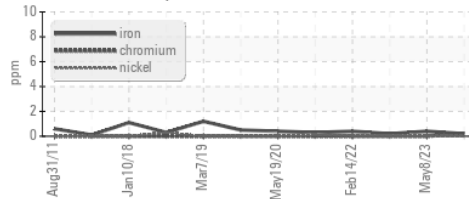


### Non-ferrous Metals

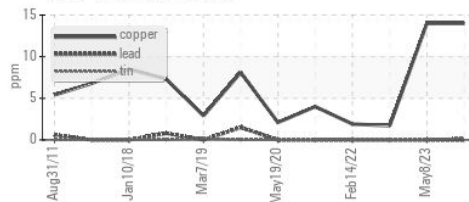


### Viscosity @ 40°C

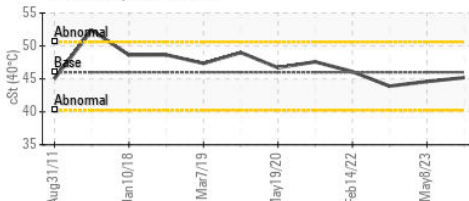

### ▲ Particle Count

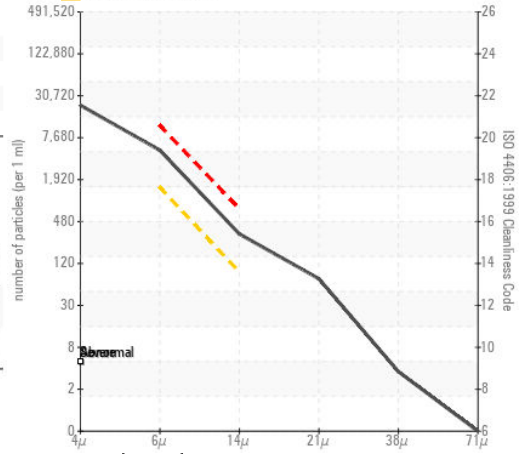

### Acid Number

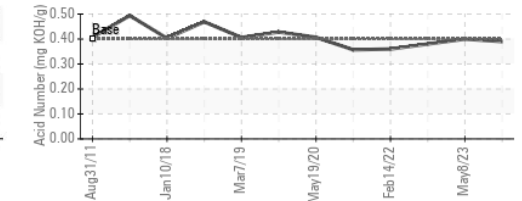

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA016886

Lab Number : 06142300

Unique Number : 10967108

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 08 Apr 2024

Tested : 09 Apr 2024

Diagnosed : 10 Apr 2024 - Doug Bogart

CORESLAB STRUCTURES KANSAS INC

759 S 65TH ST

KANSAS CITY, KS

US 66111

Contact: R. MCDOWELL

rmcdowell@coreslab.com

T:

F: