




OIL ANALYSIS REPORT

Sample Rating Trend

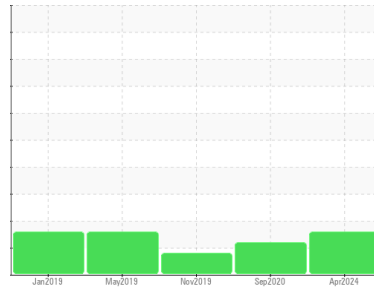

ISO



Machine Id

KAESER KAESER 6 (S/N 1028)

Component

Air Compressor

Fluid

USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | USPM36651 | USPM10428 | USPM15433 |
| Sample Date | Client Info | | 07 Apr 2024 | 07 Sep 2020 | 11 Nov 2019 |
| Machine Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | ATTENTION | ABNORMAL | ATTENTION |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 0 | <1 | <1 |
| Chromium | ppm | ASTM D5185m >4 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >4 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m >3 | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m >2 | <1 | <1 | <1 |
| Aluminum | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m >20 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >40 | <1 | 3 | 3 |
| Tin | ppm | ASTM D5185m >5 | <1 | <1 | 0 |
| Antimony | ppm | ASTM D5185m | --- | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|---------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m 0 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m 0 | 1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m 0 | <1 | 0 | 0 |
| Calcium | ppm | ASTM D5185m 0 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m 1 | 0 | 46 | 81 |
| Zinc | ppm | ASTM D5185m 0 | 1 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m 0 | 0 | 2700 | 5473 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | 0 | <1 | <1 |
| Sodium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185m >20 | 1 | 0 | 0 |
| Water | % | ASTM D6304 >0.2 | 0.055 | 0.088 | 0.035 |
| ppm Water | ppm | ASTM D6304 >2000 | 554 | 883.8 | 350.1 |

FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|------------------------|------------|-----------------|----------|----------|
| Particles >4µm | ASTM D7647 | | 6198 | 8347 | 3568 |
| Particles >6µm | ASTM D7647 >1300 | | 1896 | 2582 | 909 |
| Particles >14µm | ASTM D7647 >80 | | 93 | 275 | 36 |
| Particles >21µm | ASTM D7647 >20 | | 27 | 77 | 22 |
| Particles >38µm | ASTM D7647 >4 | | 0 | 3 | 1 |
| Particles >71µm | ASTM D7647 >3 | | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) >--/17/13 | | 20/18/14 | 20/19/15 | 19/17/12 |


FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.05 | 0.10 | 0.213 | 0.142 |




OIL ANALYSIS REPORT


Particle Trend

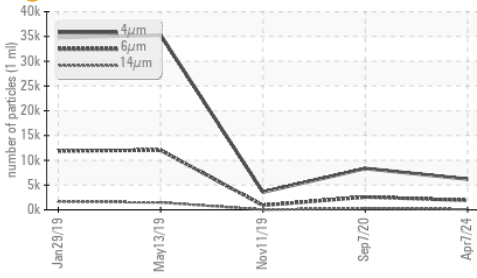


Water (KF)

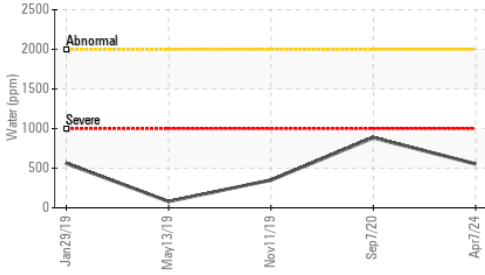


Acid Number

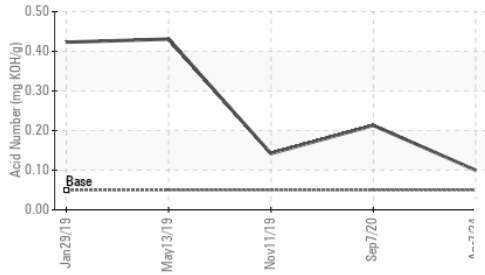

Water (KF)

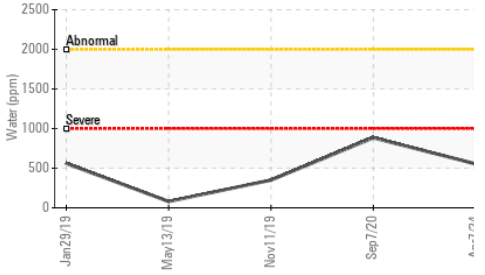


Viscosity @ 40°C

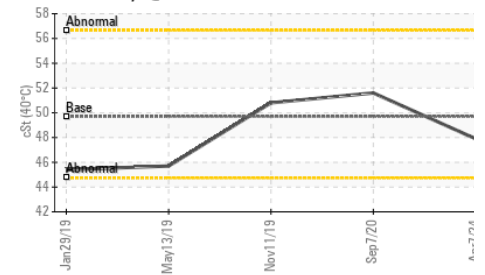

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 49.7 | 47.9 | 51.6 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

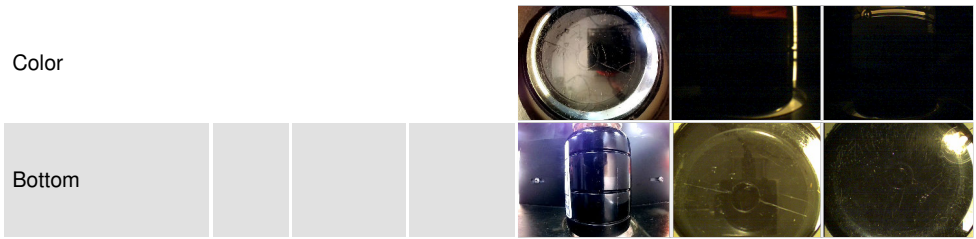


GRAPHS


Ferrous Alloys

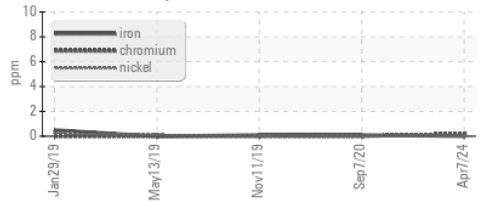


Non-ferrous Metals

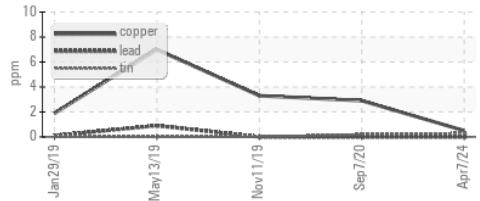


Viscosity @ 40°C

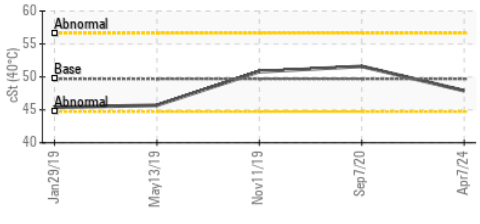

Particle Count

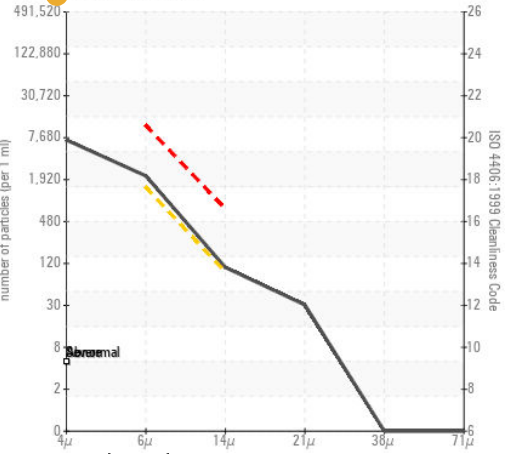

Acid Number

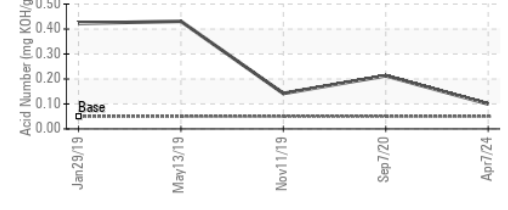

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36651
Lab Number : 06142319
Unique Number : 10967127
Test Package : IND 2

JBS SWIFT and COMPANY - GRAND ISLAND
 GRAND ISLAND, NE
 US
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375

F: (402)423-6661