



PROBLEM SUMMARY

Sample Rating Trend



DEGRADATION



Machine Id

SULLAIR 5 (S/N 202107160031)




Component

Air Compressor

Fluid

SULLAIR SULLUBE 32 (--- GAL)

COMPONENT CONDITION SUMMARY

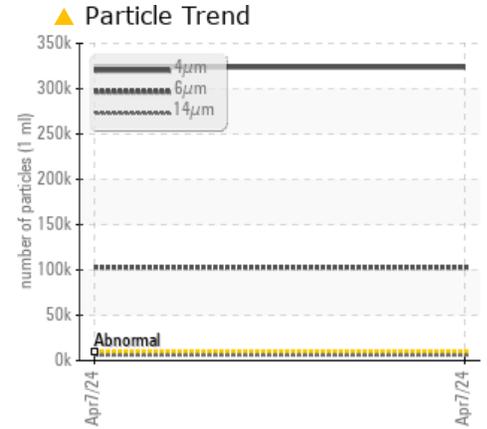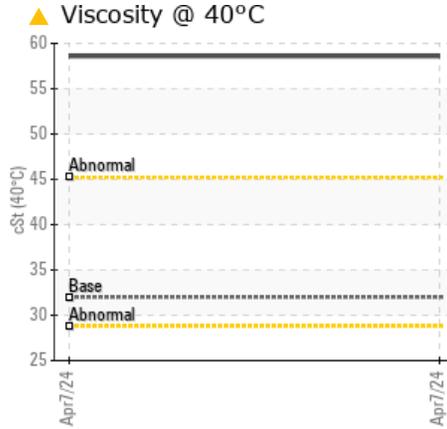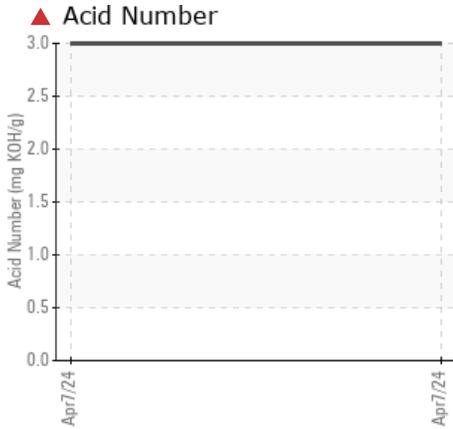

RECOMMENDATION

Recommend drain oil if not already done and flush with cleaner before refilling with oil. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status	SEVERE	---	---
Particles >4µm	ASTM D7647 >10000	▲ 323800	---
Particles >6µm	ASTM D7647 >2500	▲ 102860	---
Particles >14µm	ASTM D7647 >320	▲ 6319	---
Particles >21µm	ASTM D7647 >80	▲ 2023	---
Particles >38µm	ASTM D7647 >20	▲ 111	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 26/24/20	---
Acid Number (AN)	mg KOH/g ASTM D8045	▲ 3.00	---
Visc @ 40°C	cSt ASTM D445 32.0	▲ 58.6	---

Customer Id: JBSGRECO
 Sample No.: USPM36650
 Lab Number: 06142320
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Recommend drain oil if not already done and flush with cleaner before refilling with oil.
Flush System	---	---	?	Recommend drain oil if not already done and flush with cleaner before refilling with oil.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION



Machine Id

SULLAIR 5 (S/N 202107160031)

Component

Air Compressor

Fluid

SULLAIR SULLUBE 32 (--- GAL)

DIAGNOSIS

▲ Recommendation

Recommend drain oil if not already done and flush with cleaner before refilling with oil. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is above the recommended limit. Additive levels indicate the addition of a different brand or type of oil. Confirmed. Confirm oil type.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM36650	---	---
Sample Date	Client Info		07 Apr 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	7	---	---
Chromium	ppm	ASTM D5185m >4	<1	---	---
Nickel	ppm	ASTM D5185m >4	0	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m	<1	---	---
Aluminum	ppm	ASTM D5185m >10	2	---	---
Lead	ppm	ASTM D5185m >20	0	---	---
Copper	ppm	ASTM D5185m >40	19	---	---
Tin	ppm	ASTM D5185m >5	<1	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m 745	6	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	2	---	---
Calcium	ppm	ASTM D5185m 1	4	---	---
Phosphorus	ppm	ASTM D5185m 3	2	---	---
Zinc	ppm	ASTM D5185m	4	---	---
Sulfur	ppm	ASTM D5185m	285	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	---	---
Sodium	ppm	ASTM D5185m	10	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304 >0.6	0.293	---	---
ppm Water	ppm	ASTM D6304 >6000	2930	---	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 323800	---	---
Particles >6µm	ASTM D7647	>2500	▲ 102860	---	---
Particles >14µm	ASTM D7647	>320	▲ 6319	---	---
Particles >21µm	ASTM D7647	>80	▲ 2023	---	---
Particles >38µm	ASTM D7647	>20	▲ 111	---	---
Particles >71µm	ASTM D7647	>4	4	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 26/24/20	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ 3.00	---	---




OIL ANALYSIS REPORT

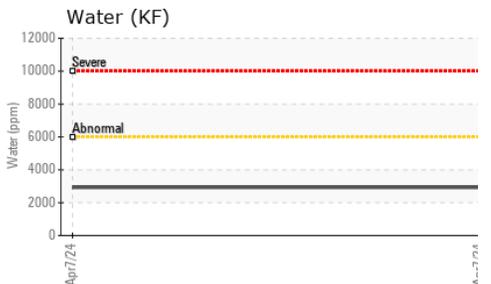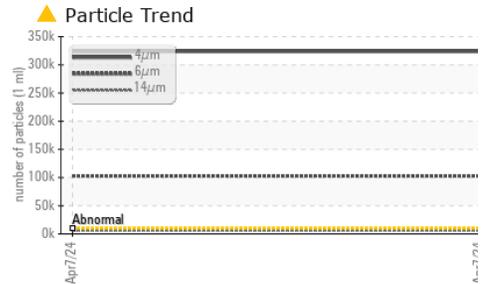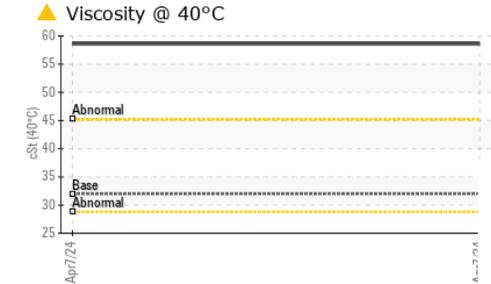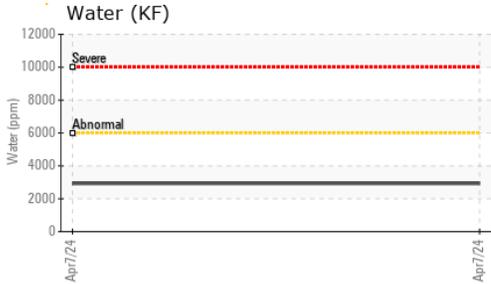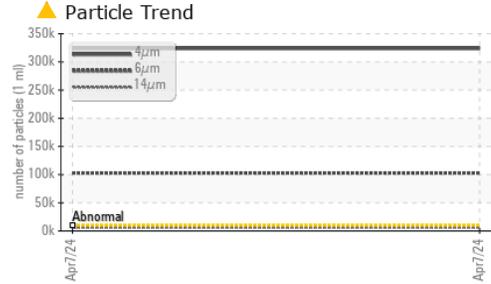






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.6	0.2%	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32.0	58.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

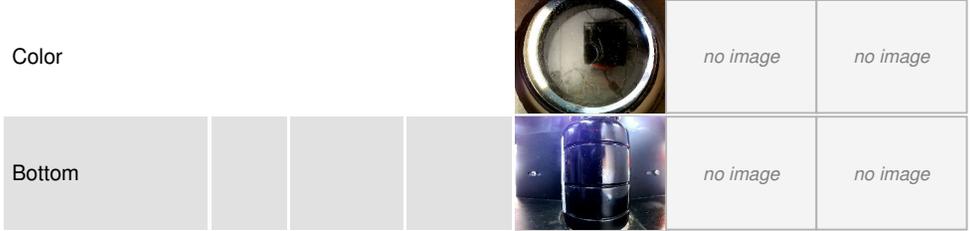

GRAPHS

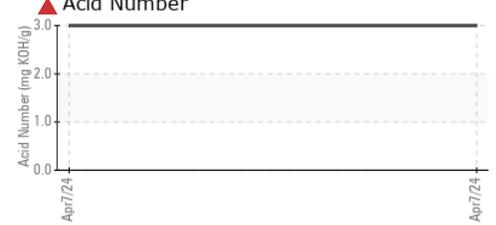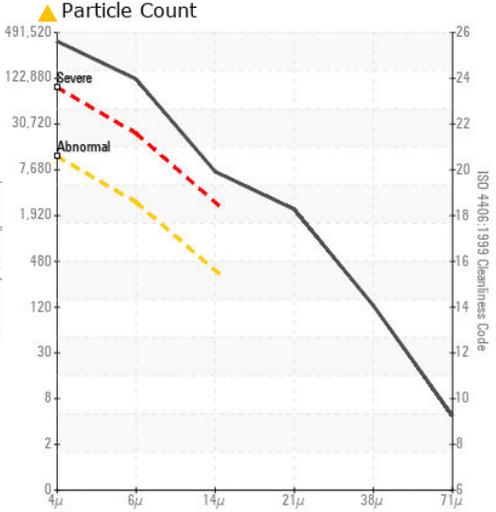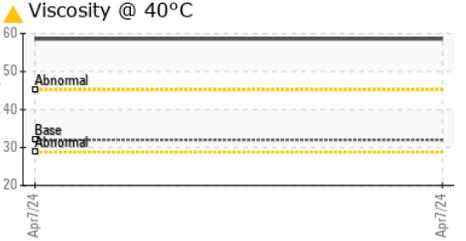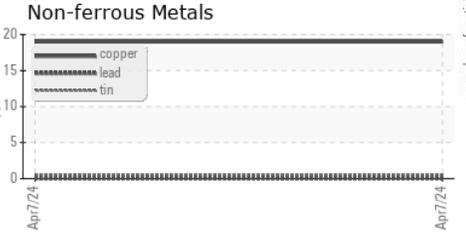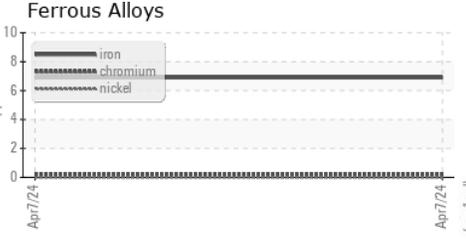

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36650 **Received** : 08 Apr 2024
Lab Number : 06142320 **Tested** : 11 Apr 2024
Unique Number : 10967128 **Diagnosed** : 11 Apr 2024 - Doug Bogart
Test Package : IND 2

JBS/SWIFT - GREELEY BEEF
 800 N 8TH ST
 GREELEY, CO
 US 80631
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)