


OIL ANALYSIS REPORT

ULTRA COOL [417498] INGERSOLL RAND TS6629U07129 - PHILLIPS 66

Component Compressor

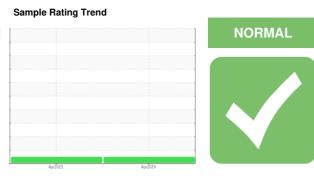

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06142360	UCH05536436	
Sample Date		Client Info		08 Apr 2024	25 Apr 2022	
Machine Age	hrs	Client Info		0	36287	
Oil Age	hrs	Client Info		0	3624	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m		<1	0	
Aluminum	ppm	ASTM D5185m	>25	2	0	
Lead	ppm	ASTM D5185m	>25	0	<1	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>15	<1	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	500	997	894	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	0	<1	<1	
Calcium	ppm	ASTM D5185m	0	4	1	
Phosphorus	ppm	ASTM D5185m	20	14	2	
Zinc	ppm	ASTM D5185m	0	<1	0	
Sulfur	ppm	ASTM D5185m	200	286	258	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		2	1	
Potassium	ppm	ASTM D5185m	>20	3	<1	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.073	0.262	




OIL ANALYSIS REPORT

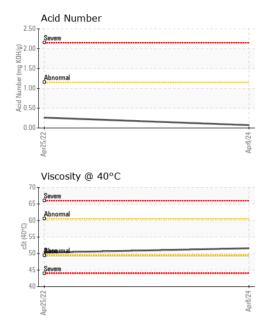





GRAPHS













Laboratory Sample No.

Lab Number : 06142360

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06142360 Unique Number : 10967168

Received : 08 Apr 2024 **Tested** Diagnosed

: 09 Apr 2024 : 11 Apr 2024 - Don Baldridge

AIRMATIC COMPRESSOR SYSTEMS

700 WASHINGTON AVE CARLSTADT, NJ US 07072

Contact: ELVIN DIAZ ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (800)864-7621 F: (201)342-6241

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: UCAIRCAR [WUSCAR] 06142360 (Generated: 04/12/2024 08:22:27) Rev: 1

Contact/Location: ELVIN DIAZ - UCAIRCAR