


# **OIL ANALYSIS REPORT**

# NOT GIVEN NO INFO GIVEN (S/N NOT GIVEN) Component Compressor

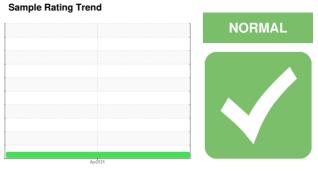

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06142372		
Sample Date		Client Info		08 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	7		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0		
Barium	ppm	ASTM D5185m	1	0		
Molybdenum	ppm	ASTM D5185m	1	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	1	0		
Calcium	ppm	ASTM D5185m	1	0		
Phosphorus	ppm	ASTM D5185m	800	707		
Zinc	ppm	ASTM D5185m	20	4		
Sulfur	ppm	ASTM D5185m	37	0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2

0.26

Acid Number (AN) mg KOH/g ASTM D8045 0.24




## **OIL ANALYSIS REPORT**




VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.3		


Color	no image	no image
Bottom	no image	no image

SAMPLE IMAGES













Sample No.

Lab Number : 06142372 Unique Number : 10967180

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06142372

Received : 08 Apr 2024 **Tested** Diagnosed

: 09 Apr 2024 : 11 Apr 2024 - Don Baldridge

**AIRMATIC COMPRESSOR SYSTEMS** 700 WASHINGTON AVE CARLSTADT, NJ

US 07072 Contact: ELVIN DIAZ

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com T: (800)864-7621

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (201)342-6241 Contact/Location: ELVIN DIAZ - UCAIRCAR