




# OIL ANALYSIS REPORT

Sample Rating Trend

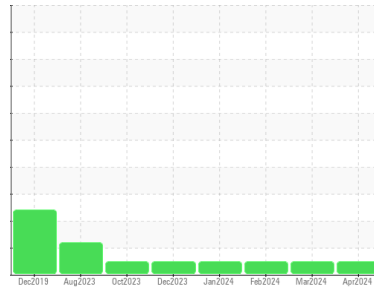

**NORMAL**



Area

## Extrusion

Machine Id

### Press 5 Press Hydraulic Unit Oil (S/N 81546)

Component

#### Hydraulic System

Fluid

#### AW HYDRAULIC OIL ISO 46 (3487 GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0041862</b>	RP0041881	RP0041871
Sample Date	Client Info			<b>04 Apr 2024</b>	01 Mar 2024	01 Feb 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>4</b>	2	<1
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>20	<b>7</b>	6	6
Tin	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>5</b>	7	7
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	5	<b>9</b>	9	13
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	25	<b>15</b>	16	25
Calcium	ppm	ASTM D5185m	200	<b>83</b>	86	100
Phosphorus	ppm	ASTM D5185m	300	<b>317</b>	329	360
Zinc	ppm	ASTM D5185m	370	<b>373</b>	363	413

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>2</b>	2	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	3
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.002	0.004
ppm Water	ppm	ASTM D6304	>500	<b>60</b>	23	47

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>4069</b>	695	492
Particles >6µm		ASTM D7647	>1300	<b>362</b>	126	146
Particles >14µm		ASTM D7647	>160	<b>14</b>	8	13
Particles >21µm		ASTM D7647	>40	<b>5</b>	2	3
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>19/16/11</b>	17/14/10	16/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.49</b>	0.39	0.34


# OIL ANALYSIS REPORT

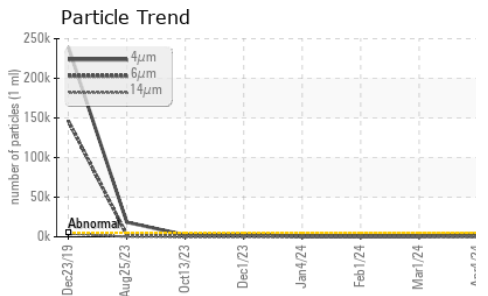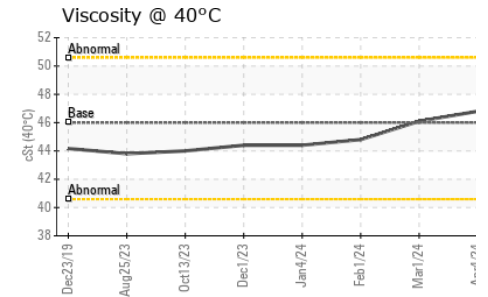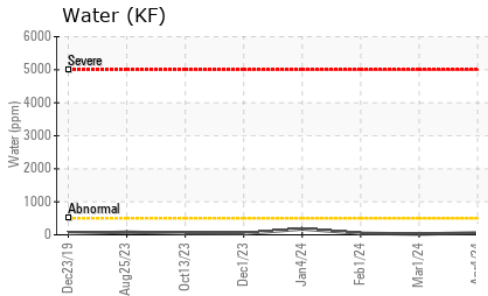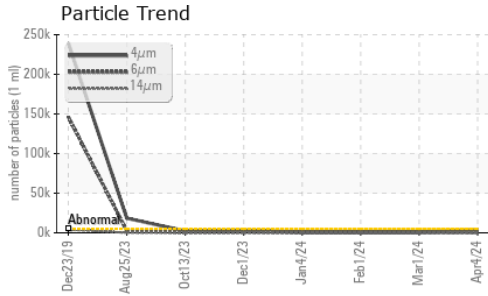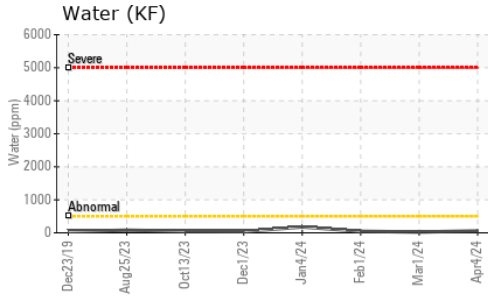






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.8	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

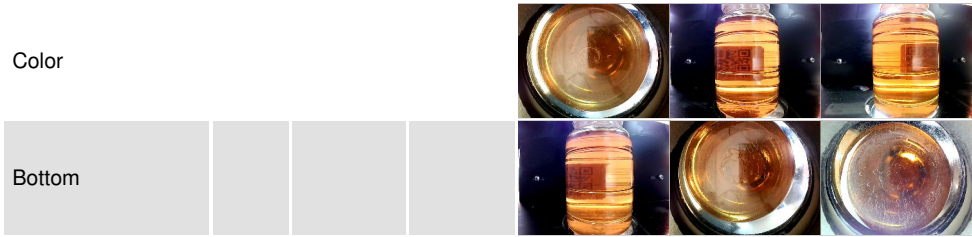

## GRAPHS

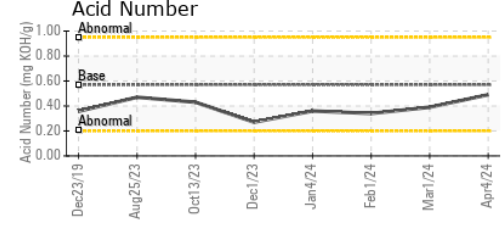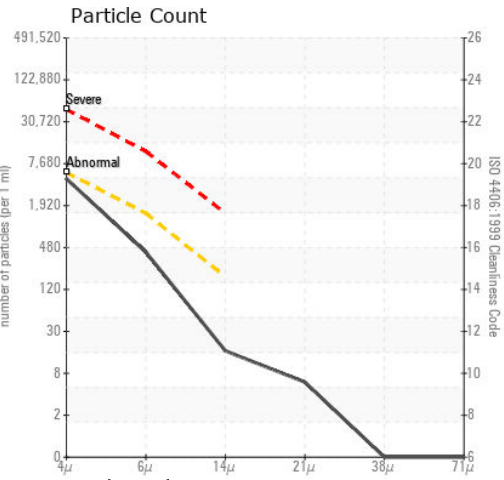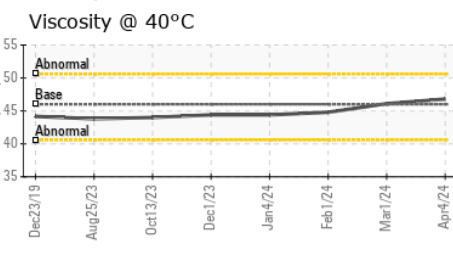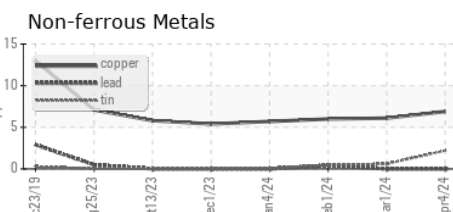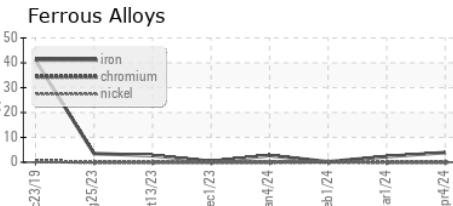

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0041862  
**Lab Number** : 06143030  
**Unique Number** : 10967838  
**Test Package** : IND 2  
**Received** : 09 Apr 2024  
**Tested** : 10 Apr 2024  
**Diagnosed** : 10 Apr 2024 - Wes Davis

**WESTERN EXTRUSIONS CORPORATION**  
 1735 SANDY LAKE RD  
 CARROLLTON, TX  
 US 75006  
 Contact: SCOTT WESTFALL  
 swestfall@WesternExtrusions.Com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)