


# **OIL ANALYSIS REPORT**

Sample Rating Trend

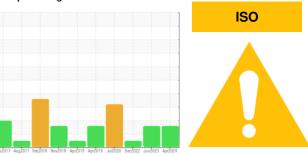

Machine Id

# KAESER SM 10 5014960 (S/N 1545)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

0.4.4.D.L.E.IV.E.O.D.L.						
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015994	KCPA002858	KCP45768
Sample Date		Client Info		04 Apr 2024	23 Jun 2023	01 Dec 2022
Machine Age	hrs	Client Info		7453	0	6539
Oil Age	hrs	Client Info		1727	0	369
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	2	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	6	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	13	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	100	48	24	24
Calcium	ppm	ASTM D5185m	0	<1	3	0
Phosphorus	ppm	ASTM D5185m	0	0	0	0
Zinc	ppm	ASTM D5185m	0	38	73	64
Sulfur	ppm	ASTM D5185m	23500	22080	22272	22497
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	2
Sodium	ppm	ASTM D5185m		11	8	11
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.014	0.011	0.026
	ppm	ASTM D6304	>500	145	117.8	260.0
ppm Water						
opm Water  FLUID CLEANLIN		method	limit/base	current	history1	history2
ppm Water  FLUID CLEANLIN  Particles >4µm		method ASTM D7647	limit/base	current 11200	history1 12301	history2 2673
FLUID CLEANLIN Particles >4μm						
FLUID CLEANLIN Particles >4μm Particles >6μm		ASTM D7647		11200	12301	2673
FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm		ASTM D7647 ASTM D7647	>1300	11200 <b>2610</b>	12301 <b>A</b> 3376	2673 706
FLUID CLEANLIN		ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80	11200 ▲ 2610 ● 156	12301 3376 315	2673 706 45
FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm		ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80 >20 >4	11200 2610 156 41	12301 3376 315 90	2673 706 45 9
FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm Particles >38μm		ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80 >20 >4	11200 ^ 2610 ^ 156 ^ 41 3	12301 3376 315 90 6	2673 706 45 9



## **OIL ANALYSIS REPORT**







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA015994 : 06143085 Unique Number : 10967893

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 09 Apr 2024 **Tested** : 10 Apr 2024

Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 11 Apr 2024 - Angela Borella

**OLD DOMINION** 2098 SPIRIT OF 76 DR MEMPHIS, TN US 38116 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: