




OIL ANALYSIS REPORT

Sample Rating Trend

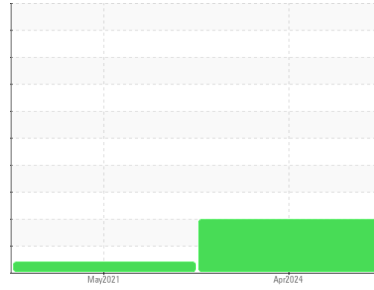

VISCOSITY



Machine Id
5329608 (S/N 1047)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

● Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA015745	KCP32427	---
Sample Date	Client Info			03 Apr 2024	11 May 2021	---
Machine Age	hrs	Client Info		44091	26154	---
Oil Age	hrs	Client Info		6000	6000	---
Oil Changed		Client Info		N/A	Changed	---
Sample Status				ABNORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	2	1	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	17	18	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	100	0	0	---
Calcium	ppm	ASTM D5185m	0	0	0	---
Phosphorus	ppm	ASTM D5185m	0	183	421	---
Zinc	ppm	ASTM D5185m	0	32	47	---
Sulfur	ppm	ASTM D5185m	23500	1351	175	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	0	---
Sodium	ppm	ASTM D5185m		4	0	---
Potassium	ppm	ASTM D5185m	>20	<1	<1	---
Water	%	ASTM D6304	>0.05	0.020	0.002	---
ppm Water	ppm	ASTM D6304	>500	204	16.7	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		20194	2012	---
Particles >6µm		ASTM D7647	>1300	▲ 4114	421	---
Particles >14µm		ASTM D7647	>80	▲ 259	26	---
Particles >21µm		ASTM D7647	>20	▲ 62	8	---
Particles >38µm		ASTM D7647	>4	3	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/19/15	16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.56	0.278	---


OIL ANALYSIS REPORT

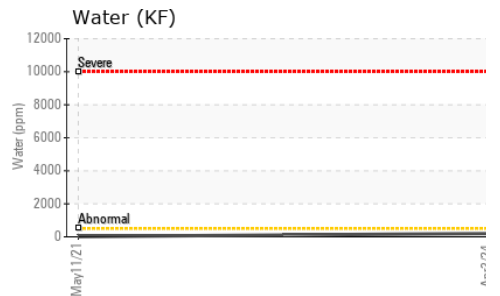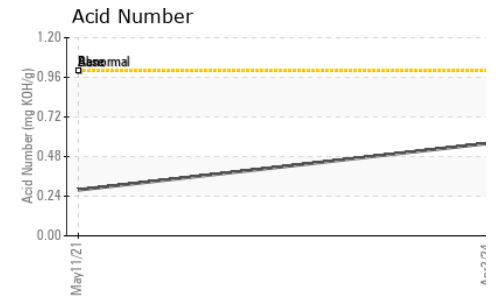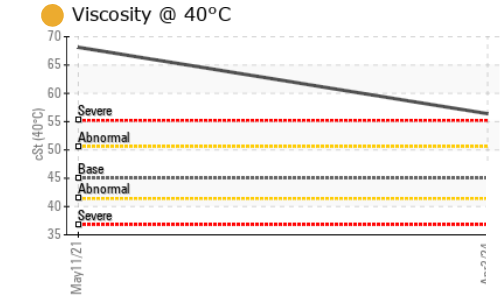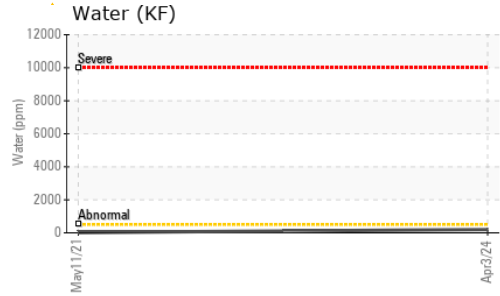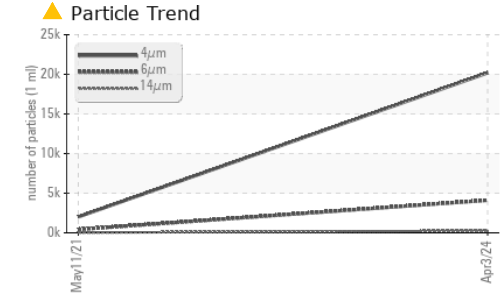




PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	56.4	68.13	---

SAMPLE IMAGES

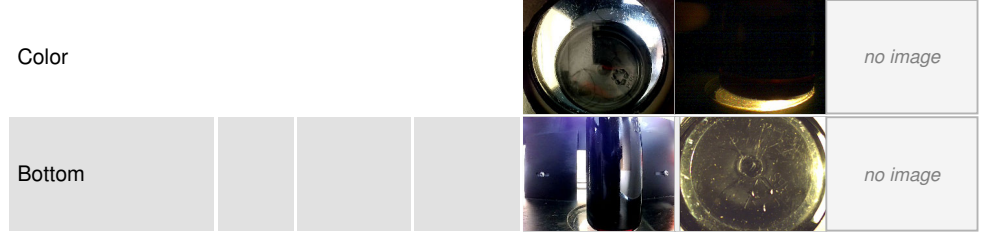

GRAPHS

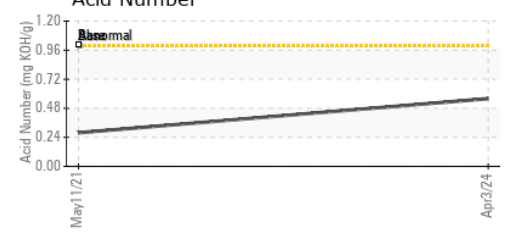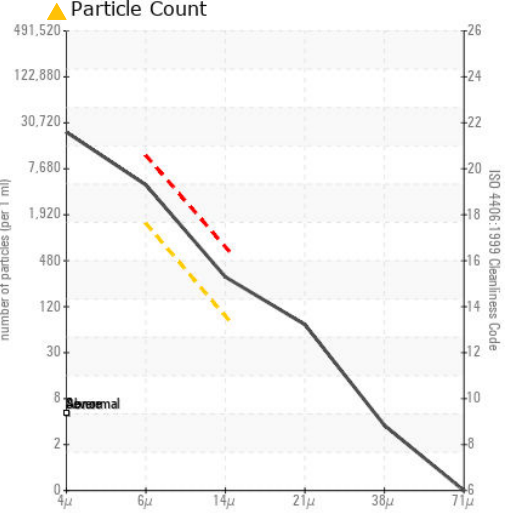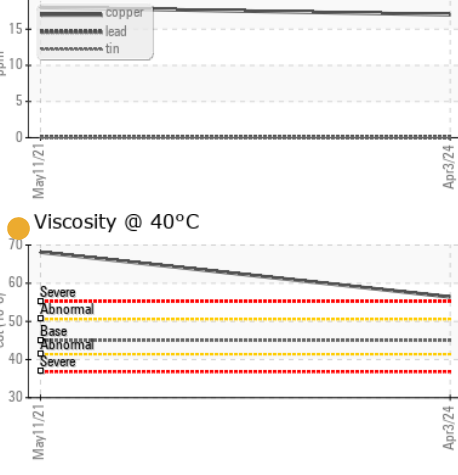

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015745 **Received** : 09 Apr 2024
Lab Number : 06143098 **Tested** : 10 Apr 2024
Unique Number : 10967906 **Diagnosed** : 11 Apr 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TWINCO ROMAX dba DYK AUTOMOTIVE
 3100 W MILL RD
 MILWAUKEE, WI
 US 53209
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)