




# OIL ANALYSIS REPORT

Sample Rating Trend

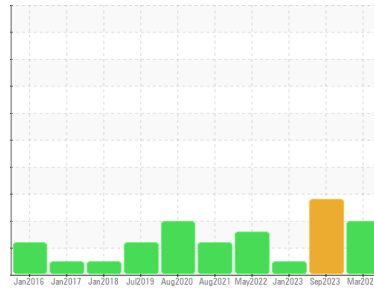

Machine Id  
**KAESER ASD 25 5205177 (S/N 1048)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA016357</b>	KCPA006275	KCP55715
Sample Date	Client Info		<b>21 Mar 2024</b>	01 Sep 2023	03 Jan 2023
Machine Age	hrs	Client Info	<b>28454</b>	27291	25873
Oil Age	hrs	Client Info	<b>8000</b>	0	3669
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	4	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>22</b>	25	23
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	6	<1
Calcium	ppm	ASTM D5185m 2	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	3	3
Zinc	ppm	ASTM D5185m	<b>48</b>	59	34
Sulfur	ppm	ASTM D5185m	<b>20367</b>	18189	15917

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	6	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0
Water	%	ASTM D6304 >0.05	<b>0.005</b>	▲ 0.203	0.006
ppm Water	ppm	ASTM D6304 >500	<b>54</b>	▲ 2030	66.8






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9369</b>	---	2483
Particles >6µm	ASTM D7647	>1300	▲ <b>4054</b>	---	1109
Particles >14µm	ASTM D7647	>80	▲ <b>260</b>	---	39
Particles >21µm	ASTM D7647	>20	▲ <b>82</b>	---	8
Particles >38µm	ASTM D7647	>4	● <b>9</b>	---	0
Particles >71µm	ASTM D7647	>3	<b>1</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/19/15</b>	---	18/17/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.45</b>	0.40	0.37


# OIL ANALYSIS REPORT

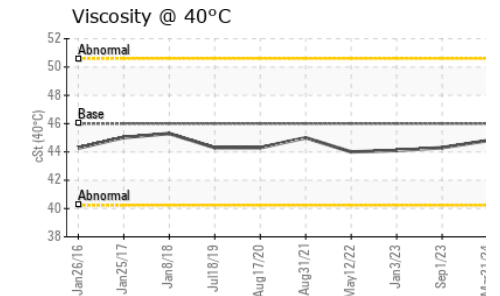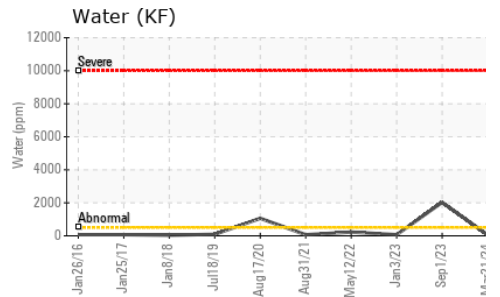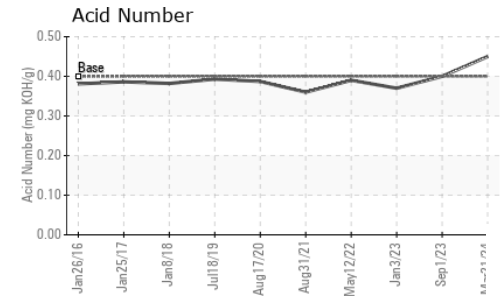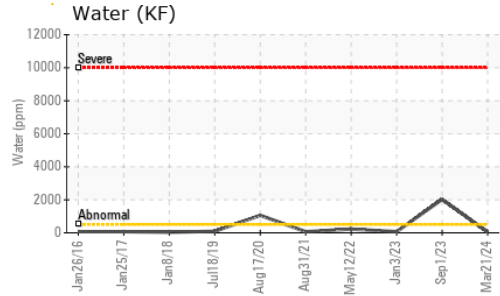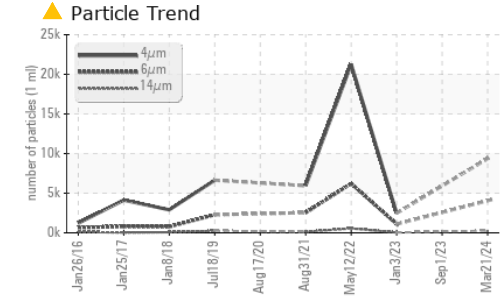





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.8	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

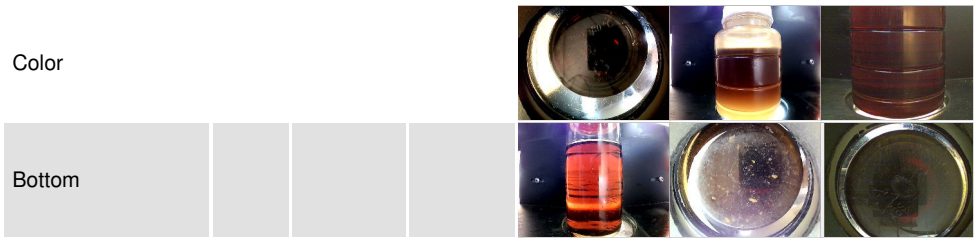

## GRAPHS

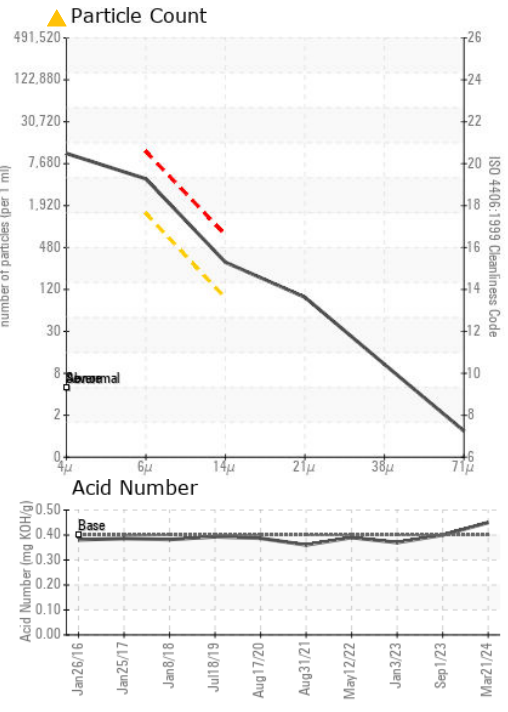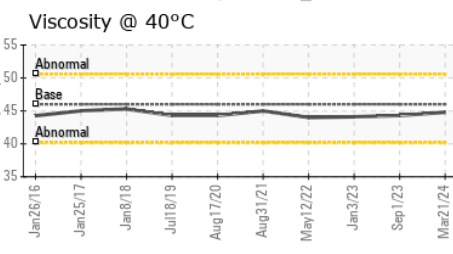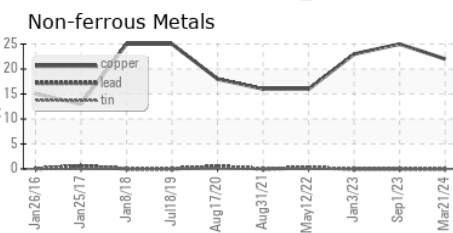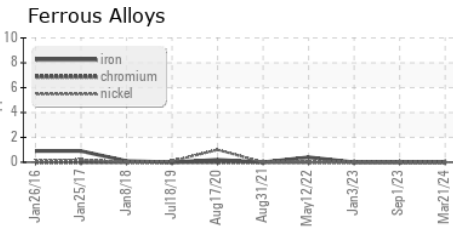

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016357  
**Lab Number** : 06143104  
**Unique Number** : 10967912  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 09 Apr 2024  
**Tested** : 10 Apr 2024  
**Diagnosed** : 11 Apr 2024 - Angela Borella

**ARAMARK**  
 401 GLEN IRIS DR NE  
 ATLANTA, GA  
 US 30308  
 Contact: ERIC SMITH  
 smith-eric14@aramark.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)