

OIL ANALYSIS REPORT



Machine Id

6604229 (S/N NOT GIVEN)

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013931	KCPA007481	
Sample Date		Client Info		04 Apr 2024	19 Dec 2023	
Machine Age	hrs	Client Info		4192	4080	
Oil Age	hrs	Client Info		200	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	2	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	3	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		۰ <1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	37	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	54	18	
Calcium	ppm	ASTM D5185m	0	<1	<1	
Phosphorus	ppm	ASTM D5185m	0	1	45	
Zinc	ppm	ASTM D5185m	0	11	12	
Sulfur	ppm	ASTM D5185m	23500	21527	23406	
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		13	7	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.029	0.008	
ppm Water	ppm	ASTM D6304	>500	291	86	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3380	2418	
Particles >6µm		ASTM D7647	>1300	1170	805	
Particles >14µm		ASTM D7647	>80	47	31	
Particles >21µm		ASTM D7647	>20	8	6	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	18/17/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34	0.23	

Contact/Location: Service Manager - ONEUTIKC Page 1 of 2



OIL ANALYSIS REPORT

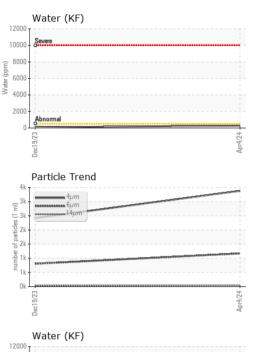

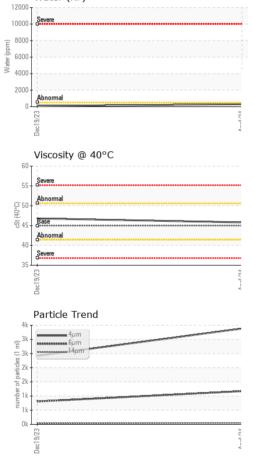

Ś

	VISUAL		method	limit/base	current	history1	history2	
	White Metal	scalar	*Visual	NONE	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE		
Apr4/24	Appearance	scalar	*Visual	NORML	NORML	NORML		
A	Odor	scalar	*Visual	NORML	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG	NEG		
	Free Water	scalar	*Visual		NEG	NEG		
	FLUID PROPERT	TIES	method	limit/base	current	history1	history2	
	Visc @ 40°C	cSt	ASTM D445	45	45.8	46.8		
***************************************	SAMPLE IMAGES	S	method	limit/base	current	history1	history2	
Apr4.24	Color					•	no image	
	Bottom						no image	
	GRAPHS		•					
	Ferrous Alloys			491,520	Particle Count		T 26	
	8- iron						20	
Č.	E 6+ nickel			122,880	-		-24	
Amed				30,720			-22	
	2			7.000				
				7,680 12			+20 +18 +16 +14 +12	
	Dec19/23			Apr4/24			-18	
	□ Non-ferrous Metal	lc.		·편 480		N	16	
				of par			10	
	8 - copper			sappiped 480 to a gumm		1.	-14	
	E 6			30	-		-12	
	4							
V C P	2				Berwe mal		+10	
Λ	9/23			Apr4/24			-8	
	Dec19/23			Apr ⁴				
	Viscosity @ 40°C			4	ہوں۔ Acid Number	14µ 21µ	38µ 71µ	
	60 T			<u> </u>	-			
	55 - Severe			(b)HO 0.96 (b)HO 0.96 (b) 0.72 400.48 V 0.24 V 0.00	Base rmal			
	(2) 50 - Abnormal (3) 60 (4) 45 - Abnormal			ຍິ 0.72				
	Abrioritia			- ⁰ 0.48				
	40 Severe			P 0.24				
	35				53		100	
1 C 1	Dec19/23			Apr4/24	Dec19/23		₽C ₽ruV	
ufficate L2367 Unique Number	: WearCheck USA - 50 : KCPA013931 r : 06143105 r : 10967913 a : IND 2 (Additional Test	Recei Teste Diagr sts: KF, P	ived : 09 ed : 10 nosed : 11 PrtCount)	red : 09 Apr 2024 I : 10 Apr 2024 Osed : 11 Apr 2024 - Angela Borella tCount)			NEIDA WATER TREATMEN 51 LELAND AVENUE UTICA, N US 13502 Contact: Service Manage	
discuss this sample repor Denotes test methods that		7025 scc	pe of accred	litation.	rule (ICGM 106	S-2012)	T	

Contact/Location: Service Manager - ONEUTIKC Page 2 of 2