


OIL ANALYSIS REPORT

Sample Rating Trend

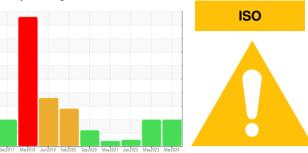

Machine Id

KAESER AS 25T 2252232 (S/N 1111)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2017 Ma	r2018 Jun2019 Feb2020 :	Sep 2020 May 2021 Jan 2022 May 202	23 Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013022	KCP001647	KCP41190
Sample Date		Client Info		19 Mar 2024	04 May 2023	27 Jan 2022
Machine Age	hrs	Client Info		93543	90013	82664
Oil Age	hrs	Client Info		2912	0	3393
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	4	15	6
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	22
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	100	0	11	13
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	0	2
Zinc	ppm	ASTM D5185m	0	0	29	37
Sulfur	ppm	ASTM D5185m	23500	17104	20158	18019
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	<1
Sodium	ppm	ASTM D5185m		2	2	9
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304		0.006	0.006	0.005
ppm Water	ppm	ASTM D6304	>500	65	64.1	52.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		8745	51691	3851
Particles >6µm		ASTM D7647	>1300	<u>2071</u>	<u>^</u> 26120	1052
Particles >14μm		ASTM D7647	>80	<u>^</u> 229	<u>4163</u>	76
Particles >21µm		ASTM D7647	>20	<u> </u>	<u></u> 969	21
Particles >38µm		ASTM D7647	>4	<u>▲</u> 11	▲ 57	0
Particles >71µm		ASTM D7647	>3	1	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15	<u>\$\text{23/22/19}\$</u>	17/13



OIL ANALYSIS REPORT

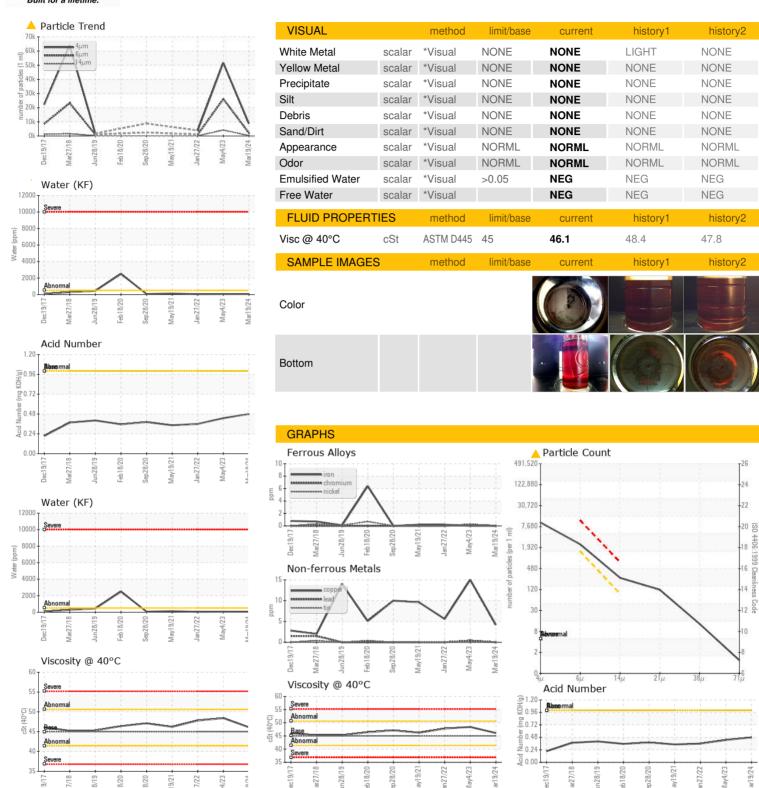





Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06143106 Unique Number : 10967914

: KCPA013022

Received **Tested**

: 10 Apr 2024 Diagnosed : 11 Apr 2024 - Angela Borella

: 09 Apr 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

JOSH.TIMMONS@ODLF.COM T:

OLD DOMINION FREIGHT

2885 ALUM CREEK DR

Contact: JOSH TIMMONS

COLUMBUS, OH

US 43207

F:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: OLDCOL [WUSCAR] 06143106 (Generated: 04/12/2024 09:15:50) Rev: 1

Contact/Location: JOSH TIMMONS - OLDCOL