




# OIL ANALYSIS REPORT

## Sample Rating Trend

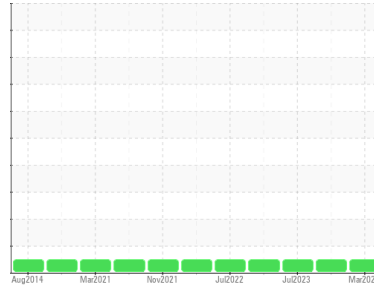

**NORMAL**



Area

**LIQUID TITANIUM LUB ALLOY PS3C**  
 Machine Id  
**DEKKER VMX0553KA1-00 22579 DEKKER VACUUM PUMP - ALL CLAD**  
 Component  
**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.  
 Please note that this is a corrected copy for laboratory data updates.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. Chlorine 0.0 ppm.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06143144</b>	UCH06030787	UCH05907711
Sample Date	Client Info		<b>15 Mar 2024</b>	15 Nov 2023	17 Jul 2023
Machine Age	hrs	Client Info	<b>42748</b>	40938	38880
Oil Age	hrs	Client Info	<b>2375</b>	565	2547
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	3	2
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	6	6
Phosphorus	ppm	ASTM D5185m		<b>145</b>	197	144
Zinc	ppm	ASTM D5185m		<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m		<b>1883</b>	2314	1895

### CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	4	6
Sodium	ppm	ASTM D5185m		<b>27</b>	20	45
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	<1
Chlorine Content	ppm	ASTM D5185m		<b>0.000</b>	5.40	3.10

### FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.11</b>	0.11	0.063




# OIL ANALYSIS REPORT

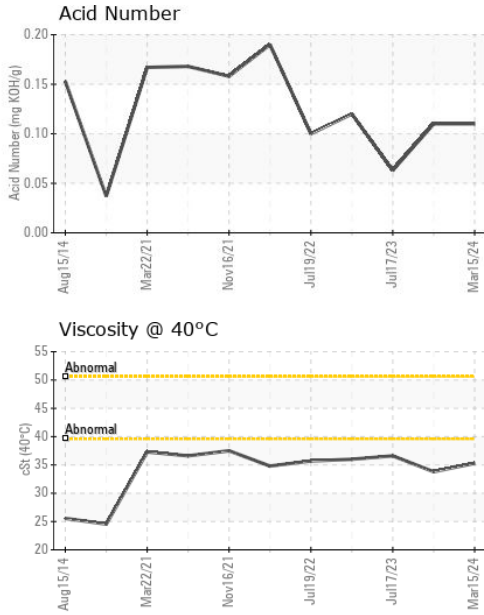



PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	35.3	33.8	36.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

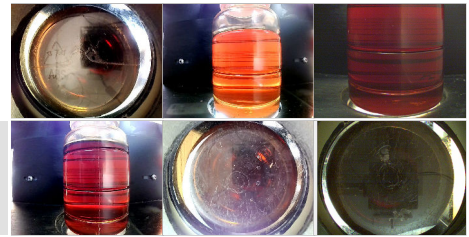

## GRAPHS

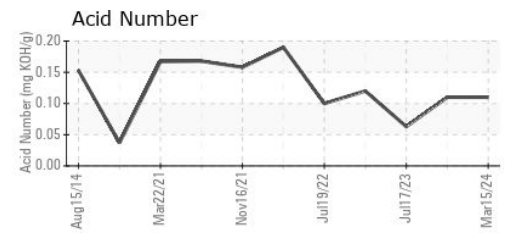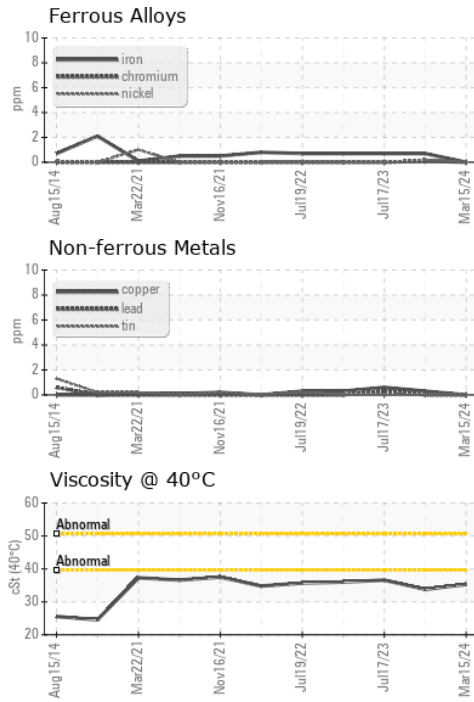

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06143144      **Received** : 09 Apr 2024  
**Lab Number** : 06143144      **Tested** : 15 Apr 2024  
**Unique Number** : 10967952      **Diagnosed** : 15 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: CHLORINEXRF )

**ROCKWELL EQUIPMENT & SUPPLY CO**  
 PO BOX 114  
 VERSAILLES, PA  
 US 15137  
 Contact: DINO PICCOLINO  
 DINOP@ROCKWELLEQUIPMENT.COM  
 T: (412)824-9903  
 F: (412)824-9271

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)