




# OIL ANALYSIS REPORT

Area  
**SYNOIL 8K**  
 Machine Id  
**KAESER 1413 - AMPHENOL**  
 Component  
**Compressor**

Sample Rating Trend

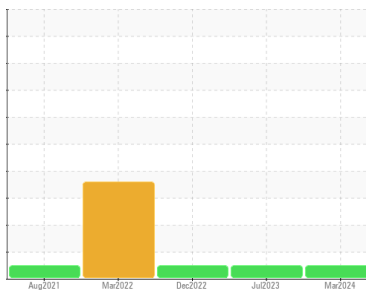

**NORMAL**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCZ06143153</b>	UCZ05919826	UCZ05727416
Sample Date	Client Info		<b>15 Mar 2024</b>	26 Jul 2023	07 Dec 2022
Machine Age	hrs	Client Info	<b>22176</b>	19357	16587
Oil Age	hrs	Client Info	<b>5700</b>	2800	5300
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	3	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	2	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>4</b>	9	5
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.3	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.3	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0.9	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0.2	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m 0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 429	<b>253</b>	339	142
Zinc	ppm	ASTM D5185m 0.3	<b>37</b>	41	47
Sulfur	ppm	ASTM D5185m 1336	<b>2966</b>	4450	11646

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	2	1
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.622	<b>0.40</b>	0.44	0.311




# OIL ANALYSIS REPORT

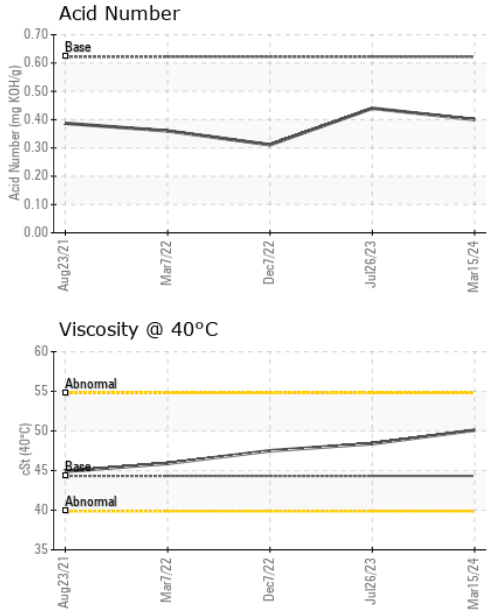



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	MODER
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.32	<b>50.1</b>	48.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

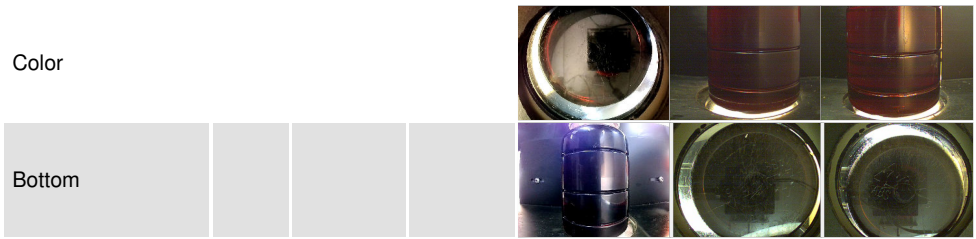

## GRAPHS

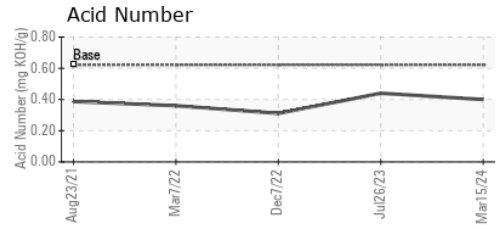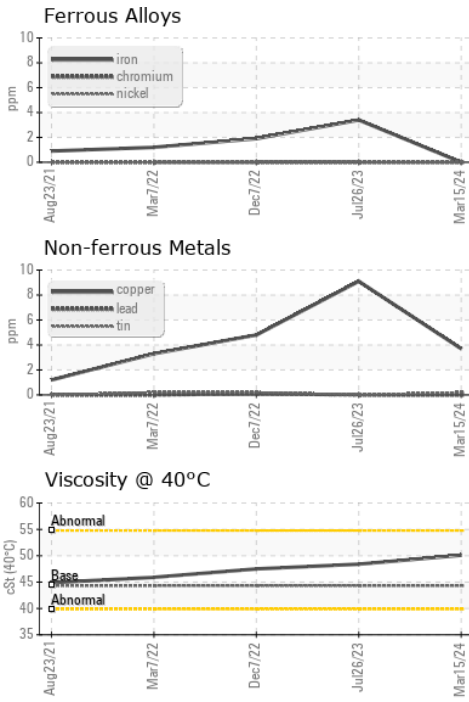

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06143153      **Received** : 09 Apr 2024  
**Lab Number** : **06143153**      **Tested** : 15 Apr 2024  
**Unique Number** : 10967961      **Diagnosed** : 15 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2

**ZORN COMPRESSOR EQUIPMENT**  
 227 AMBROSIO DR, SUITE A  
 GURNEE, IL  
 US 60031  
 Contact: Rachel Pesnikov  
 rachel.pesnikov@zornair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)