




OIL ANALYSIS REPORT

Sample Rating Trend

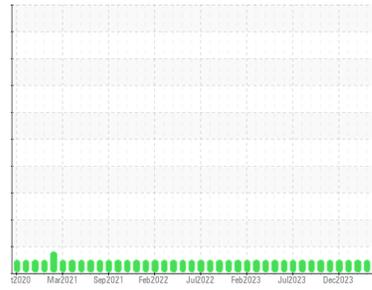

NORMAL



Machine Id
TURBO EXPANDER
 Component
Hydraulic System
 Fluid
MOBIL DTE OIL LIGHT (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0907819	WC0907813	WC0820286
Sample Date	Client Info		04 Apr 2024	09 Mar 2024	06 Feb 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	0	0	0
Chromium	ppm	ASTM D5185m >20	<1	<1	0
Nickel	ppm	ASTM D5185m >20	0	<1	<1
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >20	0	0	0
Lead	ppm	ASTM D5185m >20	0	2	0
Copper	ppm	ASTM D5185m >20	7	8	8
Tin	ppm	ASTM D5185m >20	0	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	10	0	0
Molybdenum	ppm	ASTM D5185m	0	1	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	0	<1	<1
Calcium	ppm	ASTM D5185m	4	3	5
Phosphorus	ppm	ASTM D5185m	100	96	106
Zinc	ppm	ASTM D5185m	65	54	69
Sulfur	ppm	ASTM D5185m	488	463	453

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	<1	0
Sodium	ppm	ASTM D5185m	1	2	<1
Potassium	ppm	ASTM D5185m >20	0	1	0
Water	%	ASTM D6304 >0.05	0.002	0.001	0.003
ppm Water	ppm	ASTM D6304 >500	19	9	27

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	594	666	533
Particles >6µm	ASTM D7647	>1300	105	128	110
Particles >14µm	ASTM D7647	>160	8	6	6
Particles >21µm	ASTM D7647	>40	3	2	1
Particles >38µm	ASTM D7647	>10	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	16/14/10	17/14/10	16/14/10

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.15	0.15	0.13



OIL ANALYSIS REPORT

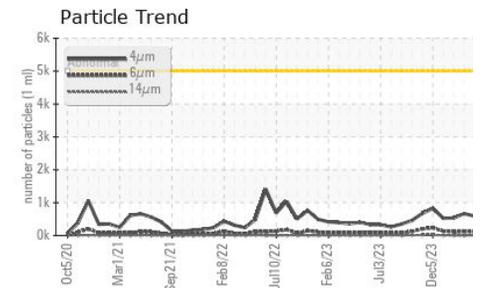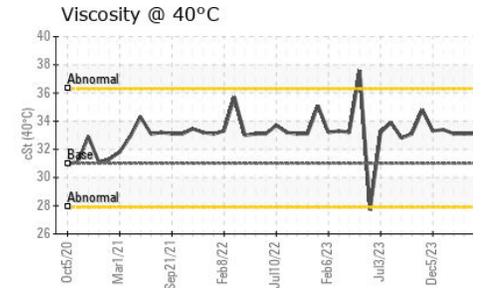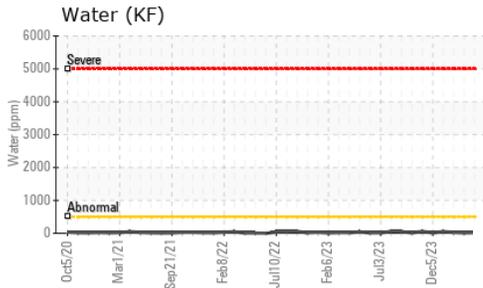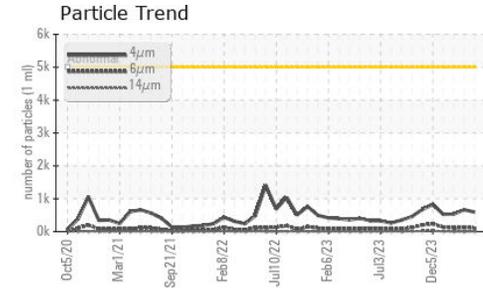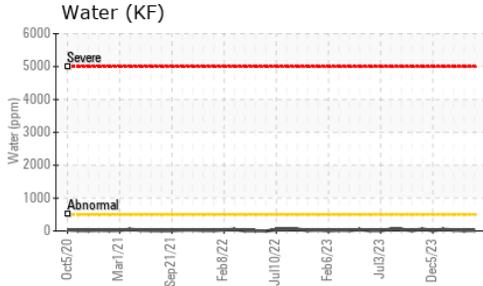





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 31	33.1	33.1	33.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

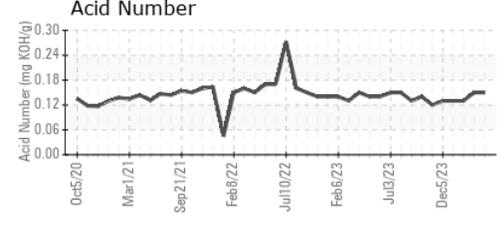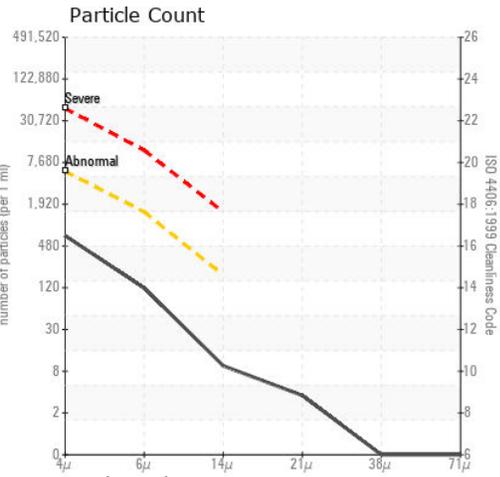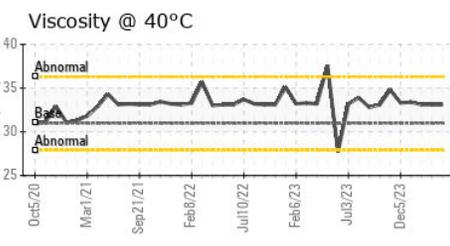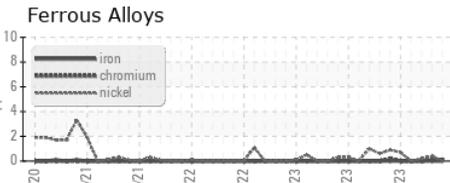

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0907819 **Received** : 09 Apr 2024
Lab Number : **06143705** **Tested** : 10 Apr 2024
Unique Number : 10968513 **Diagnosed** : 10 Apr 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF)

UGI ENERGY SERVICES - LNG FACILITY
 80 ENERGY LN
 MESHOPPEN, PA
 US 18630
 Contact: **JOE BARRETT**
 jbarrett@ugies.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)