




OIL ANALYSIS REPORT

Sample Rating Trend

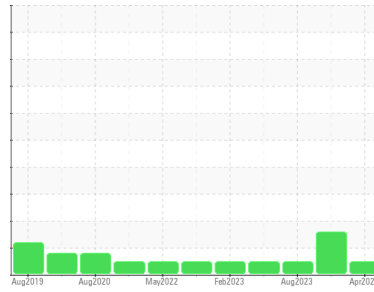

NORMAL



Machine Id
KAESER BSD 60T 6475974 (S/N 1250)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015395	KCPA004557	KCPA005992
Sample Date	Client Info		01 Apr 2024	02 Nov 2023	11 Aug 2023
Machine Age	hrs	Client Info	22106	19048	17654
Oil Age	hrs	Client Info	147	0	0
Oil Changed	Client Info		Changed	N/A	N/A
Sample Status			NORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	0	1	<1
Tin	ppm	ASTM D5185m >10	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	62	0	48
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	77	0	80
Calcium	ppm	ASTM D5185m 2	2	0	<1
Phosphorus	ppm	ASTM D5185m	1	0	2
Zinc	ppm	ASTM D5185m	0	0	2
Sulfur	ppm	ASTM D5185m	22176	20079	23492

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	2	1
Sodium	ppm	ASTM D5185m	28	22	26
Potassium	ppm	ASTM D5185m >20	6	5	6
Water	%	ASTM D6304 >0.05	0.012	0.026	0.038
ppm Water	ppm	ASTM D6304 >500	130	268.3	380.2






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1465	14953	2211
Particles >6µm	ASTM D7647 >1300		187	▲ 4845	489
Particles >14µm	ASTM D7647 >80		10	▲ 269	48
Particles >21µm	ASTM D7647 >20		3	▲ 51	13
Particles >38µm	ASTM D7647 >4		0	1	0
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		18/15/10	▲ 21/19/15	18/16/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.36	0.30	0.38


OIL ANALYSIS REPORT

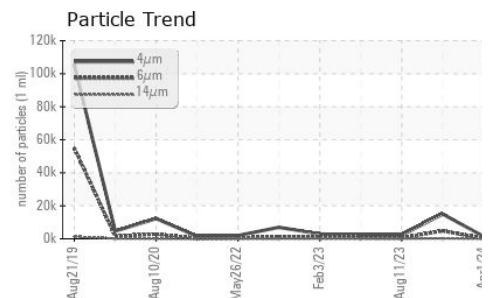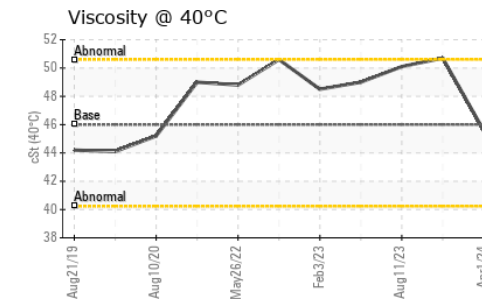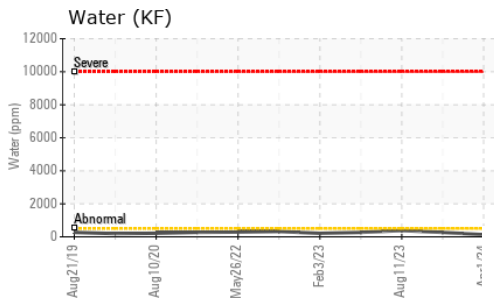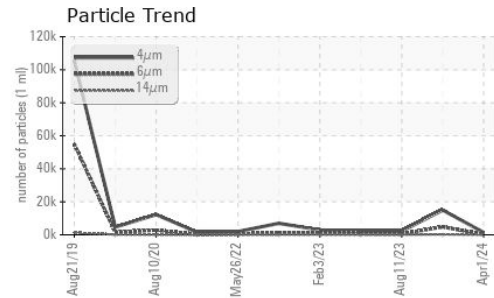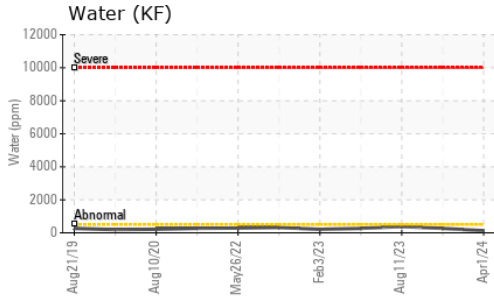






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.6	50.7	50.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

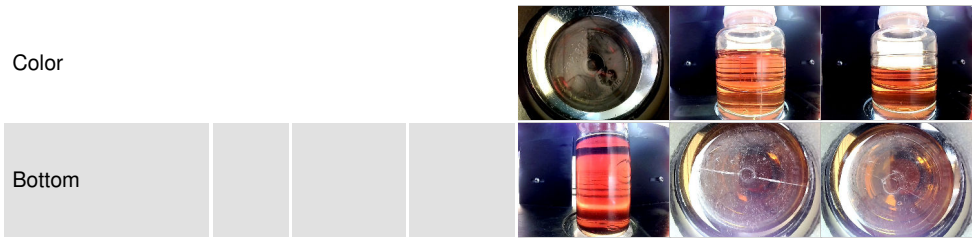

GRAPHS

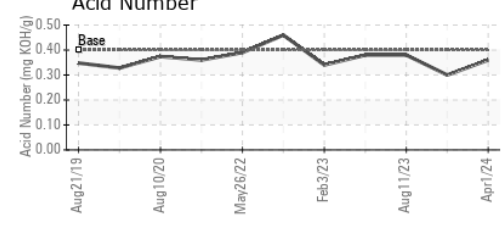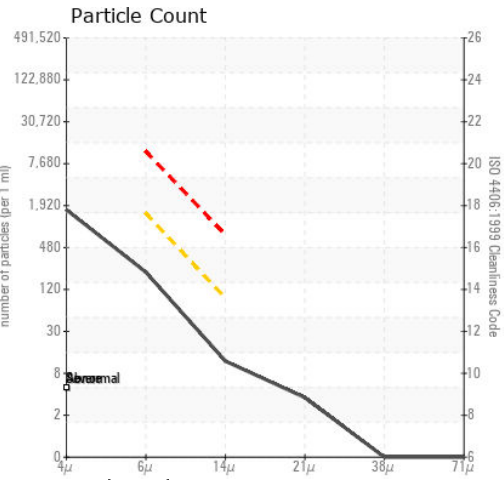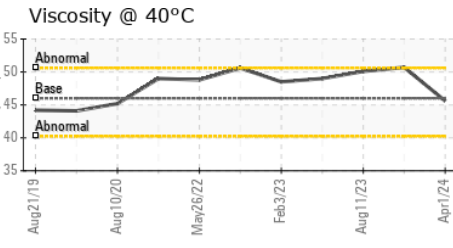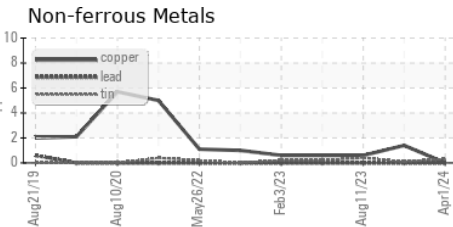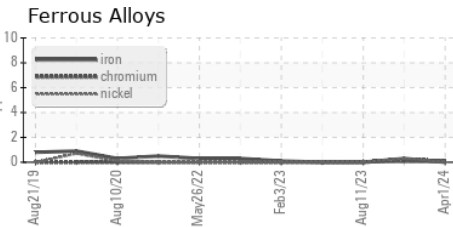

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015395 **Received** : 09 Apr 2024
Lab Number : 06143714 **Tested** : 10 Apr 2024
Unique Number : 10968522 **Diagnosed** : 12 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON SERVICES
 409 WASHINGTON AVE
 NORTH HAVEN, CT
 US 06473
 Contact: L. UCASTRA
 lucastra@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)