




OIL ANALYSIS REPORT

Sample Rating Trend

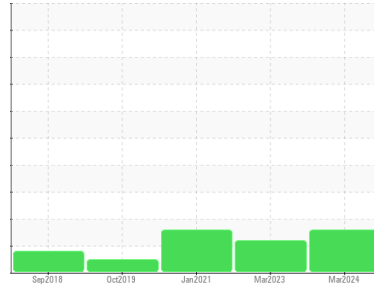

ISO



Machine Id
KAESER SM 11 2234200 (S/N 1027)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015989	KCP54157	KCP27767
Sample Date	Client Info		28 Mar 2024	31 Mar 2023	12 Jan 2021
Machine Age	hrs	Client Info	11285	10544	8472
Oil Age	hrs	Client Info	741	0	1140
Oil Changed	Client Info		Changed	Changed	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	1	4	10
Copper	ppm	ASTM D5185m >50	8	8	5
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	13
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 100	34	47	78
Calcium	ppm	ASTM D5185m 0	0	0	2
Phosphorus	ppm	ASTM D5185m 0	0	0	4
Zinc	ppm	ASTM D5185m 0	7	0	<1
Sulfur	ppm	ASTM D5185m 23500	22009	23824	18711

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	6	0	<1
Sodium	ppm	ASTM D5185m	10	12	14
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.05	0.010	0.005	0.010
ppm Water	ppm	ASTM D6304 >500	104	56.9	107.5






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		30043	4764	5179
Particles >6µm	ASTM D7647	>1300	▲ 8362	● 1379	▲ 1751
Particles >14µm	ASTM D7647	>80	▲ 657	● 89	▲ 222
Particles >21µm	ASTM D7647	>20	▲ 151	22	▲ 64
Particles >38µm	ASTM D7647	>4	4	0	▲ 4
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/17	● 19/18/14	▲ 18/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.40	0.36	0.456


OIL ANALYSIS REPORT

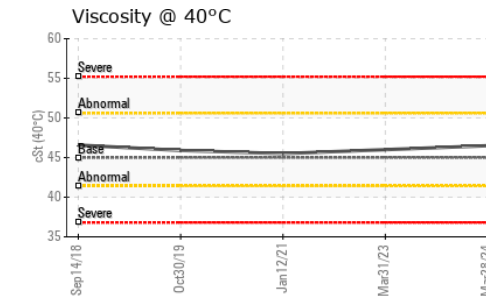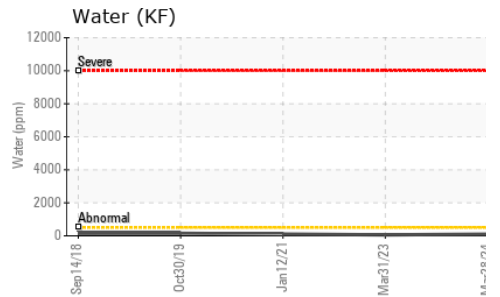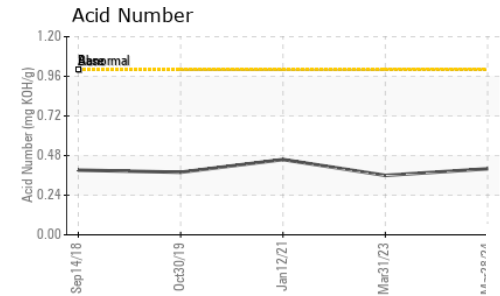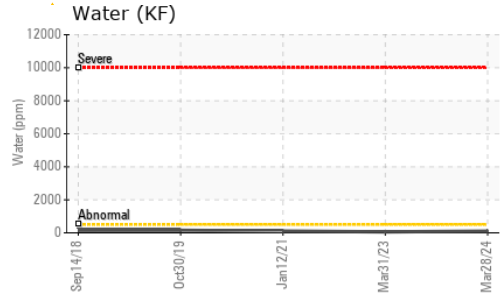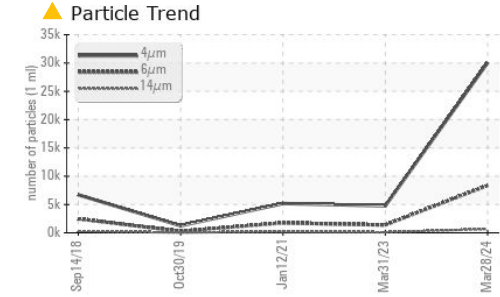






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.5	46.0	45.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

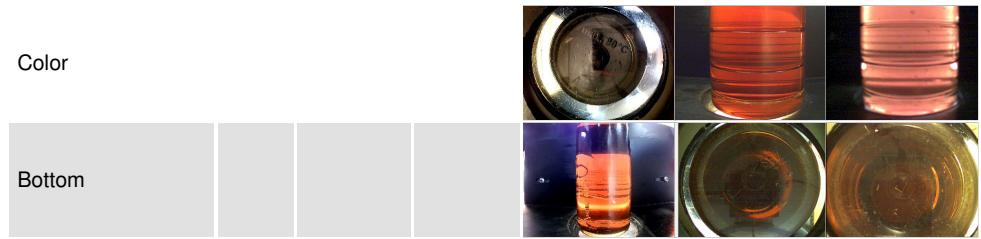

GRAPHS

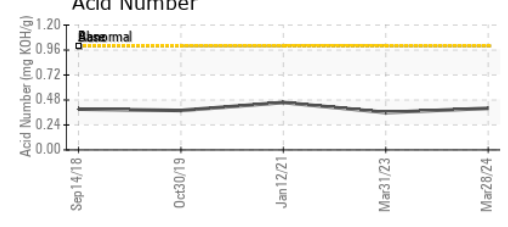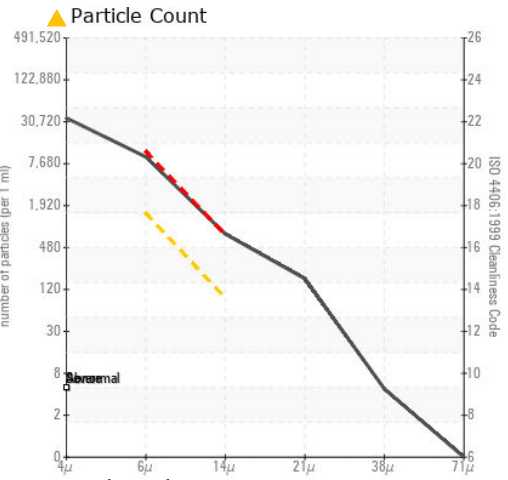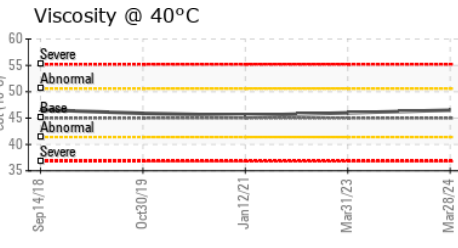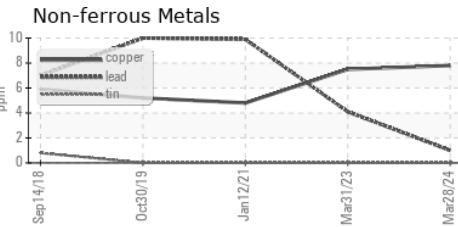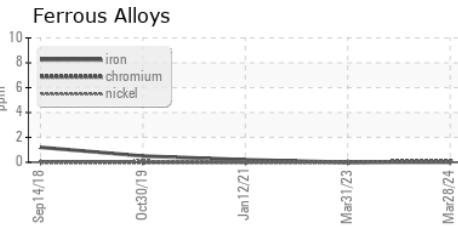

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015989 **Received** : 09 Apr 2024
Lab Number : 06143718 **Tested** : 10 Apr 2024
Unique Number : 10968526 **Diagnosed** : 12 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PASTERKAMP HVAC
 1930 S CHEROKEE ST
 DENVER, CO
 US 80223
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)