




# OIL ANALYSIS REPORT

## Sample Rating Trend

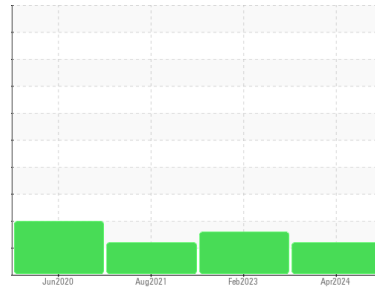

ISO



Machine Id  
**KAESER SFC 37T 4156012 (S/N 1001)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016892</b>	KCP52460	KCP42610
Sample Date	Client Info			<b>01 Apr 2024</b>	10 Feb 2023	12 Aug 2021
Machine Age	hrs	Client Info		<b>32880</b>	31333	29779
Oil Age	hrs	Client Info		<b>1639</b>	1554	2790
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	2	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>10</b>	7	20
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>3</b>	2	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	100	<b>60</b>	35	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	9	14
Zinc	ppm	ASTM D5185m	0	<b>16</b>	51	58
Sulfur	ppm	ASTM D5185m	23500	<b>22201</b>	18317	18964


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m		<b>19</b>	11	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	4	0
Water	%	ASTM D6304	>0.05	<b>0.019</b>	0.015	0.007
ppm Water	ppm	ASTM D6304	>500	<b>197</b>	154.5	79.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>7374</b>	21343	8948
Particles >6µm		ASTM D7647	>1300	<b>1706</b>	5484	2967
Particles >14µm		ASTM D7647	>80	<b>89</b>	239	225
Particles >21µm		ASTM D7647	>20	<b>16</b>	41	51
Particles >38µm		ASTM D7647	>4	<b>0</b>	1	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	22/20/15	19/15


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.43</b>	0.38	0.416

# OIL ANALYSIS REPORT


## Particle Trend

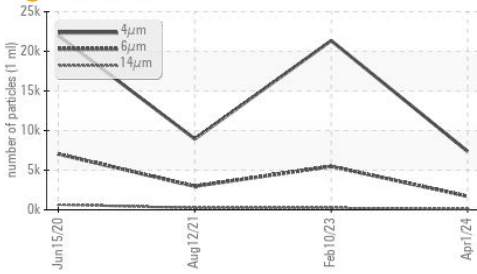


## Water (KF)

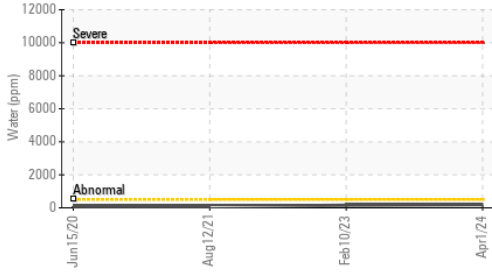


## Acid Number

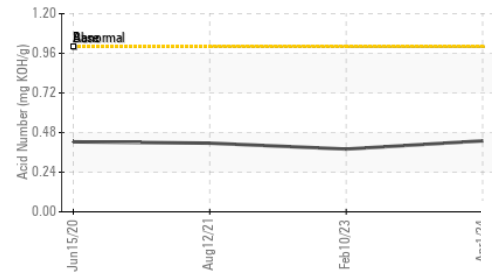

## Water (KF)

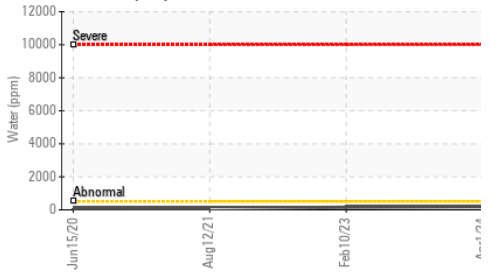

## Viscosity @ 40°C

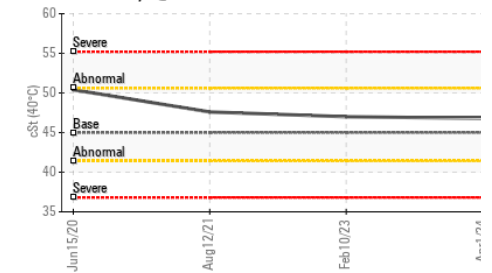


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.8	47.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


### Ferrous Alloys

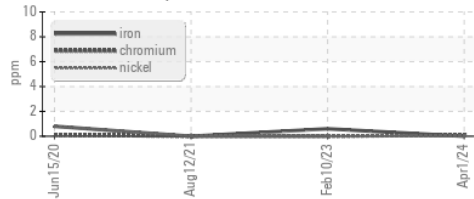


### Non-ferrous Metals

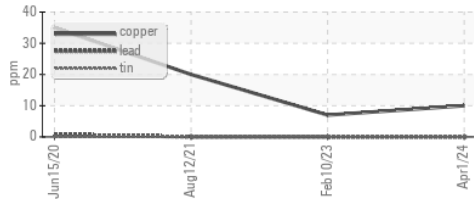


### Viscosity @ 40°C

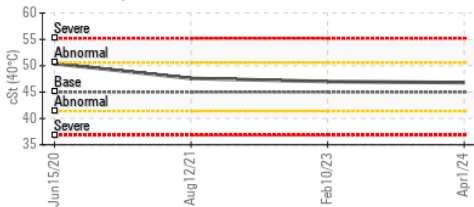

### Particle Count

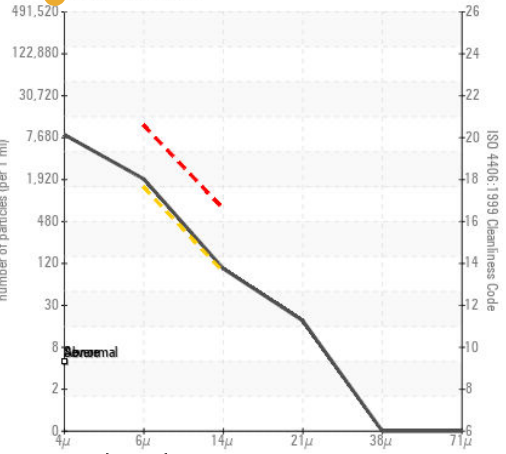

### Acid Number

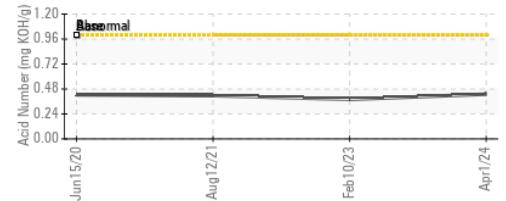

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA016892

Lab Number : 06143726

Unique Number : 10968534

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 09 Apr 2024

Tested : 10 Apr 2024

Diagnosed : 12 Apr 2024 - Jonathan Hester

ARAMARK UNIFORM SERVICES

1900 PROGRESS AVE

COLUMBUS, OH

US 43207

Contact: HERB TELFORD

TELFORD.HERB@ARAMARK.COM

T:

F: