



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area  
**38558 TRACE PO 38138 [38558]**  
 Machine Id  
**JP8TS0001-04082024B**  
 Component  
**Turbine**  
 Fluid  
**832020 JP8 MIL-DTL-83133 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target SAE AS4059 (replaces NAS 1638) cleanliness code.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC06143768</b>	---	---
Sample Date	Client Info			<b>08 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Lead	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304	>0.03	<b>0.004</b>	---	---
ppm Water	ppm	ASTM D6304	>300	<b>45</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles 5-15µm	count	*NAS 1638	>8000	<b>▲ 20131</b>	---	---
Particles 15-25µm	count	*NAS 1638	>1425	<b>▲ 2228</b>	---	---
Particles 25-50µm	count	*NAS 1638	>253	<b>▲ 911</b>	---	---
Particles 50-100µm	count	*NAS 1638	>45	<b>▲ 72</b>	---	---
Particles >100µm	count	*NAS 1638	>8	<b>0</b>	---	---
NAS 1638	Class	*NAS 1638	>5	<b>7</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.091</b>	---	---



# OIL ANALYSIS REPORT

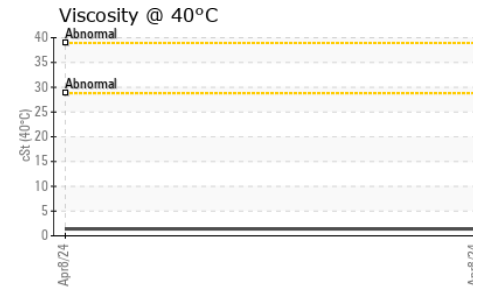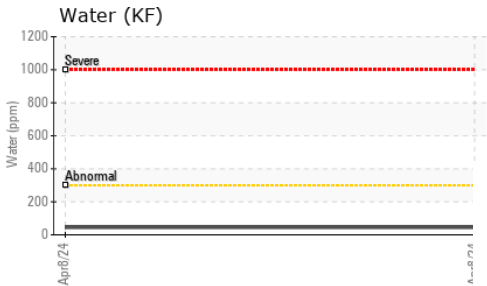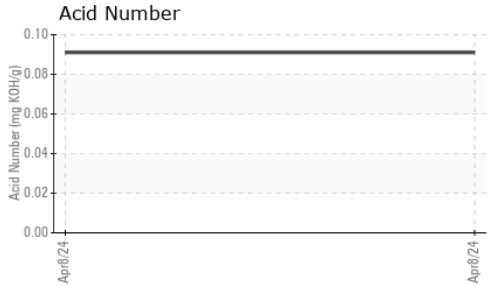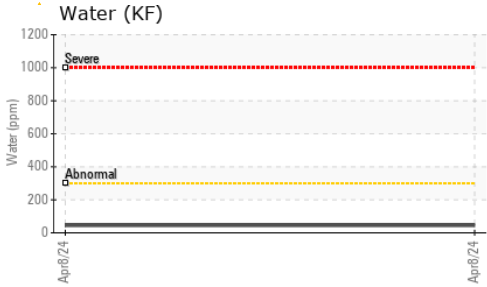





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.03	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

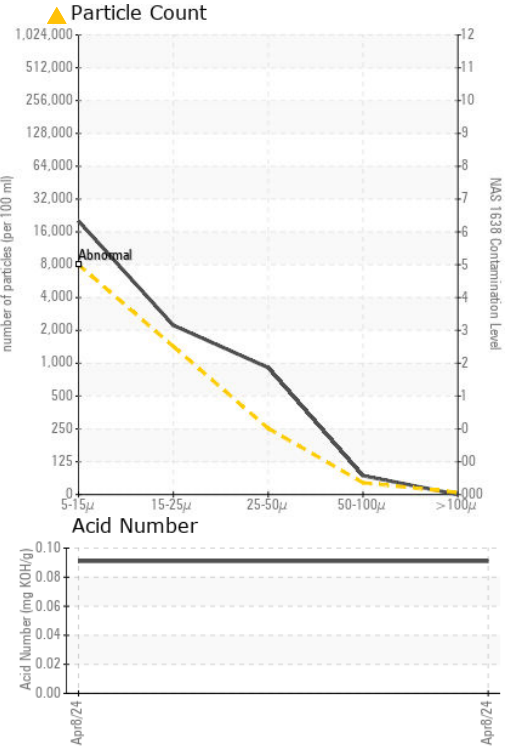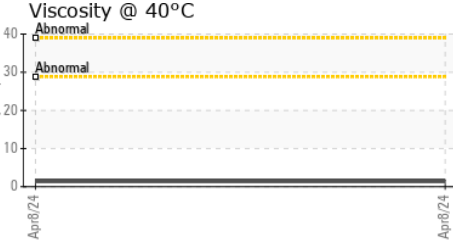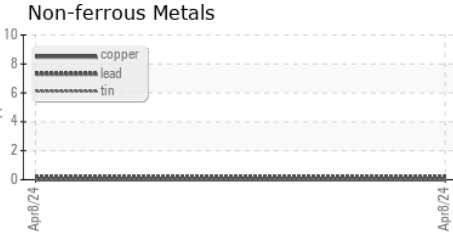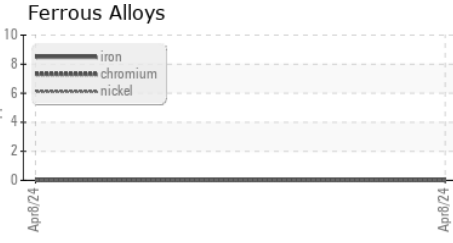

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06143768      **Received** : 09 Apr 2024  
**Lab Number** : 06143768      **Tested** : 12 Apr 2024  
**Unique Number** : 10968576      **Diagnosed** : 12 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCountNAS )

**RIDGE ENGINEERING**  
 3987 HAMPSTEAD-MEXICO RD  
 HAMPSTEAD, MD  
 US 21074  
 Contact: HEATHER ABELL\*  
 heather@ridgeeng.com; dbogart@wearcheckusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)