




OIL ANALYSIS REPORT

Sample Rating Trend

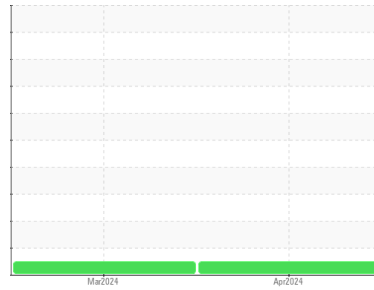

NORMAL



Area
QUANTUM

Machine Id

4205

Component

Biogas Engine

Fluid

LO-ASH ENGINE OIL SAE 40 (115 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			AO0000396	AO0000395	---
Sample Date	Client Info			05 Apr 2024	04 Mar 2024	---
Machine Age	hrs	Client Info		38651	37652	---
Oil Age	hrs	Client Info		38651	4429	---
Oil Changed	Client Info			Filtered	Filtered	---
Sample Status				NORMAL	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	---
Water	WC Method	>0.1		NEG	NEG	---
Glycol	WC Method			NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	3	0	---
Chromium	ppm	ASTM D5185m	>2	<1	0	---
Nickel	ppm	ASTM D5185m	>2	<1	<1	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m	>5	0	0	---
Aluminum	ppm	ASTM D5185m	>10	2	2	---
Lead	ppm	ASTM D5185m	>5	1	<1	---
Copper	ppm	ASTM D5185m	>14	<1	0	---
Tin	ppm	ASTM D5185m	>13	<1	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	37	0	0	---
Barium	ppm	ASTM D5185m	12	0	0	---
Molybdenum	ppm	ASTM D5185m	200	4	<1	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	5	16	9	---
Calcium	ppm	ASTM D5185m	1600	1351	1253	---
Phosphorus	ppm	ASTM D5185m	300	301	282	---
Zinc	ppm	ASTM D5185m	400	379	354	---
Sulfur	ppm	ASTM D5185m	2600	3008	2537	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	2	1	---
Sodium	ppm	ASTM D5185m		0	1	---
Potassium	ppm	ASTM D5185m	>20	1	2	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	---
Nitration	Abs/cm	*ASTM D7624	>20	5.0	4.8	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.3	15.2	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.0	9.3	---
Base Number (BN)	mg KOH/g	ASTM D2896	3.0	2.8	2.2	---





OIL ANALYSIS REPORT

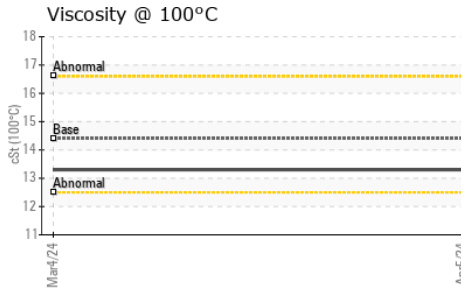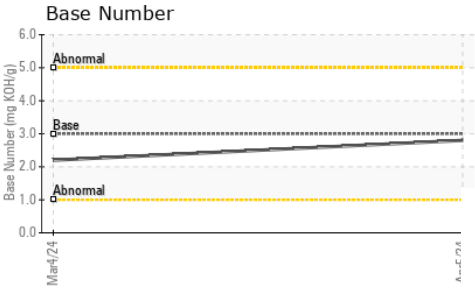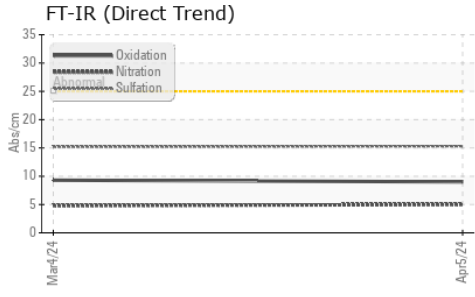

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	13.3	13.3	---

GRAPHS

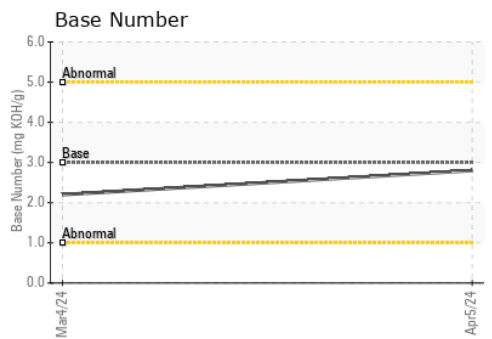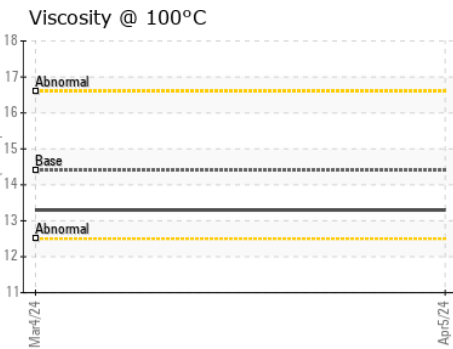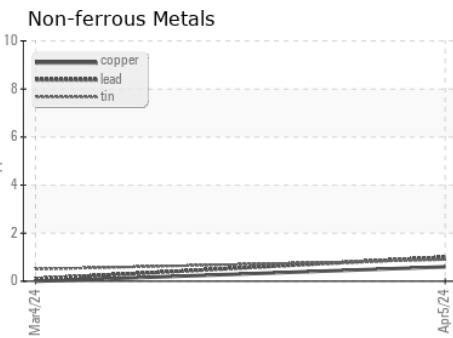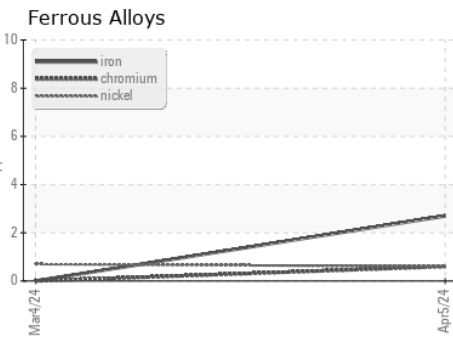

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : AO0000396 **Received** : 10 Apr 2024
Lab Number : **06144071** **Tested** : 11 Apr 2024
Unique Number : 10968879 **Diagnosed** : 12 Apr 2024 - Don Baldrige
Test Package : FLEET

MOMENTUM MIDSTREAM - LONGVIEW
 540 PR 2297
 LONGVIEW, TX
 US 75604
 Contact: KEVIN MILLER
 kevin.miller@momentummidstream.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)