




# OIL ANALYSIS REPORT

## Sample Rating Trend

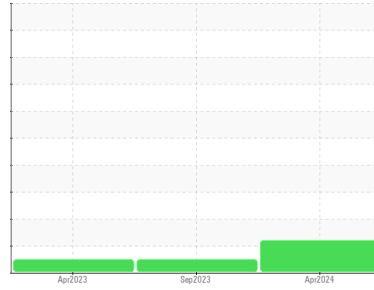

ISO



Machine Id  
**WC-9814A-1001-5 Air Compressor #1**  
 Component  
**Air Compressor**  
 Fluid  
**QUINCY QUINSYN (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0836587</b>   | WC0836527   | WC0784755   |
| Sample Date   | Client Info |             | <b>08 Apr 2024</b> | 14 Sep 2023 | 05 Apr 2023 |
| Machine Age   | hrs         | Client Info | <b>35135</b>       | 30252       | 26529       |
| Oil Age       | hrs         | Client Info | <b>0</b>           | 0           | 0           |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             |             | <b>ATTENTION</b>   | NORMAL      | NORMAL      |

### WEAR METALS

|          | method | limit/base      | current  | history1 | history2 |
|----------|--------|-----------------|----------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b> | <1       | 0        |
| Chromium | ppm    | ASTM D5185m >4  | <b>0</b> | 0        | 0        |
| Nickel   | ppm    | ASTM D5185m >4  | <b>0</b> | 0        | 0        |
| Titanium | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Silver   | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >10 | <b>0</b> | 0        | <1       |
| Lead     | ppm    | ASTM D5185m >20 | <b>0</b> | 0        | 0        |
| Copper   | ppm    | ASTM D5185m >40 | <b>0</b> | <1       | 0        |
| Tin      | ppm    | ASTM D5185m >5  | <b>0</b> | 0        | 0        |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |

### ADDITIVES

|            | method | limit/base  | current  | history1 | history2 |
|------------|--------|-------------|----------|----------|----------|
| Boron      | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |
| Barium     | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |
| Molybdenum | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |
| Manganese  | ppm    | ASTM D5185m | <b>0</b> | 0        | <1       |
| Magnesium  | ppm    | ASTM D5185m | <b>0</b> | <1       | 0        |
| Calcium    | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m | <b>2</b> | 3        | 4        |
| Zinc       | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |
| Sulfur     | ppm    | ASTM D5185m | <b>0</b> | 0        | 0        |

### CONTAMINANTS

|           | method | limit/base       | current    | history1 | history2 |
|-----------|--------|------------------|------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >25  | <b>0</b>   | 0        | 0        |
| Sodium    | ppm    | ASTM D5185m      | <b>0</b>   | 0        | 0        |
| Potassium | ppm    | ASTM D5185m >20  | <b>0</b>   | <1       | 0        |
| Water     | %      | ASTM D6304 >0.6  | <b>NEG</b> | 0.025    | NEG      |
| ppm Water | ppm    | ASTM D6304 >6000 | <b>---</b> | 254.7    | ---      |

### FLUID CLEANLINESS

|                 | method       | limit/base | current         | history1 | history2 |
|-----------------|--------------|------------|-----------------|----------|----------|
| Particles >4µm  | ASTM D7647   | >10000     | <b>5759</b>     | 1287     | 556      |
| Particles >6µm  | ASTM D7647   | >2500      | <b>2762</b>     | 423      | 212      |
| Particles >14µm | ASTM D7647   | >320       | <b>408</b>      | 38       | 22       |
| Particles >21µm | ASTM D7647   | >80        | <b>67</b>       | 14       | 5        |
| Particles >38µm | ASTM D7647   | >20        | <b>2</b>        | 3        | 1        |
| Particles >71µm | ASTM D7647   | >4         | <b>0</b>        | 1        | 0        |
| Oil Cleanliness | ISO 4406 (c) | >20/18/15  | <b>20/19/16</b> | 17/16/12 | 16/15/12 |


### FLUID DEGRADATION

|                  | method   | limit/base     | current     | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 .10 | <b>0.46</b> | 0.44     | 0.45     |




# OIL ANALYSIS REPORT


● Particle Trend

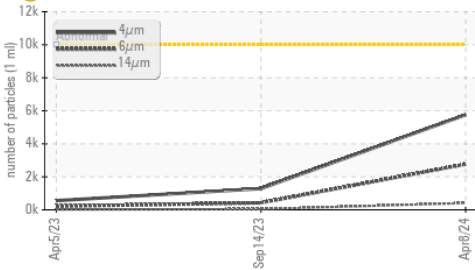


Water (KF)

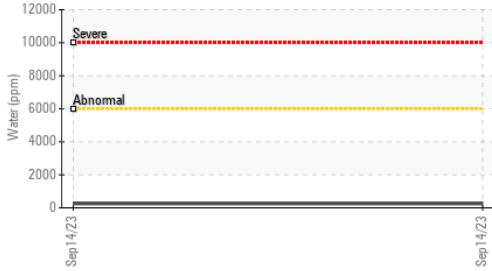


Acid Number

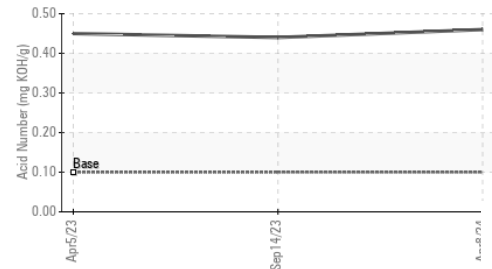

Viscosity @ 40°C

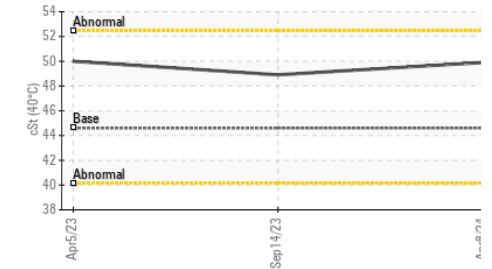


Water (KF)

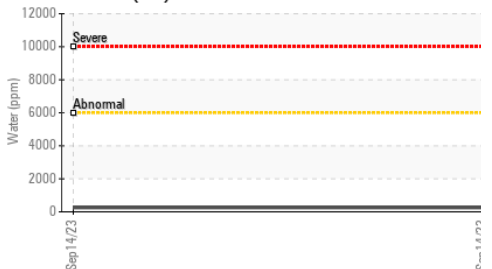

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.6    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 44.6    | 49.9     | 48.9     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

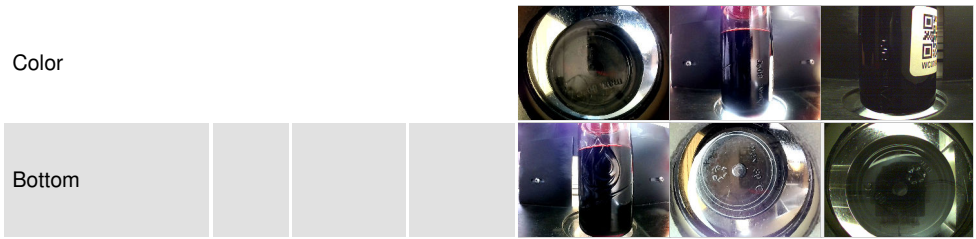


## GRAPHS


Ferrous Alloys

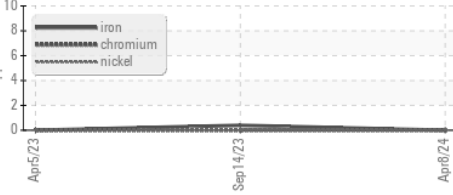


Non-ferrous Metals

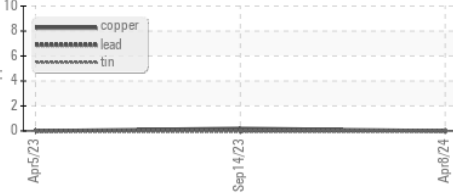


Viscosity @ 40°C

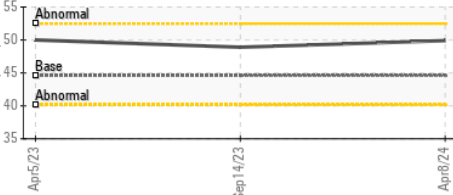

● Particle Count

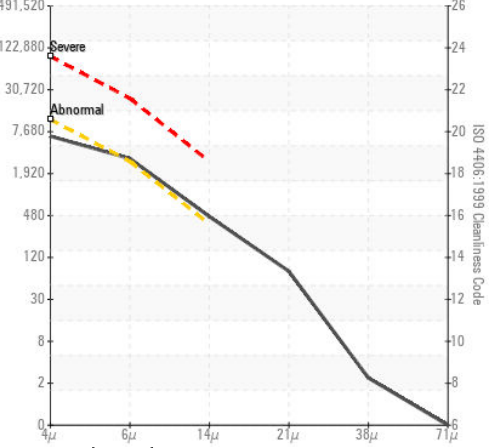

Acid Number

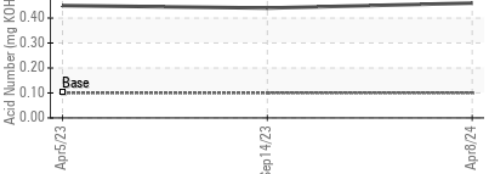

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0836587  
**Lab Number** : 06144208  
**Unique Number** : 10969016  
**Test Package** : PLANT

**Received** : 10 Apr 2024  
**Tested** : 15 Apr 2024  
**Diagnosed** : 15 Apr 2024 - Jonathan Hester

**Chugach Consolidated Solutions - NSA**  
 10840 Guilford Road, Suites 406-407  
 Annapolis Junction, MD  
 US 20701

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Susan Nord  
 susan.nord@chugachgov.com  
 T: (301)688-6363  
 F: (443)479-5666