


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 7447321

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Appearance is unacceptable There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

CAMPLE INCOR	AATIONI					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013313	KCP46337	KCP37021
Sample Date		Client Info		27 Mar 2024	23 Feb 2023	30 Aug 2021
Machine Age	hrs	Client Info		5682	4113	1076
Oil Age	hrs	Client Info		1569	3037	922
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	2	2	1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	4	11	13
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	39	67	67
Calcium	ppm	ASTM D5185m	2	<1	2	0
Phosphorus	ppm	ASTM D5185m		3	<1	4
Zinc	ppm	ASTM D5185m		0	3	1
Sulfur	ppm	ASTM D5185m		20477	20397	17195
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		8	13	8
Potassium	ppm	ASTM D5185m	>20	<1	4	8
Water	%	ASTM D6304	>0.05	△ 0.327	0.025	0.032
ppm Water	ppm	ASTM D6304	>500	<u>▲</u> 3270	252.9	328.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1105	4120	20506
Particles >6µm		ASTM D7647	>1300	602	1092	▲ 8769
Particles >14μm		ASTM D7647	>80	102	29	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	4	<u>△</u> 25
Particles >38μm		ASTM D7647	>4	<u> </u>	1	1
Particles >71μm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/14	19/17/12	△ 20/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

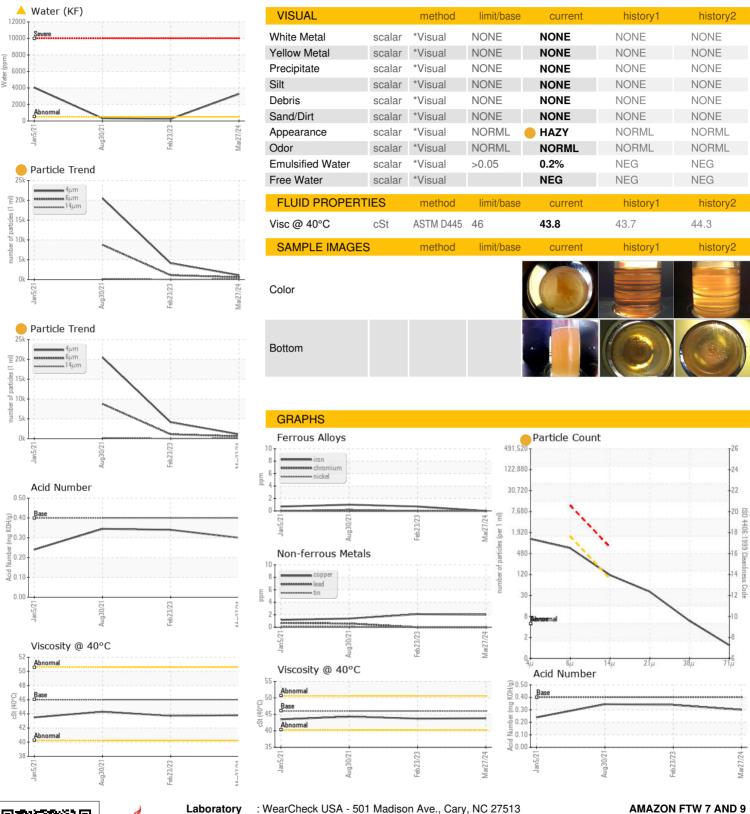





Laboratory Sample No.

Lab Number Unique Number: 10969059

: KCPA013313 : 06144251

Received **Tested** Diagnosed

: 16 Apr 2024

: 10 Apr 2024

: 16 Apr 2024 - Jonathan Hester

Contact: Service Manager

944 W SANDY LAKE RD

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COPPELL, TX

US 75019

T:

F: