




OIL ANALYSIS REPORT

Sample Rating Trend

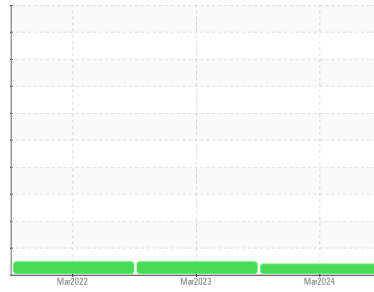

VIS DEBRIS



Machine Id
6312028 (S/N 1242)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA015043	KCP54020	KCP44028
Sample Date	Client Info			22 Mar 2024	07 Mar 2023	11 Mar 2022
Machine Age	hrs	Client Info		24707	20465	15949
Oil Age	hrs	Client Info		4242	4400	7500
Oil Changed	Client Info			Not Chngd	Changed	Changed
Sample Status				ABNORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	10	10
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	2
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	0	5	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	2	0
Zinc	ppm	ASTM D5185m		0	0	2
Sulfur	ppm	ASTM D5185m		17599	19436	14138

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	8
Sodium	ppm	ASTM D5185m		0	<1	1
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	0.016	0.007	0.002
ppm Water	ppm	ASTM D6304	>500	165	75.1	18.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	3074	3970
Particles >6µm		ASTM D7647	>1300	---	1055	1061
Particles >14µm		ASTM D7647	>80	---	42	73
Particles >21µm		ASTM D7647	>20	---	6	16
Particles >38µm		ASTM D7647	>4	---	1	2
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	19/17/13	17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.36	0.45


OIL ANALYSIS REPORT

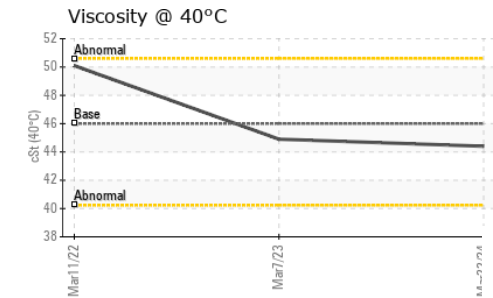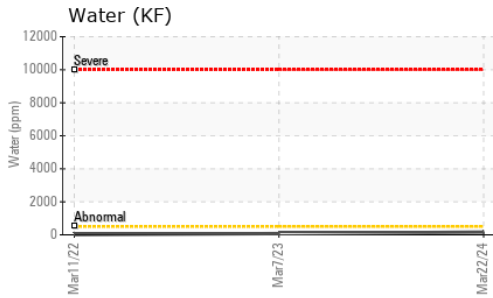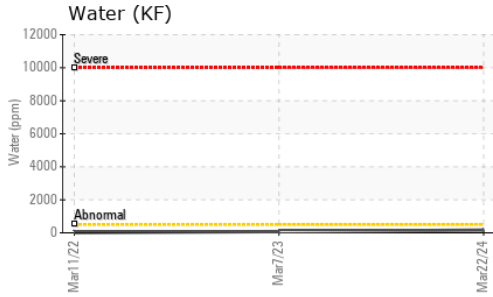





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	50.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

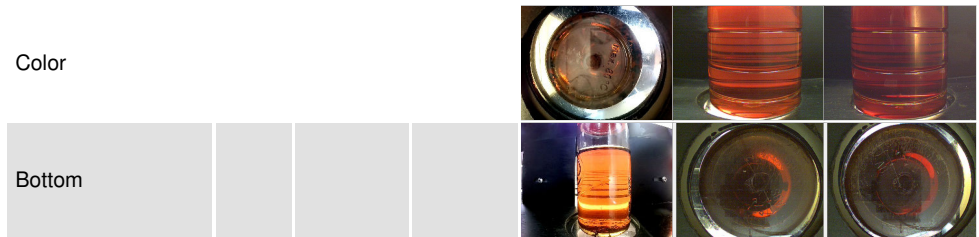

GRAPHS

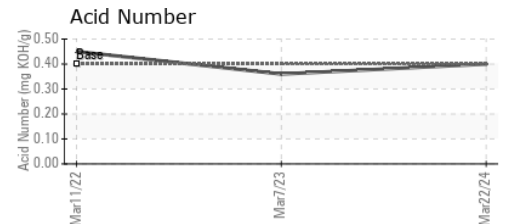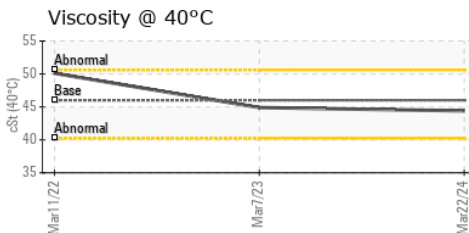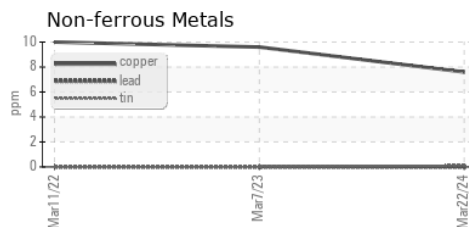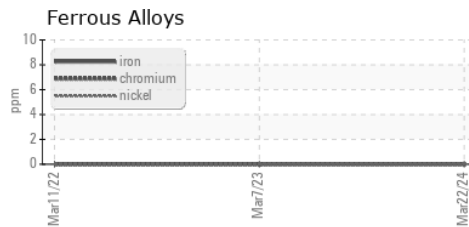

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA015043

Lab Number : 06144272

Unique Number : 10969080

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 10 Apr 2024

Tested : 11 Apr 2024

Diagnosed : 11 Apr 2024 - Doug Bogart

PAUL FUNSTON DYNAMIC CEMENT PRODUCTS

4801 FEATHER RIVER BLVD 30C

OROVILLE, CA

US 95965

Contact: PAUL FUNSTON

nfunston.fis@gmail.com

T:

F: