


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER AS 30 7374371 (S/N 1562)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

וט	Δ		u 🗪		
	\sim	чι	\sim	\sim	\cdot

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		0ct2020 N	May2021 Mar2022 May20	22 Dec2022 May2023 Nov2023	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130486	KCPA010355	KC101176
Sample Date		Client Info		03 Apr 2024	30 Nov 2023	31 May 2023
Machine Age	hrs	Client Info		29429	26186	22106
Oil Age	hrs	Client Info		2973	0	0
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	<1
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	0	1
Copper	ppm	ASTM D5185m	>50	4	10	6
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	0	5	<1
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	30	0
Zinc	ppm	ASTM D5185m		0	18	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	<1
Sodium	ppm	ASTM D5185m		0	<1	1
Potassium	ppm	ASTM D5185m	>20	0	1	2
Water	%	ASTM D6304	>0.05	0.009	0.005	0.003
ppm Water	ppm	ASTM D6304	>500	94	52	37.0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1320	3110	892
Particles >6µm		ASTM D7647	>1300	203	604	319
Particles >14μm		ASTM D7647	>80	17	24	24
Particles >21µm		ASTM D7647	>20	5	5	6
Particles >38μm		ASTM D7647	>4	0	0	1
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/11	19/16/12	17/15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.36	0.46



OIL ANALYSIS REPORT

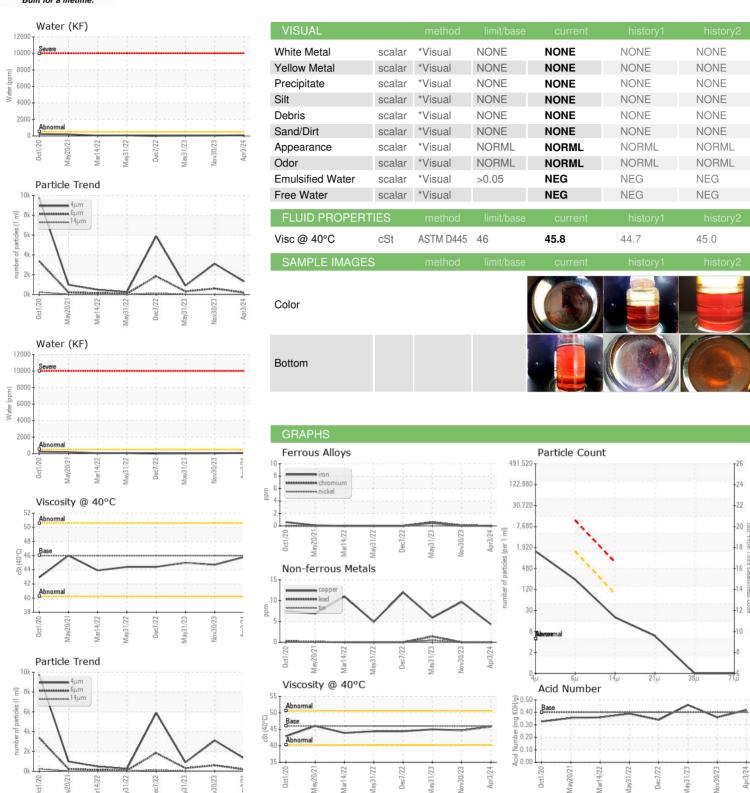



Certificate 12367

Laboratory

Sample No. Lab Number

: KC130486 : 06144281 Unique Number : 10969089 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Apr 2024 **Tested** : 11 Apr 2024

Diagnosed : 11 Apr 2024 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 65 RICHARD RD IVYLAND, PA US 18974 Contact: C. TAUL

AXIAL MEDICAL

ctaul@axial-medical.com

T: F: Contact/Location: C. TAUL - AXIIVY