




OIL ANALYSIS REPORT

Sample Rating Trend

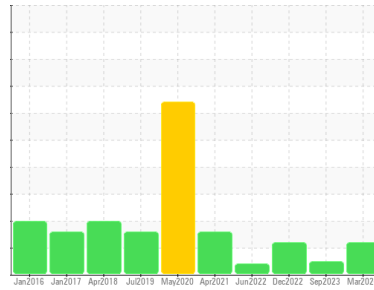

ISO



Machine Id
KAESER ASD 25 5183159 (S/N 1046)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016370	KCPA005697	KCP53332
Sample Date	Client Info			21 Mar 2024	01 Sep 2023	27 Dec 2022
Machine Age	hrs	Client Info		28851	27682	26730
Oil Age	hrs	Client Info		8000	0	1500
Oil Changed	Client Info			Not Chngd	N/A	Not Chngd
Sample Status				ATTENTION	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	6	11	9
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	39	0	26
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	6	0
Zinc	ppm	ASTM D5185m		72	105	111
Sulfur	ppm	ASTM D5185m		20464	17858	21689

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	0
Sodium	ppm	ASTM D5185m		19	1	12
Potassium	ppm	ASTM D5185m	>20	3	0	<1
Water	%	ASTM D6304	>0.05	0.015	0.003	0.020
ppm Water	ppm	ASTM D6304	>500	158	34.2	200.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5351	2870	5509
Particles >6µm		ASTM D7647	>1300	1249	1010	1369
Particles >14µm		ASTM D7647	>80	95	76	100
Particles >21µm		ASTM D7647	>20	30	26	28
Particles >38µm		ASTM D7647	>4	1	3	1
Particles >71µm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/17/14	19/17/13	20/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.41	0.35

OIL ANALYSIS REPORT

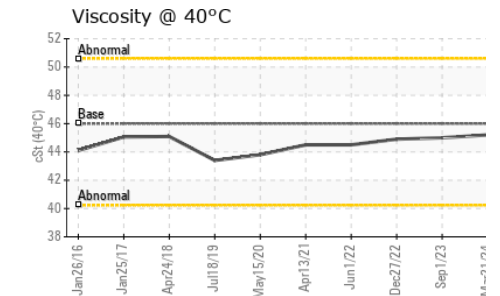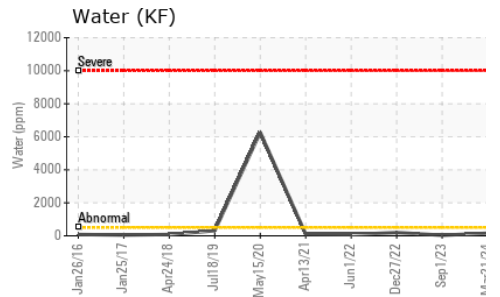
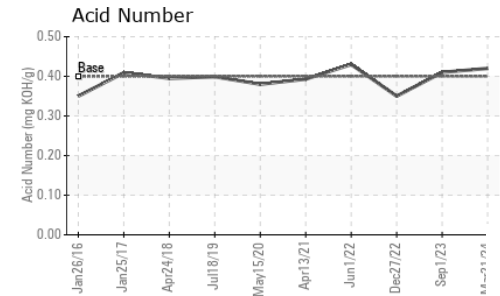
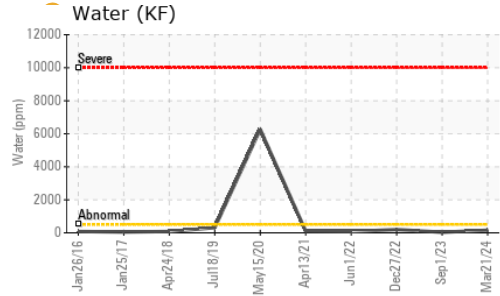
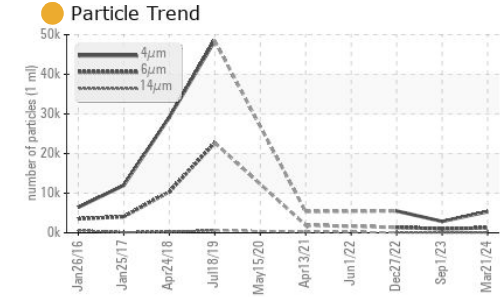


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	LIGHT	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.2	45.0	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

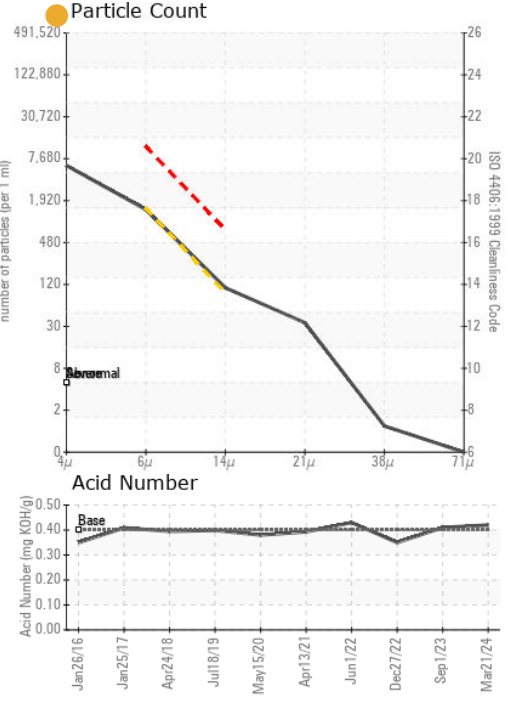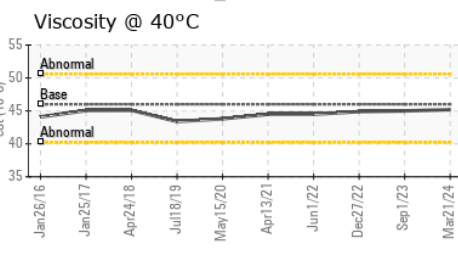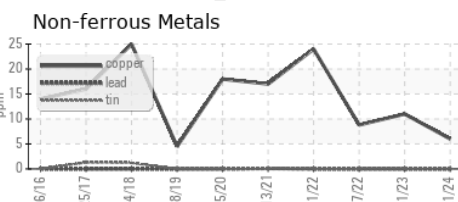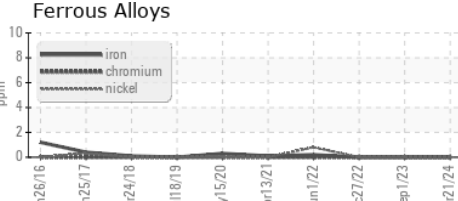

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016370
Lab Number : 06144290
Unique Number : 10969098
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 10 Apr 2024
Tested : 11 Apr 2024
Diagnosed : 11 Apr 2024 - Doug Bogart

ARAMARK
 401 GLEN IRIS DR NE
 ATLANTA, GA
 US 30308
 Contact: ERIC SMITH
 smith-eric14@aramark.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)