


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER ASD40S 6265892 (S/N 1239)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in

	Dec201	8 Apr2019	Jun2020 Ap	or2024	
SAMPLE INFORMATION	ON method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA016913	KCP26844	KCP12519
Sample Date	Client Info		01 Apr 2024	08 Jun 2020	16 Apr 2019
Machine Age hrs	Client Info		41133	14900	6929
Oil Age hrs	Client Info		7000	3000	2735
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			NORMAL	ATTENTION	NORMAL
WEAR METALS	method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m	>50	0	<1	<1
Chromium ppm	ASTM D5185m	>10	0	0	0
Nickel ppm	ASTM D5185m	>3	0	6	4
Titanium ppm		>3	0	0	0
Silver ppm		>2	0	0	0
Aluminum ppm		>10	0	<1	0
Lead ppm		>10	0	1	0
Copper ppm			1	18	3
Tin ppm		>10	<1	0	0
1-1-		>10	< 1	0	0
Antimony ppm					
Vanadium ppm			0	0	0
Cadmium ppm	ASTM D5185m		0	0	0
ADDITIVES	method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	0	<1	<1
Barium ppm	ASTM D5185m	90	0	<1	0
Molybdenum ppm	ASTM D5185m	0	3	2	1
Manganese ppm	ASTM D5185m		0	0	0
Magnesium ppm	ASTM D5185m	100	0	<1	<1
Calcium ppm	ASTM D5185m	0	0	0	<1
Phosphorus ppm	ASTM D5185m	0	0	4	2
Zinc ppm	ASTM D5185m	0	0	32	36
Sulfur ppm	ASTM D5185m	23500	18189	16719	22776
CONTAMINANTS	method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m	>25	21	11	8
Sodium ppm	ASTM D5185m		<1	0	<1
Potassium ppm	ASTM D5185m	>20	0	4	0
Water %	ASTM D6304	>0.05	0.004	0.008	0.010
ppm Water ppm	ASTM D6304	>500	46	81.5	100
FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7018	7568	1510
Particles >6µm	ASTM D7647	>1300	1247	1647	455
Particles >14µm	ASTM D7647	>80	70	57	19
Particles >21µm	ASTM D7647	>20	16	10	5
Particles >38µm	ASTM D7647	>4	1	1	1
Particles >71µm	ASTM D7647		0	0	0
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/17/13	18/13	16/11
FLUID DEGRADATION	I method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

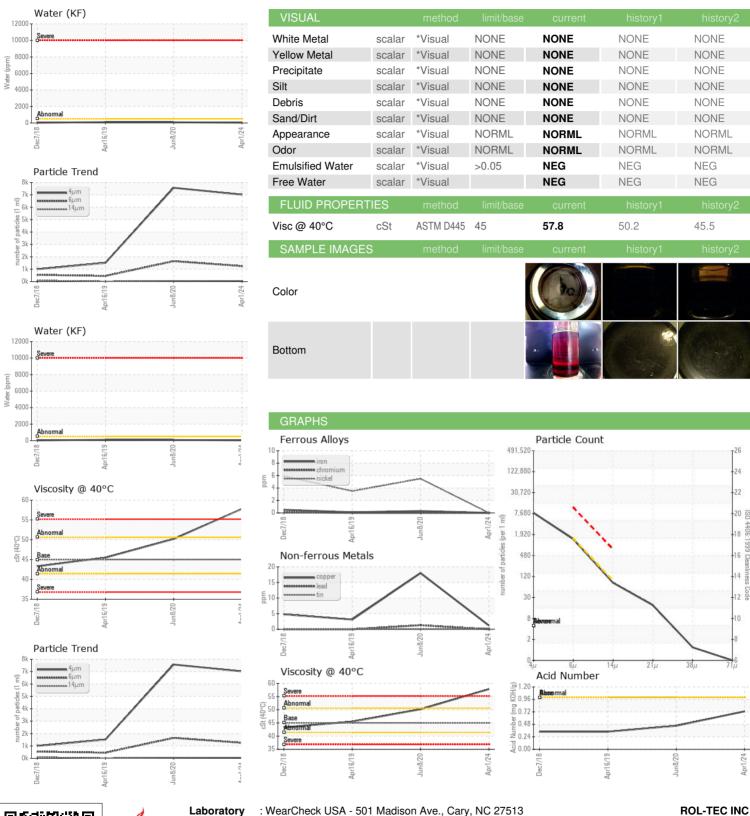





Certificate 12367

Laboratory

Sample No. Lab Number Unique Number : 10969099

: KCPA016913 : 06144291

Received **Tested** Diagnosed

: 10 Apr 2024 Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 11 Apr 2024

: 11 Apr 2024 - Doug Bogart

Contact: J. STIVVE jstivve@rol-tec.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 1150 GLORY RD

GREEN BAY, WI

US 54304

T:

F: