




OIL ANALYSIS REPORT

Sample Rating Trend

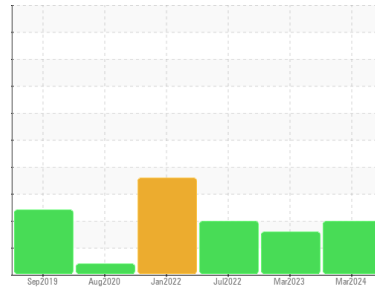

ISO



Machine Id
KAESER SM 10 6289799 (S/N 1017)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015776	KCP54567	KCP40547
Sample Date	Client Info		26 Mar 2024	02 Mar 2023	15 Jul 2022
Machine Age	hrs	Client Info	51363	42021	36510
Oil Age	hrs	Client Info	9342	5511	9111
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	9	8	9
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 100	0	2	0
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	0	3	5
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 23500	16955	19249	14315

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	<1
Sodium	ppm	ASTM D5185m	0	<1	<1
Potassium	ppm	ASTM D5185m >20	0	0	0
Water	%	ASTM D6304 >0.05	0.008	0.007	0.009
ppm Water	ppm	ASTM D6304 >500	80	76.6	96.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		44903	14919	27188
Particles >6µm	ASTM D7647	>1300	▲ 13596	▲ 4260	▲ 7092
Particles >14µm	ASTM D7647	>80	▲ 939	▲ 145	▲ 372
Particles >21µm	ASTM D7647	>20	▲ 216	▲ 28	▲ 100
Particles >38µm	ASTM D7647	>4	▲ 5	1	▲ 6
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	▲ 21/19/14	▲ 22/20/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.50	0.50	0.41

OIL ANALYSIS REPORT

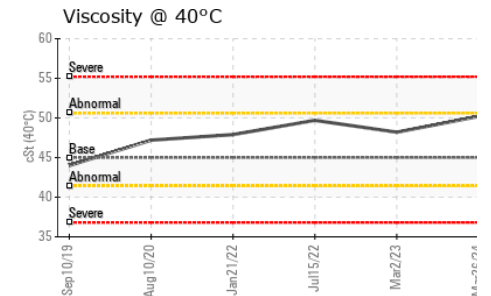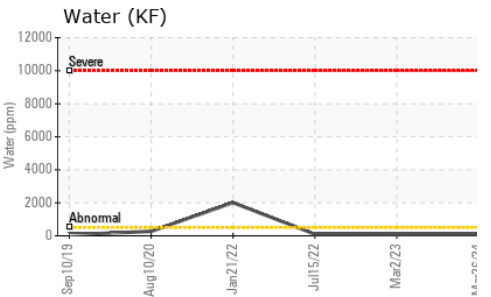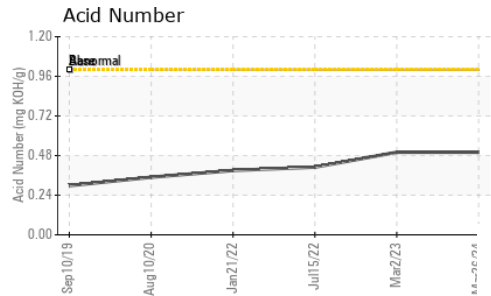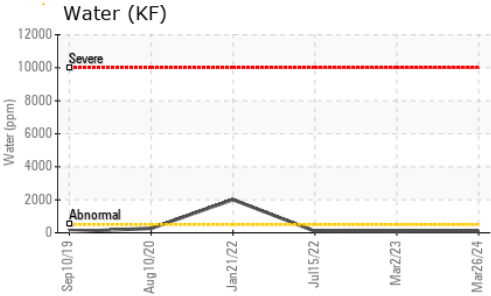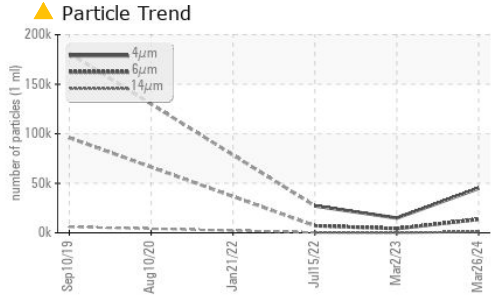

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	50.2	48.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Date	Iron	Chromium	Nickel
Sep 10/19	~10	~10	~10
Aug 10/20	~10	~10	~10
Jan 21/22	~10	~10	~10
Jul 15/22	~10	~10	~10
Mar 2/23	~10	~10	~10
Mar 26/24	~10	~10	~10

Date	Copper	Lead	Tin
Sep 10/19	~10	~10	~10
Aug 10/20	~10	~10	~10
Jan 21/22	~10	~10	~10
Jul 15/22	~10	~10	~10
Mar 2/23	~10	~10	~10
Mar 26/24	~10	~10	~10

Date	4µm	6µm	14µm	21µm	38µm	71µm
Sep 10/19	~100	~100	~100	~100	~100	~100
Aug 10/20	~100	~100	~100	~100	~100	~100
Jan 21/22	~100	~100	~100	~100	~100	~100
Jul 15/22	~100	~100	~100	~100	~100	~100
Mar 2/23	~100	~100	~100	~100	~100	~100
Mar 26/24	~100	~100	~100	~100	~100	~100

Date	Acid Number (mg KOH/g)
Sep 10/19	~0.24
Aug 10/20	~0.24
Jan 21/22	~0.24
Jul 15/22	~0.24
Mar 2/23	~0.24
Mar 26/24	~0.24



Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015776
Lab Number : 06144293
Unique Number : 10969101
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 10 Apr 2024
Tested : 11 Apr 2024
Diagnosed : 11 Apr 2024 - Doug Bogart

PENSKE
 400 INTERSTATE WEST PKWY
 LITHIA SPRINGS, GA
 US 30122
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)