




# OIL ANALYSIS REPORT

Sample Rating Trend

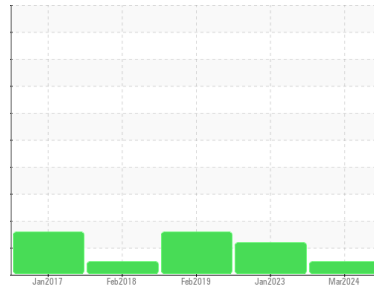

**NORMAL**



Machine Id  
**KAESER SX 7.5 4311413 (S/N 1009)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA015049</b>	KCP54874	KCP00571
Sample Date	Client Info			<b>21 Mar 2024</b>	26 Jan 2023	13 Feb 2019
Machine Age	hrs	Client Info		<b>11097</b>	9714	5802
Oil Age	hrs	Client Info		<b>2000</b>	2000	1000
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>8</b>	2	2
Tin	ppm	ASTM D5185m	>10	<b>1</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>20</b>	29	24
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>69</b>	75	70
Calcium	ppm	ASTM D5185m	2	<b>6</b>	1	2
Phosphorus	ppm	ASTM D5185m		<b>2</b>	5	4
Zinc	ppm	ASTM D5185m		<b>17</b>	5	9
Sulfur	ppm	ASTM D5185m		<b>33806</b>	20383	17901

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	1	2
Sodium	ppm	ASTM D5185m		<b>26</b>	24	16
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	5	3
Water	%	ASTM D6304	>0.05	<b>0.009</b>	0.019	0.020
ppm Water	ppm	ASTM D6304	>500	<b>98</b>	196.8	200

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3485</b>	8272	13136
Particles >6µm		ASTM D7647	>1300	<b>948</b>	● 1907	▲ 4403
Particles >14µm		ASTM D7647	>80	<b>42</b>	● 83	▲ 728
Particles >21µm		ASTM D7647	>20	<b>12</b>	16	▲ 218
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	● 10
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/17/13</b>	● 20/18/14	▲ 19/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.35</b>	0.35	0.356


# OIL ANALYSIS REPORT

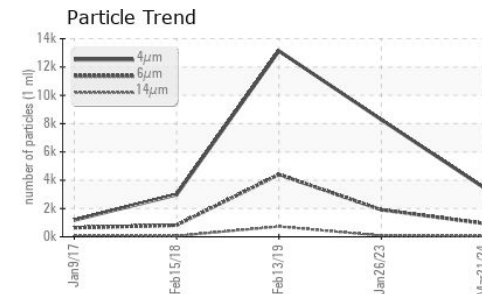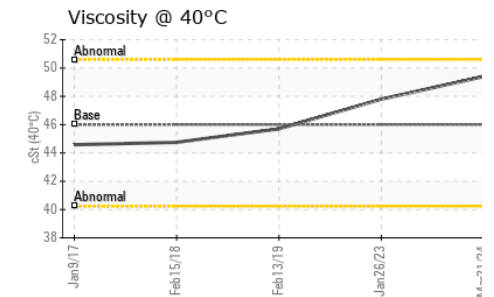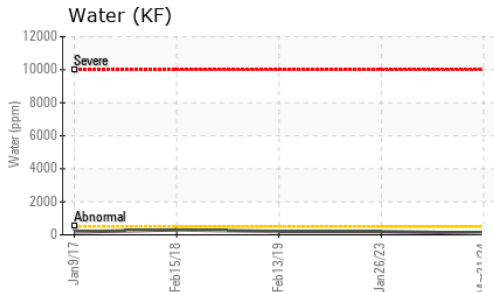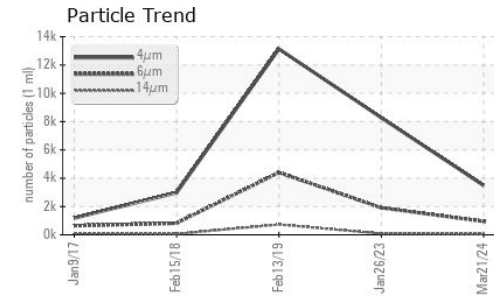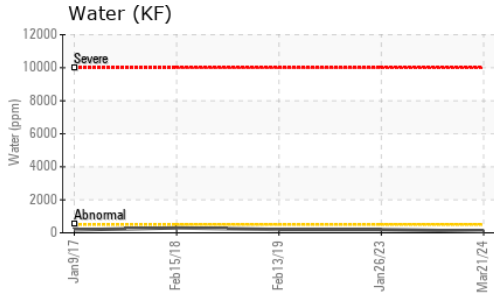






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	49.4	47.8	45.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

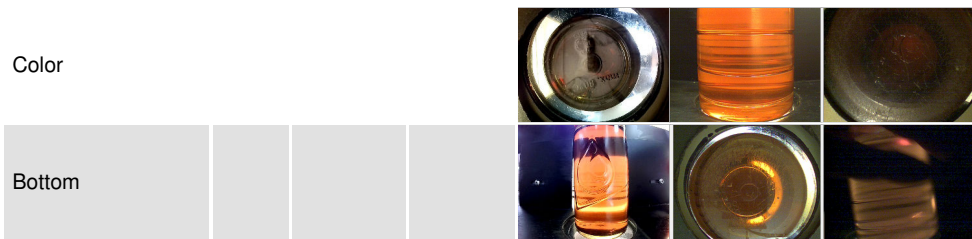

## GRAPHS

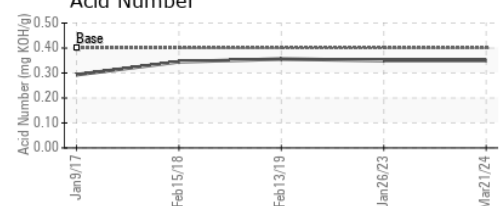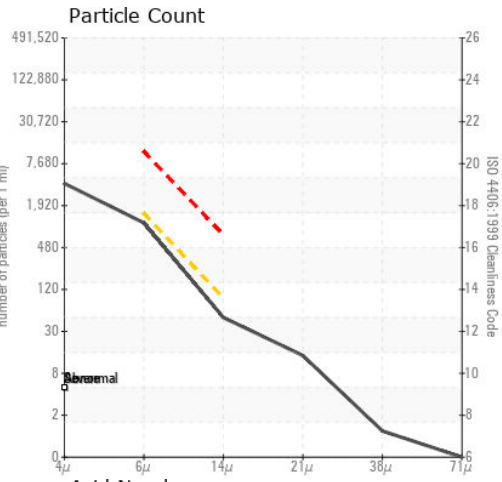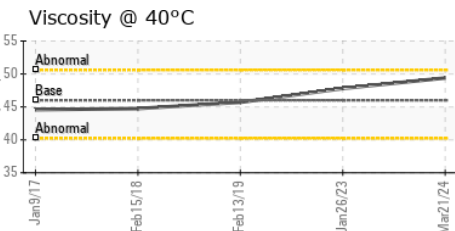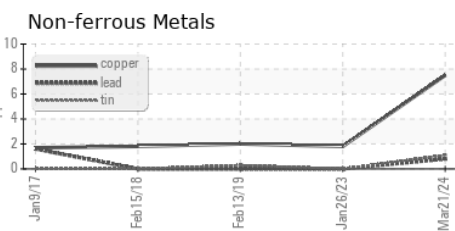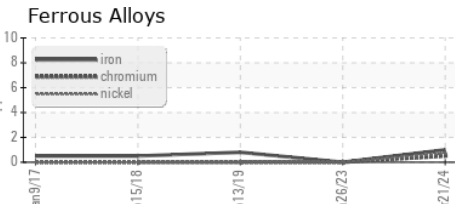

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015049 **Received** : 10 Apr 2024  
**Lab Number** : 06144297 **Tested** : 11 Apr 2024  
**Unique Number** : 10969105 **Diagnosed** : 11 Apr 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**DUNNS SPORTING GOODS**  
 6034 W NATIONAL AVE  
 WEST ALLIS, WI  
 US 53214  
 Contact: ZACH  
 zach@dunnssportinggoods.net

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)