

OIL ANALYSIS REPORT

Area ULTRA COOLANT [SVO-59790] INGERSOLL RAND EE1718U98237 - MODINE

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






NORMAL


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06144343		
Sample Date		Client Info		27 Mar 2024		
Machine Age	hrs	Client Info		67613		
Oil Age	hrs	Client Info		5260		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	2		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>15	2		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	500	611		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	0	6		
Phosphorus	ppm	ASTM D5185m	20	6		
Zinc	ppm	ASTM D5185m	0	61		
Sulfur	ppm	ASTM D5185m	200	231		
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m		30		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.12		



OIL ANALYSIS REPORT

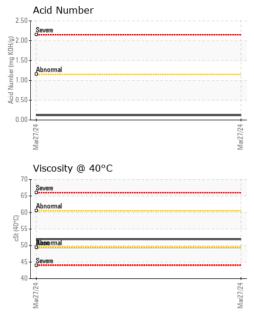

	VISUAL		method	limit/base	current	history1	history2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
Mar27/24	Appearance	scalar	*Visual	NORML	NORML		
Mar	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
1	Free Water	scalar	*Visual		NEG		
	FLUID PROPERT	IES	method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	49.4	51.9		
	SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Mar27/24 -	Color					no image	no image
	Bottom					no image	no image
	Non-ferrous Metal			Mar27/24			
	Viscosity @ 40°C			0.0 4010 Mar27124	Acid Number		Mar2/24
Laboratory Sample No. Lab Number Unique Number Test Package o discuss this sample report, Denotes test methods that tatements of conformity to sp	: WearCheck USA - 50 : UCH06144343 : 06144343 : 10969151 : IND 2 ; contact Customer Servi are outside of the ISO 1	Rece Teste Diagr ice at 1-8 7025 sco	ived : 10 ed : 11 nosed : 12 800-237-1368 ope of accred	v, NC 27513 0 Apr 2024 1 Apr 2024 2 Apr 2024 - Se 9. ditation.	JOHN ean Felton Co	SAI ntact: RACHEL rvonł T:	ER COMPANY RGET STREET NT LOUIS, MO US 63134



Contact/Location: RACHEL VON HATTEN - UCJOHSAI