

## **OIL ANALYSIS REPORT**

# **KAESER FG-460 [8507] KAESER 1006 - ANTHONY MARANO CO**

Component Compressor

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

Area


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

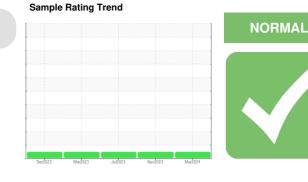


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06144363	UCH06015207	UCH05920742
Sample Date		Client Info		15 Mar 2024	15 Nov 2023	24 Jul 2023
Machine Age	hrs	Client Info		10608	10430	10237
Oil Age	hrs	Client Info		158	193	372
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	۷	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	0	2
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	4	4	10
Lead	ppm	ASTM D5185m	>10	<1	0	2
Copper	ppm	ASTM D5185m	>50	1	0	5
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	1
Manganese	ppm	ASTM D5185m		1	<1	2
Magnesium	ppm	ASTM D5185m		3	<1	1
Calcium	ppm	ASTM D5185m		4	2	0
Phosphorus	ppm	ASTM D5185m	500	498	469	443
Zinc	ppm	ASTM D5185m		64	67	84
Sulfur	ppm	ASTM D5185m		2188	1604	1961
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	1
Sodium	ppm	ASTM D5185m		0	0	5
Potassium	ppm	ASTM D5185m	>20	<1	0	3
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.63	1.36	1.35



## **OIL ANALYSIS REPORT**

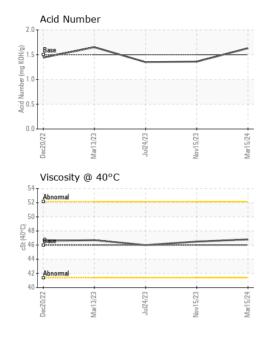

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
			Provide Managers		1 C	
FLUID PROPERT	IES	method	limit/base	current	history1	history2
FLUID PROPERT Visc @ 40°C	IES cSt	ASTM D445	46	46.8	46.5	46.0
	cSt					
Visc @ 40°C	cSt	ASTM D445	46	46.8	46.5	46.0

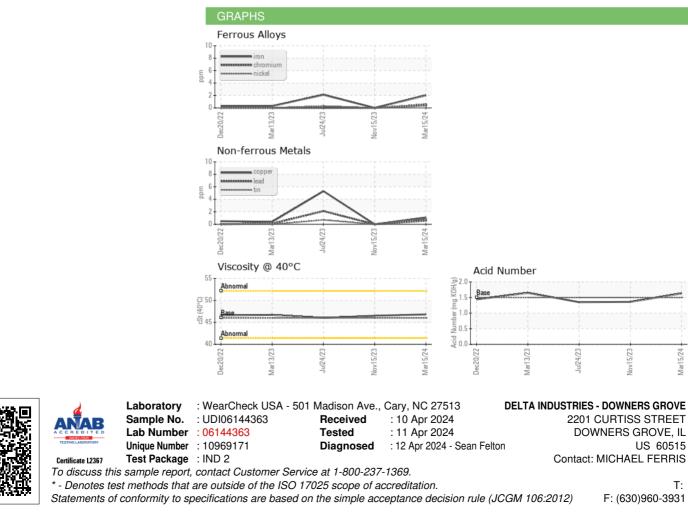

Report Id: UCDELDOW [WUSCAR] 06144363 (Generated: 04/12/2024 19:04:38) Rev: 1

Contact/Location: MICHAEL FERRIS - UCDELDOW