




COOLANT REPORT

Machine Id
Grand Blanc CAT 1 GBLM01BE
 Component
Auxiliary Circuit Coolant
 Fluid
CHEVRON HEAVY DUTY PF COOLANT (--- GAL)

Sample Rating Trend

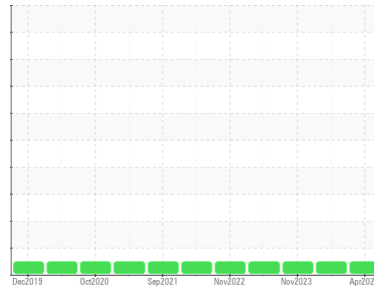

NORMAL



DIAGNOSIS

Recommendation

The fluid is suitable for further service. (Customer Sample Comment: Aux coolant. First sample after engine swap)

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0905656	WC0905727	WC0870100
Sample Date	Client Info		04 Apr 2024	19 Mar 2024	03 Nov 2023
Machine Age	hrs	Client Info	7741	7276	82521
Oil Age	hrs	Client Info	602	130	15487
Oil Changed	Client Info		Changed	Not Changd	N/A
Sample Status			NORMAL	NORMAL	NORMAL

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.067	1.067	1.067
pH	Scale 0-14	ASTM D1287 10.5	9.19	8.89	9.46
Nitrites	ppm	AP-053:2009 >800	1388	1276	1164
Reserve Alkalinity	Scale 0-20	*ASTM D1121	---	---	---
Percentage Glycol	%	ASTM D3321 50	49.8	50.0	49.6
Freezing Point	°F	ASTM D3321 -37	-33	-35	-33
Total Dissolved Solids			274.5	268.0	248.5
Carboxylate			n/a	n/a	n/a

CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130 1000	125	101	24
Phosphorus	ppm	ASTM D6130 0	12	12	4
Boron	ppm	ASTM D6130	380	352	322
Molybdenum	ppm	ASTM D6130	229	226	192

CORROSION

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130 >15	<1	1	0
Aluminum	ppm	ASTM D6130 >10	0	1	0
Copper	ppm	ASTM D6130 >10	<1	1	<1
Lead	ppm	ASTM D6130 >10	0	<1	<1
Tin	ppm	ASTM D6130 >10	0	0	1
Zinc	ppm	ASTM D6130	0	<1	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130	0	5	7

CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130	2212	2223	1949
Potassium	ppm	ASTM D6130	21	46	21







SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D6130	1	3	2
Magnesium	ppm	ASTM D6130	0	0	1






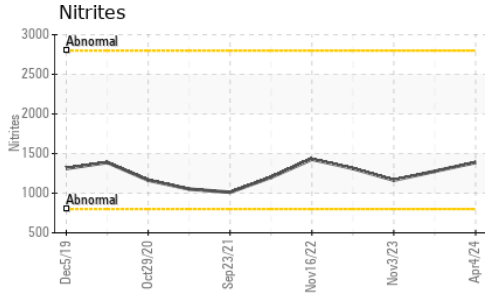


COOLANT REPORT



VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	Grn/Prpl	Pink	Pink	Pink
Coolant Appearance	*Visual	Clear	normal	normal	normal
Color					
Bottom					

GRAPHS

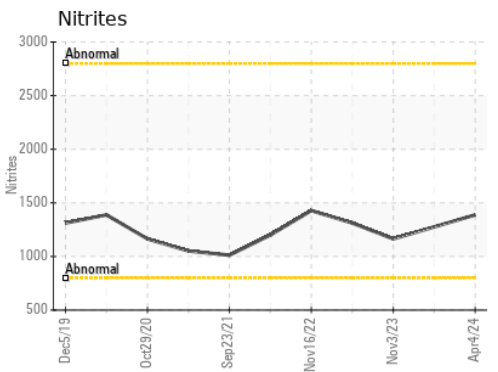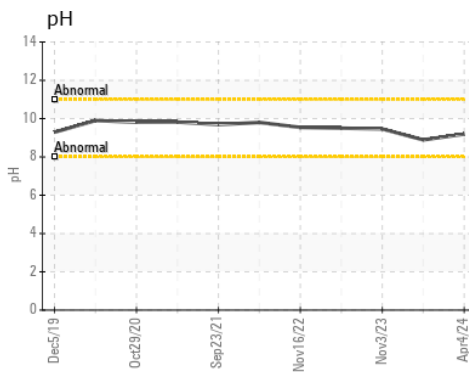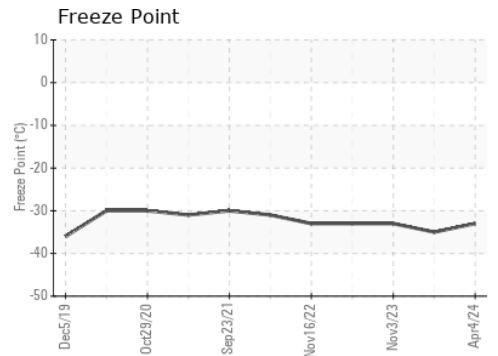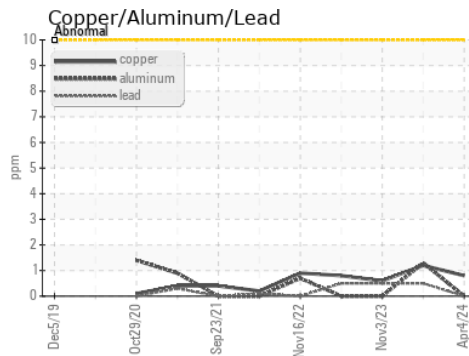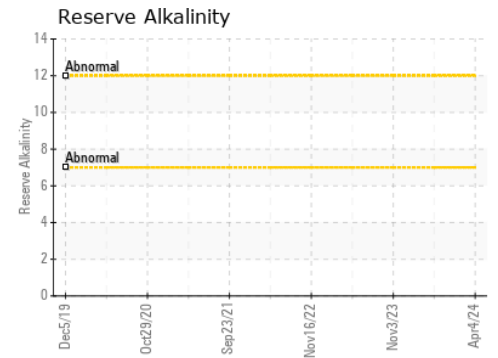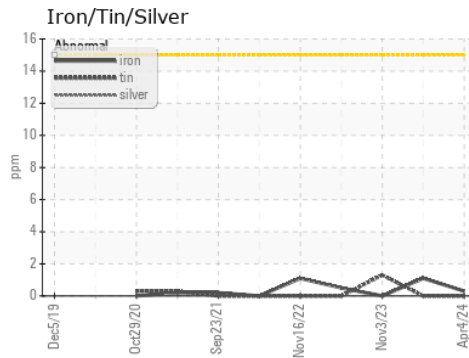

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905656 **Received** : 10 Apr 2024
Lab Number : 06144799 **Tested** : 19 Apr 2024
Unique Number : 10969607 **Diagnosed** : 19 Apr 2024 - Jonathan Hester
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType, ICP)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439

Contact: Tony Saint Marie
tony.saintmarie@edlenergy.com

T:
F: