




COOLANT REPORT

Machine Id
Grand Blanc CAT 5 GBLM05BE
 Component
Auxiliary Circuit Coolant
 Fluid
CHEVRON HEAVY DUTY PF COOLANT (--- GAL)

Sample Rating Trend

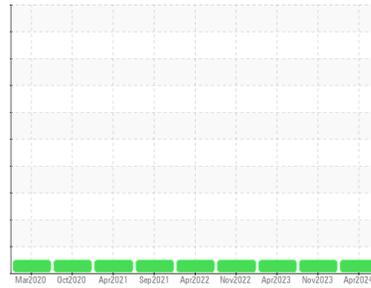

NORMAL



DIAGNOSIS

Recommendation

The fluid is suitable for further service. (Customer Sample Comment: 5 aux sample 6mo)

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0905664	WC0870108	WC0795339
Sample Date	Client Info		04 Apr 2024	06 Nov 2023	05 Apr 2023
Machine Age	hrs	Client Info	59717	56225	51396
Oil Age	hrs	Client Info	12559	9067	4238
Oil Changed		Client Info	Not Changed	Not Changd	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.069	1.069	1.069
pH	Scale 0-14	ASTM D1287 10.5	9.09	8.92	8.89
Nitrites	ppm	AP-053:2009 >800	1688	1164	1200
Reserve Alkalinity	Scale 0-20	*ASTM D1121	---	---	---
Percentage Glycol	%	ASTM D3321 50	51.7	51.9	51.9
Freezing Point	°F	ASTM D3321 -37	-38	-38	-38
Total Dissolved Solids			271.5	231.5	252.5
Carboxylate			n/a	n/a	fail

CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130 1000	40	28	82
Phosphorus	ppm	ASTM D6130 0	14	5	16
Boron	ppm	ASTM D6130	390	253	611
Molybdenum	ppm	ASTM D6130	235	155	366

CORROSION

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130 >15	<1	0	<1
Aluminum	ppm	ASTM D6130 >10	0	0	0
Copper	ppm	ASTM D6130 >10	1	<1	1
Lead	ppm	ASTM D6130 >10	0	<1	<1
Tin	ppm	ASTM D6130 >10	0	1	0
Zinc	ppm	ASTM D6130	0	0	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130	2	7	24

CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130	2242	1466	3117
Potassium	ppm	ASTM D6130	181	122	348

SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D6130	1	2	2
Magnesium	ppm	ASTM D6130	0	1	0









COOLANT REPORT

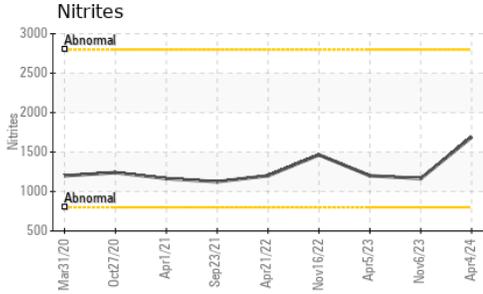

VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	Grn/Prpl	Pink	Pink	Pink
Coolant Appearance	*Visual	Clear	normal	normal	normal
Color					
Bottom					

GRAPHS

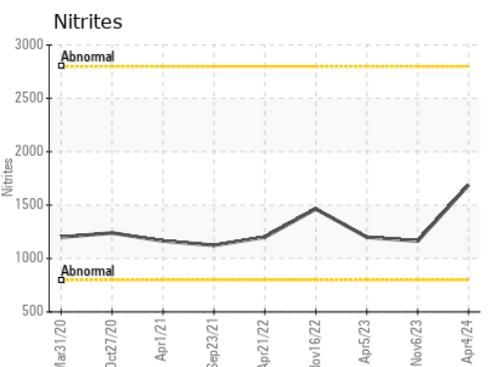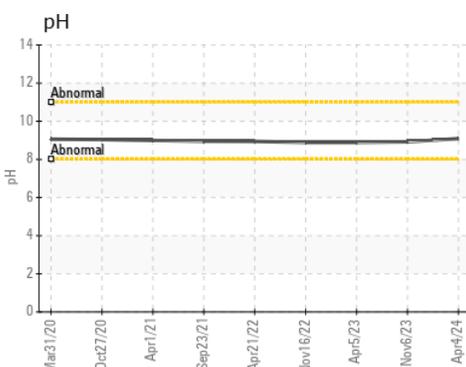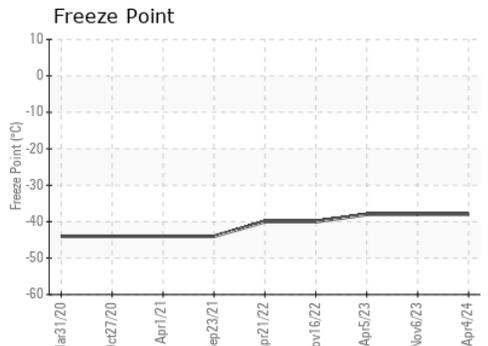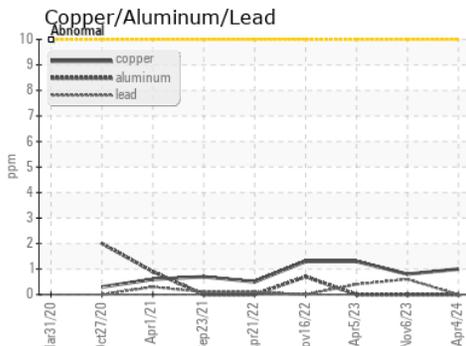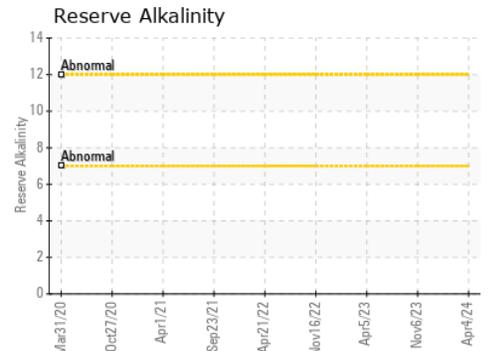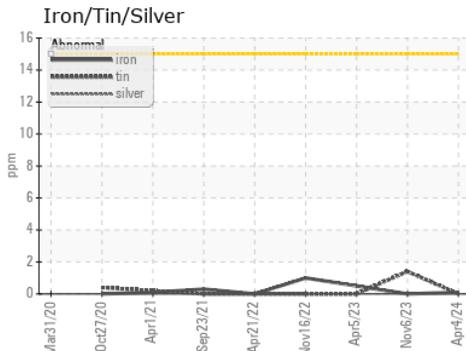

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905664 **Received** : 10 Apr 2024
Lab Number : 06144801 **Tested** : 19 Apr 2024
Unique Number : 10969609 **Diagnosed** : 19 Apr 2024 - Jonathan Hester
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType, ICP)

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439
 Contact: Tony Saint Marie
 tony.saintmarie@edlenrgy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)