

COOLANT REPORT

Sample Rating Trend



Recommendation


Machine Id Grand Blanc CAT 7 GBLM07BE **Auxiliary Circuit Coolant**

CHEVRON HEAVY DUTY PF COOLANT (--- GAL)

Sample Number

SAMPLE INFORMATION method

Client Info



WC0905668

04 Apr 2024

129829

Changed

NORMAL

1.067

9.64

1240

---40

2758

WC0870122

126342

NORMAL

1.067

9.57

1164

40

15385

N/A



WC0795331

06 Nov 2023 06 Apr 2023

0

0

N/A

NORMAL

1.067

9.66

1312

40


The fluid is suitable for further service. (Customer Sample Date Client Info Sample Comment: 7 aux sample 6 mo) Machine Age hrs **Client Info** Corrosion Oil Age hrs Client Info All metal levels are normal indicating no corrosion Oil Changed **Client Info** in the cooling system. Sample Status Contaminants PHYSICAL TEST RESULTS method There is no indication of any contamination in the coolant. Glycol Type FT-IR Specific Gravity *ASTM D1298 **Coolant Condition** Glycol and nitrite levels are acceptable. The pH pН Scale 0-14 ASTM D1287 10.5 level of this fluid is within the acceptable limits. Nitrites ppm AP-053:2009 >800 Scale 0-20 *ASTM D1121 **Reserve Alkalinity** Pe 0/ AOTH DOOOL F Т С

Percentage Glycol	%	ASTM D3321	50	49.5	49.5	49.4
Freezing Point	°F	ASTM D3321	-37	-33	-33	-33
Total Dissolved Solids				270.0	211.0	223.5
Carboxylate				n/a	n/a	fail
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130	1000	47	44	86
Phosphorus	ppm	ASTM D6130	0	14	4	17
Boron	ppm	ASTM D6130		385	300	587
Molybdenum	ppm	ASTM D6130		237	182	347
CORROSION		method	limit/base	current	history1	history2
Iron	nnm		. 15	0	0	.1


Iron	ppm	ASTM D6130	>15	0	0	<1
Aluminum	ppm	ASTM D6130	>10	0	0	0
Copper	ppm	ASTM D6130	>10	<1	<1	1
Lead	ppm	ASTM D6130	>10	0	<1	<1
Tin	ppm	ASTM D6130	>10	0	1	0
Zinc	ppm	ASTM D6130		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130		0	6	23
CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130		2246	1753	3081
Potassium	ppm	ASTM D6130		25	13	86
	pp	7101111 20100				
SCALE POTENTI		method	limit/base	current	history1	history2
SCALE POTENTI Calcium			limit/base	current	history1	history2 <1



COOLANT REPORT





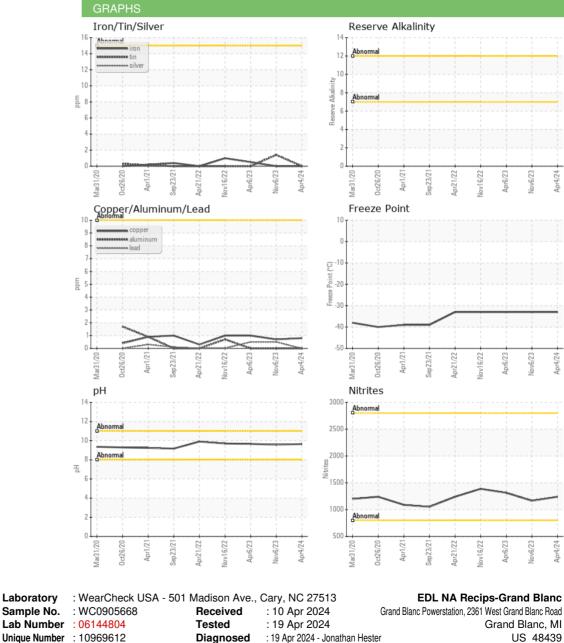

 Lab Number
 . 100144004
 Tested
 . 19 Apr 2024

 Unique Number
 : 10969612
 Diagnosed
 : 19 Apr 2024 - Jonathan Hester

 Certificate L2367
 Test Package
 : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType, ICP)
 Cordiscuss this sample report, contact Customer Service at 1-800-237-1369.

 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: EDLGRA [WUSCAR] 06144804 (Generated: 04/19/2024 06:58:11) Rev: 1

Submitted By: Tony Saint Marie Page 2 of 2

tony.saintmarie@edlenergy.com

Contact: Tony Saint Marie

T:

F: